


EXIT

EXIT

**TEMPORARY FIRE
EXTINGUISHER**

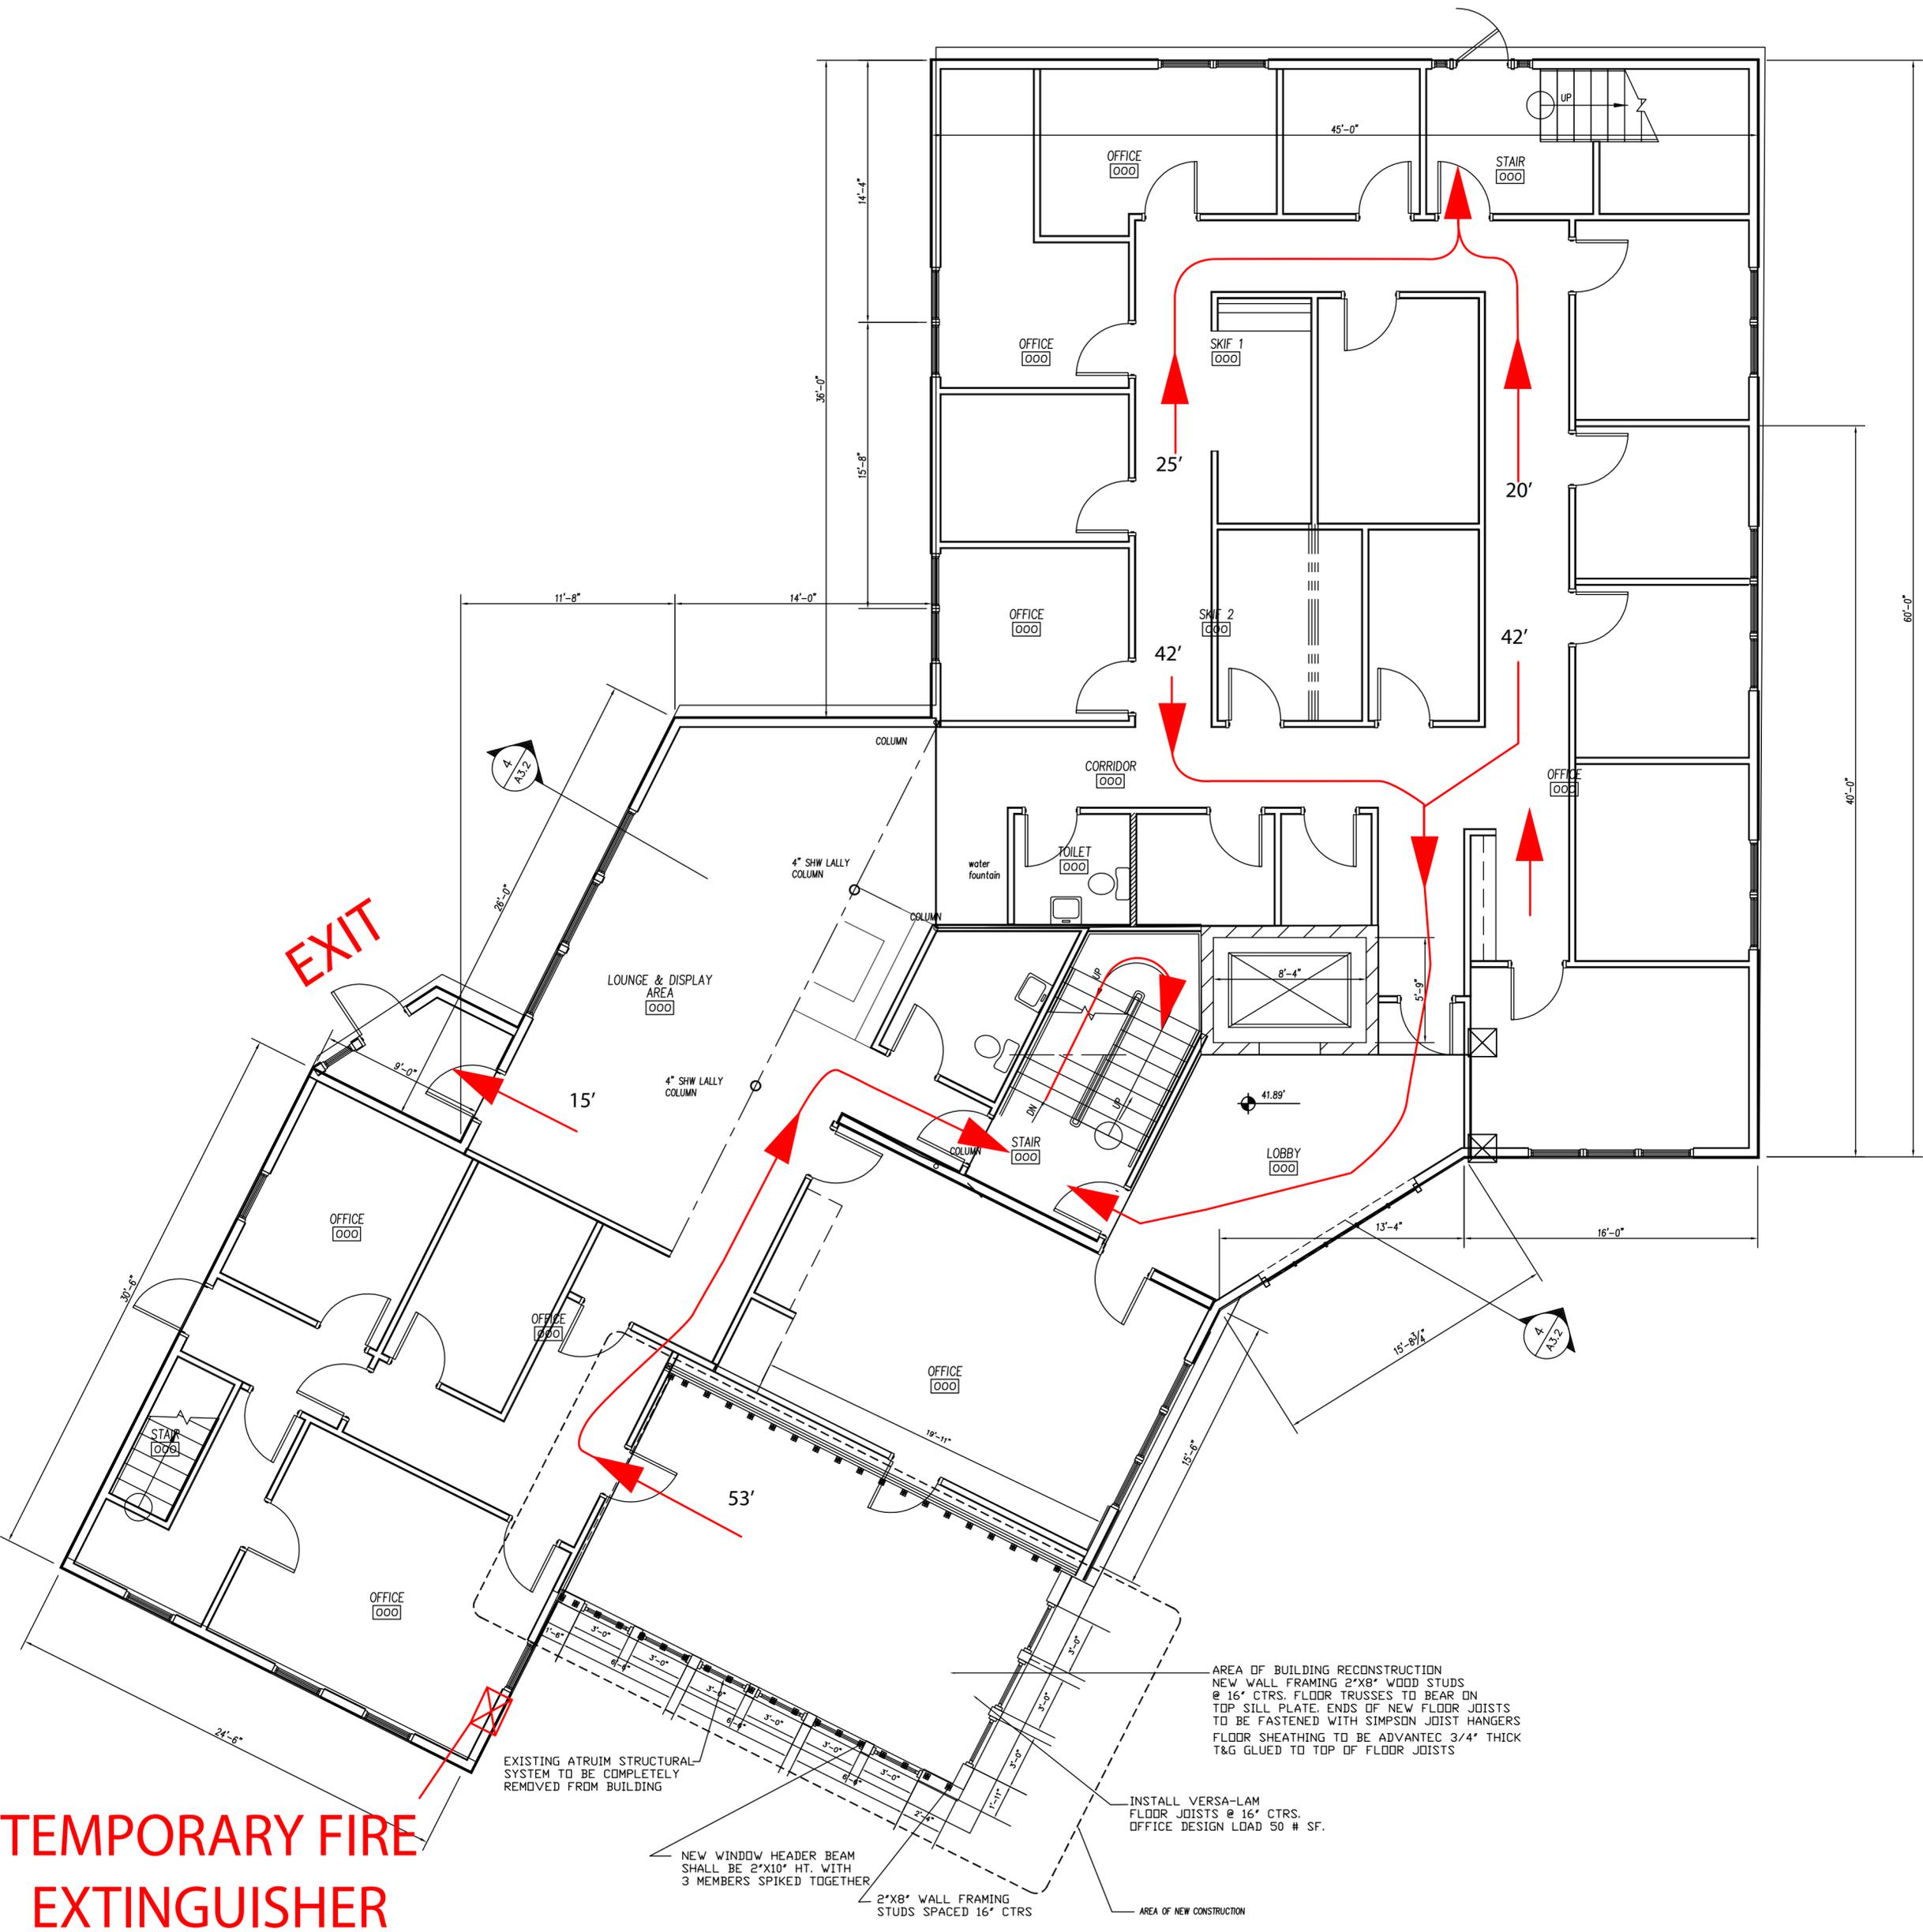

AREA OF BUILDING RECONSTRUCTION
NEW WALL FRAMING 2"x8" WOOD STUDS @ 16" CTRS. FLOOR TRUSSES TO BEAR ON TOP SILL PLATE. ENDS OF NEW FLOOR JOISTS TO BE FASTENED WITH SIMPSON JOIST HANGERS. FLOOR SHEATHING TO BE ADVANTEC 3/4" THICK T&G GLUED TO TOP OF FLOOR JOISTS

INSTALL VERSA-LAM FLOOR JOISTS @ 16" CTRS. OFFICE DESIGN LOAD 50 # SF.

NEW WINDOW HEADER BEAM SHALL BE 2"x10" HT. WITH 3 MEMBERS SPIKED TOGETHER

2"x8" WALL FRAMING STUDS SPACED 16" CTRS

EXISTING ATRUIM STRUCTURAL SYSTEM TO BE COMPLETELY REMOVED FROM BUILDING

AREA OF NEW CONSTRUCTION