



Second Floor

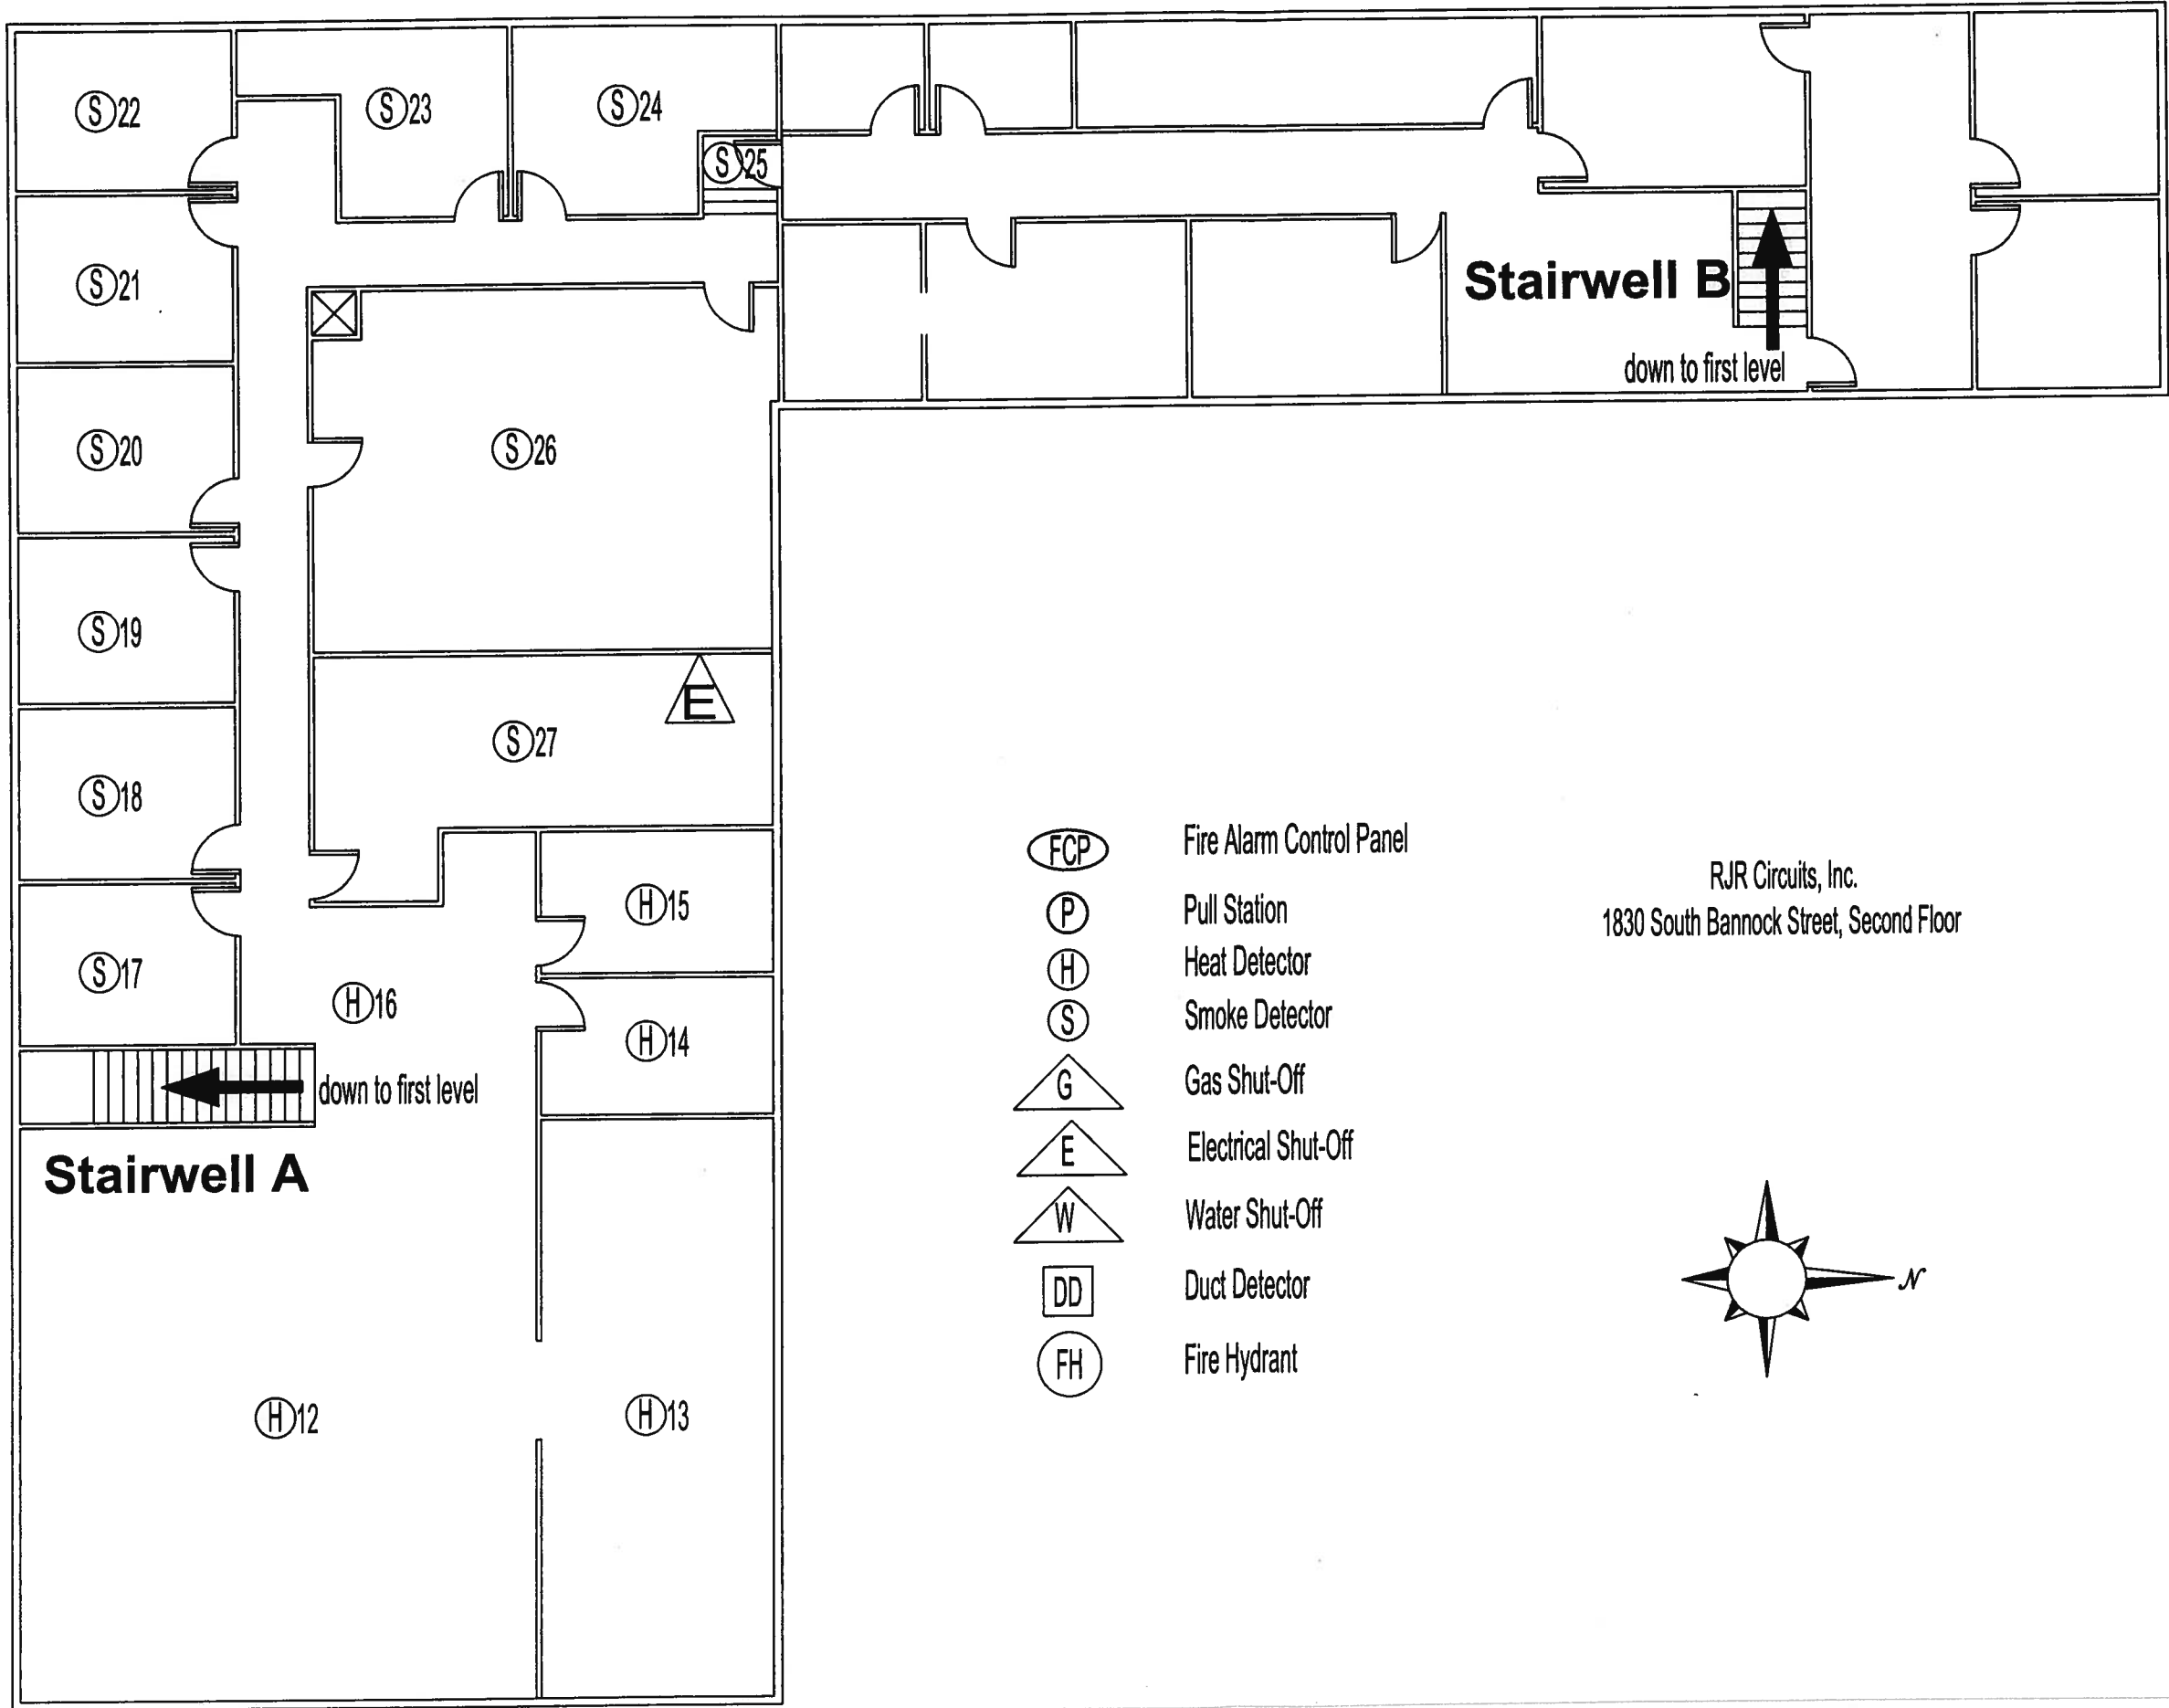


RJR Circuits, Inc.
1830 South Bannock Street, Second Floor




FH

RJR Circuits, Inc.
1830 South Bannock Street, First Floor



Ground Floor

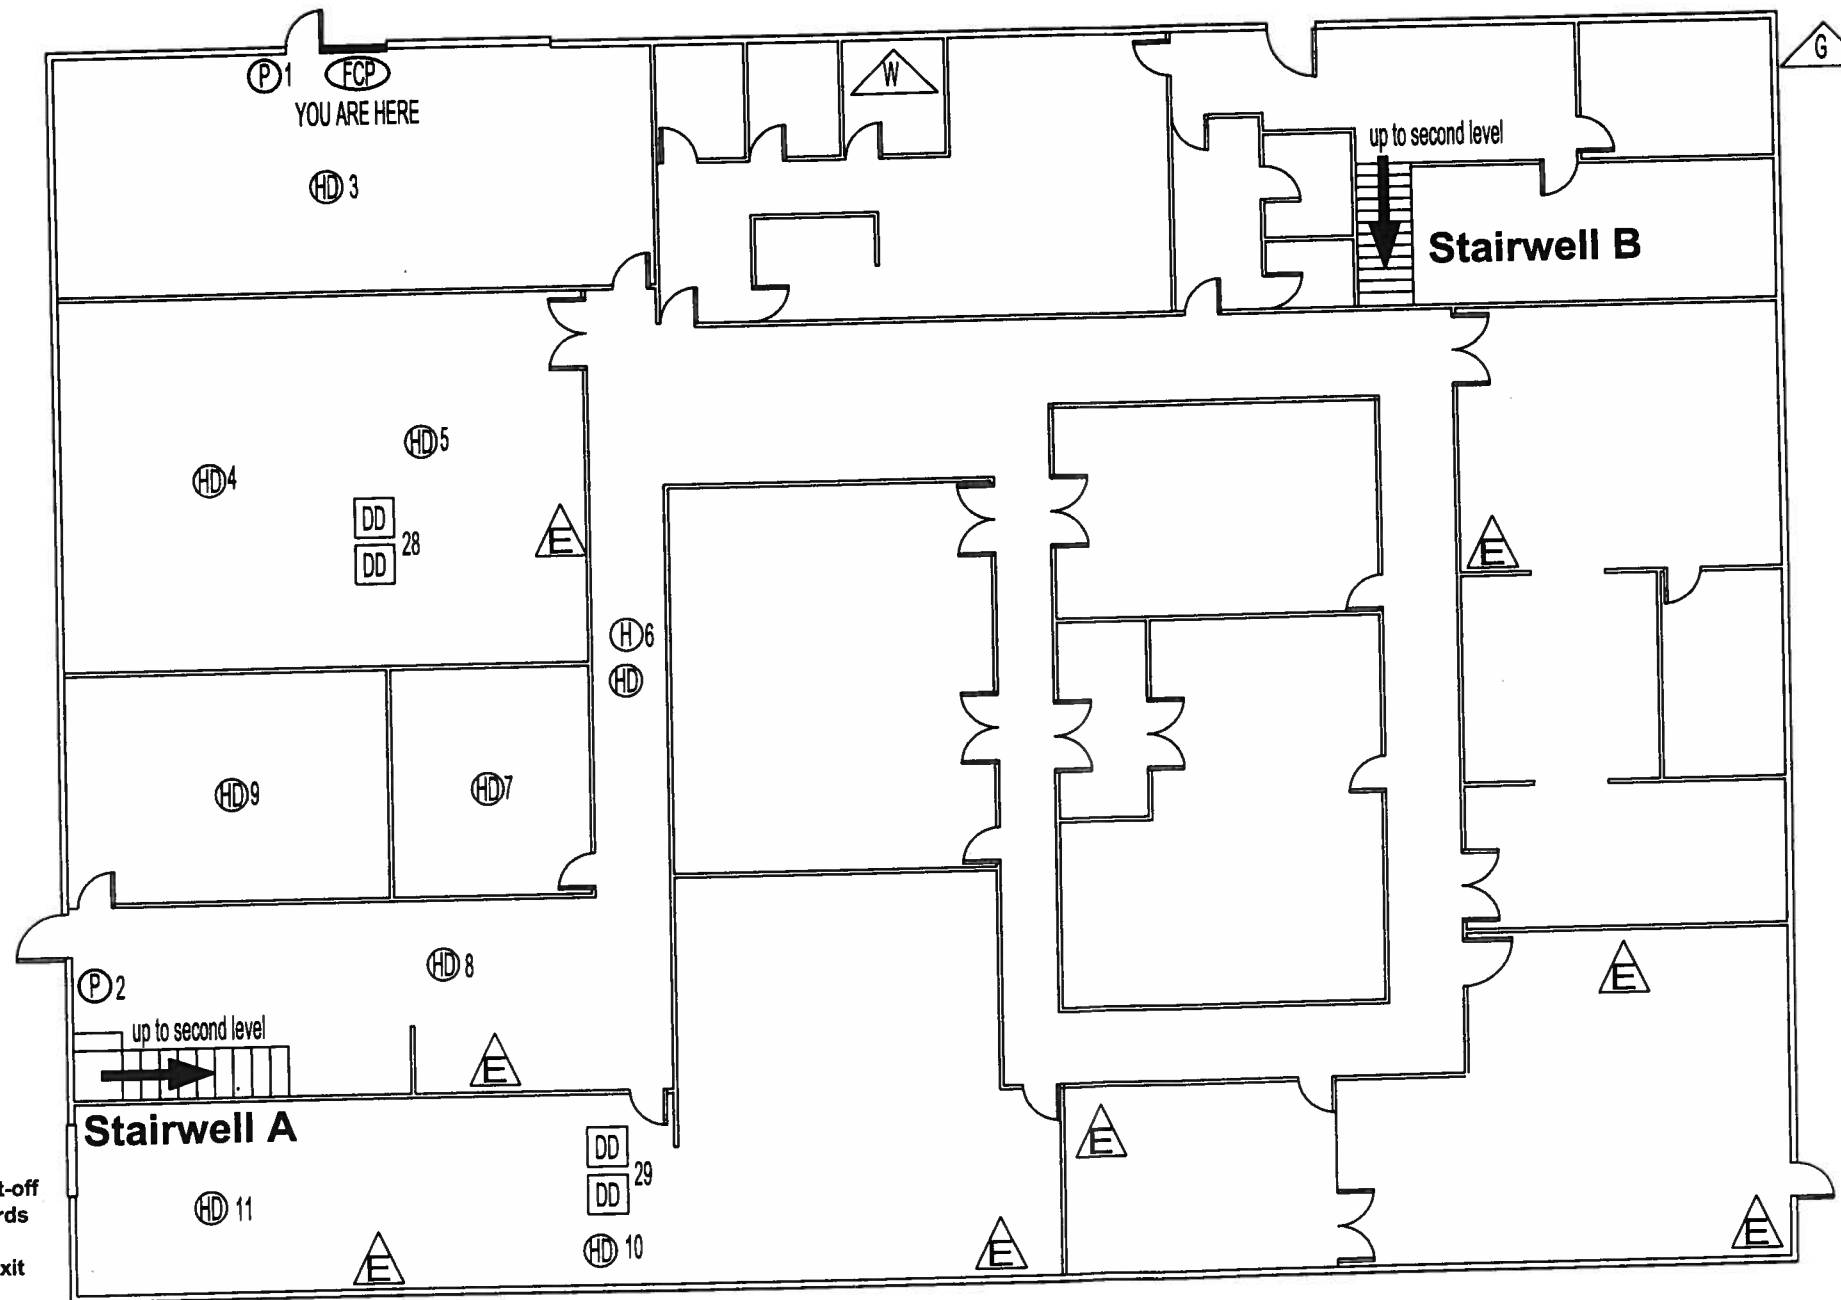

- (FCP) Fire Alarm Control Panel
- (P) Pull Station
- (HD) Heat Detector
- (SD) Smoke Detector
- (G) Gas Shut-Off
- (E) Electrical Shut-Off
- (ESD) Electrical Shut-Down
- (W) Water Shut-Off
- (DD) Duct Detector
- (FH) Fire Hydrant



Alley

Bannock Street

RJR Circuits, Inc.
1830 South Bannock Street, First Floor

Ground Floor

FRONT DOOR

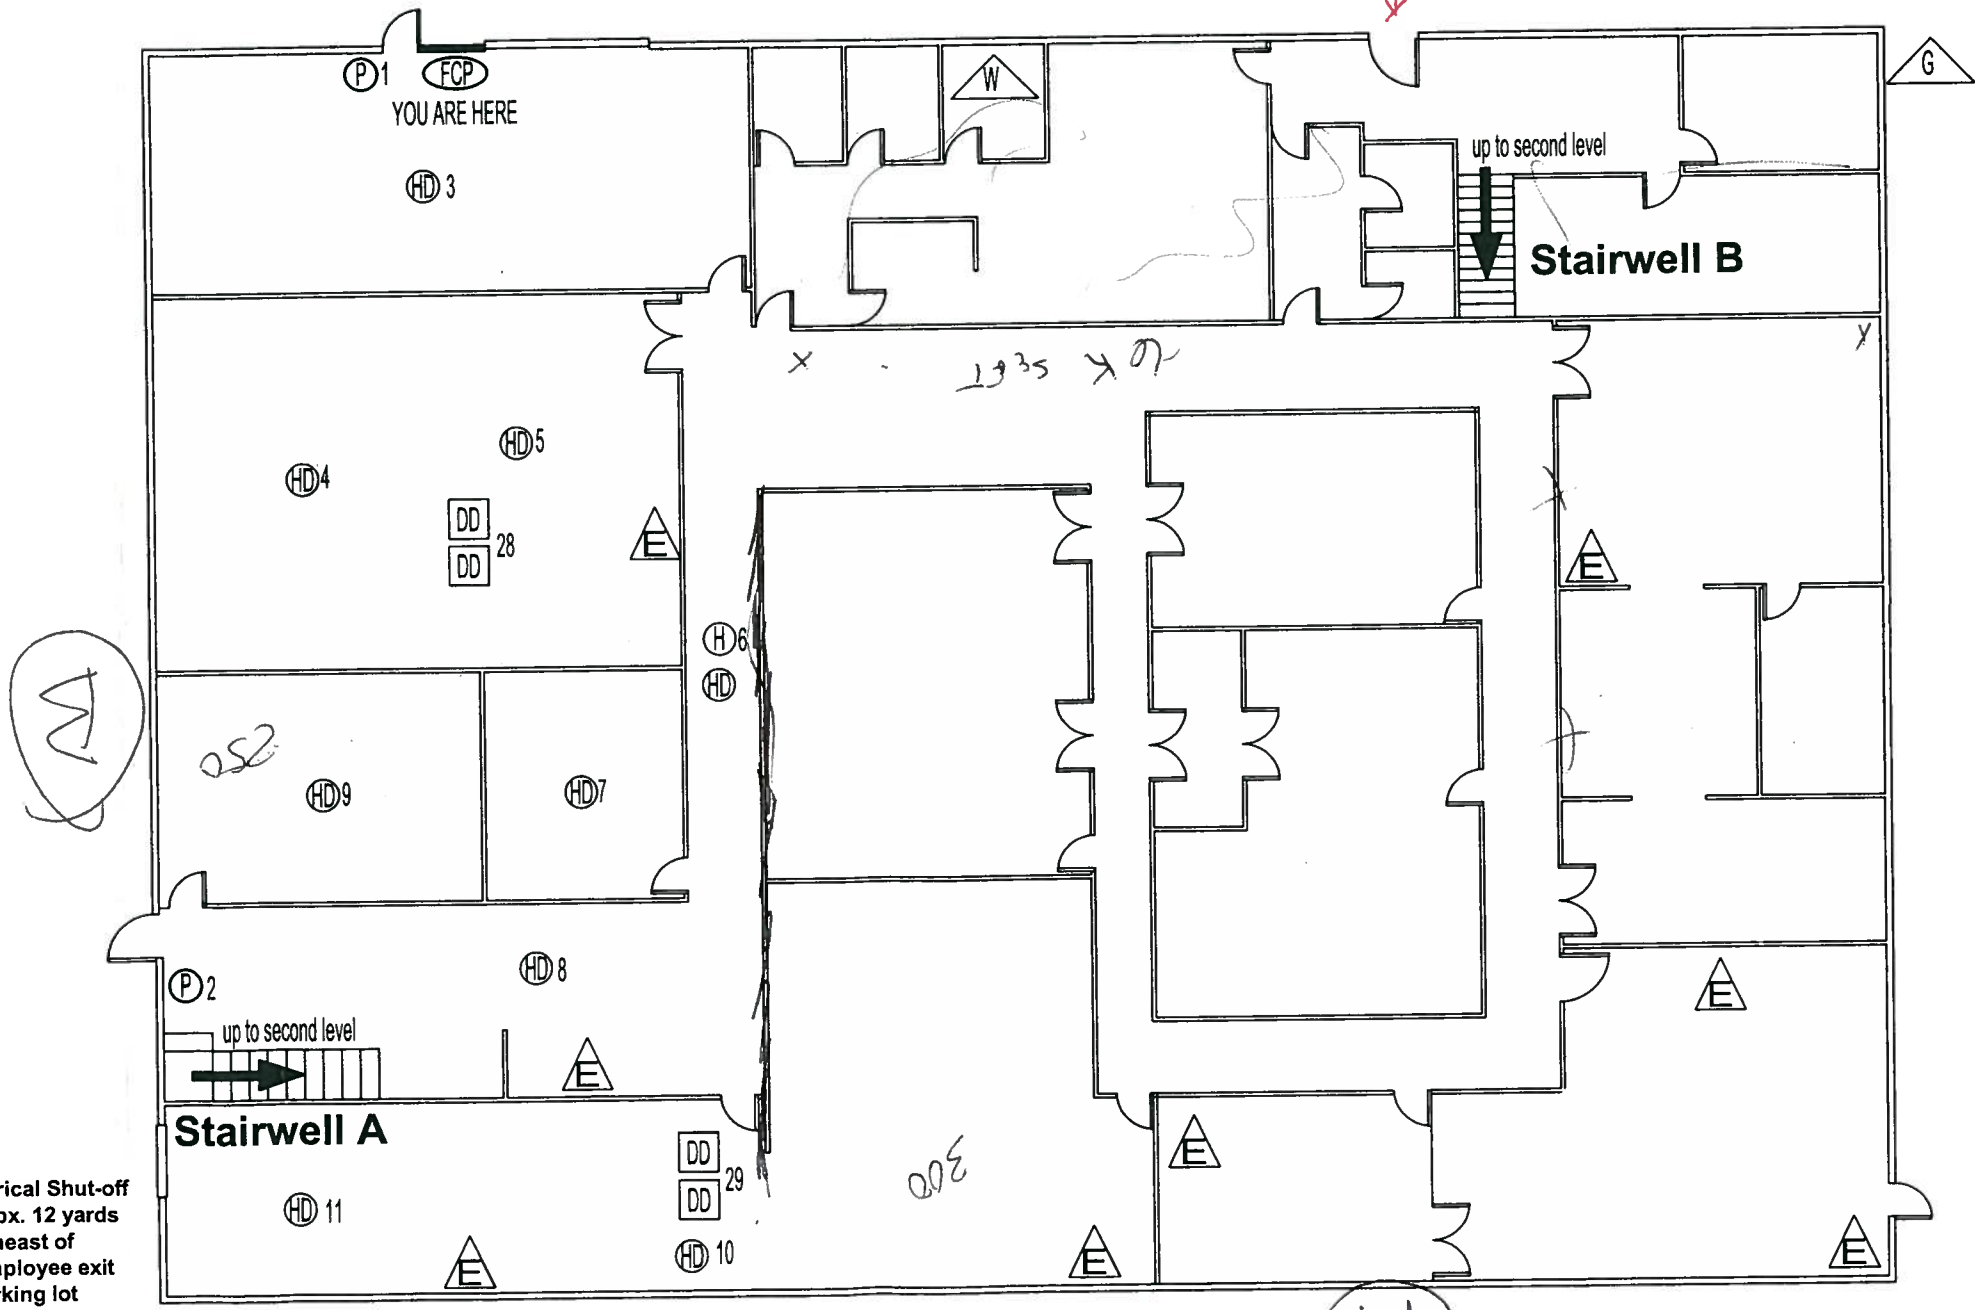

- FCP Fire Alarm Control Panel
- P Pull Station
- HD Heat Detector
- SD Smoke Detector
- G Gas Shut-Off
- E Electrical Shut-Off
- ESD Electrical Shut-Down
- W Water Shut-Off
- DD Duct Detector
- FH Fire Hydrant

Main Electrical Shut-off
located apx. 12 yards
southeast of
south employee exit
in parking lot



150 North

150

20142