


NOT TO SCALE

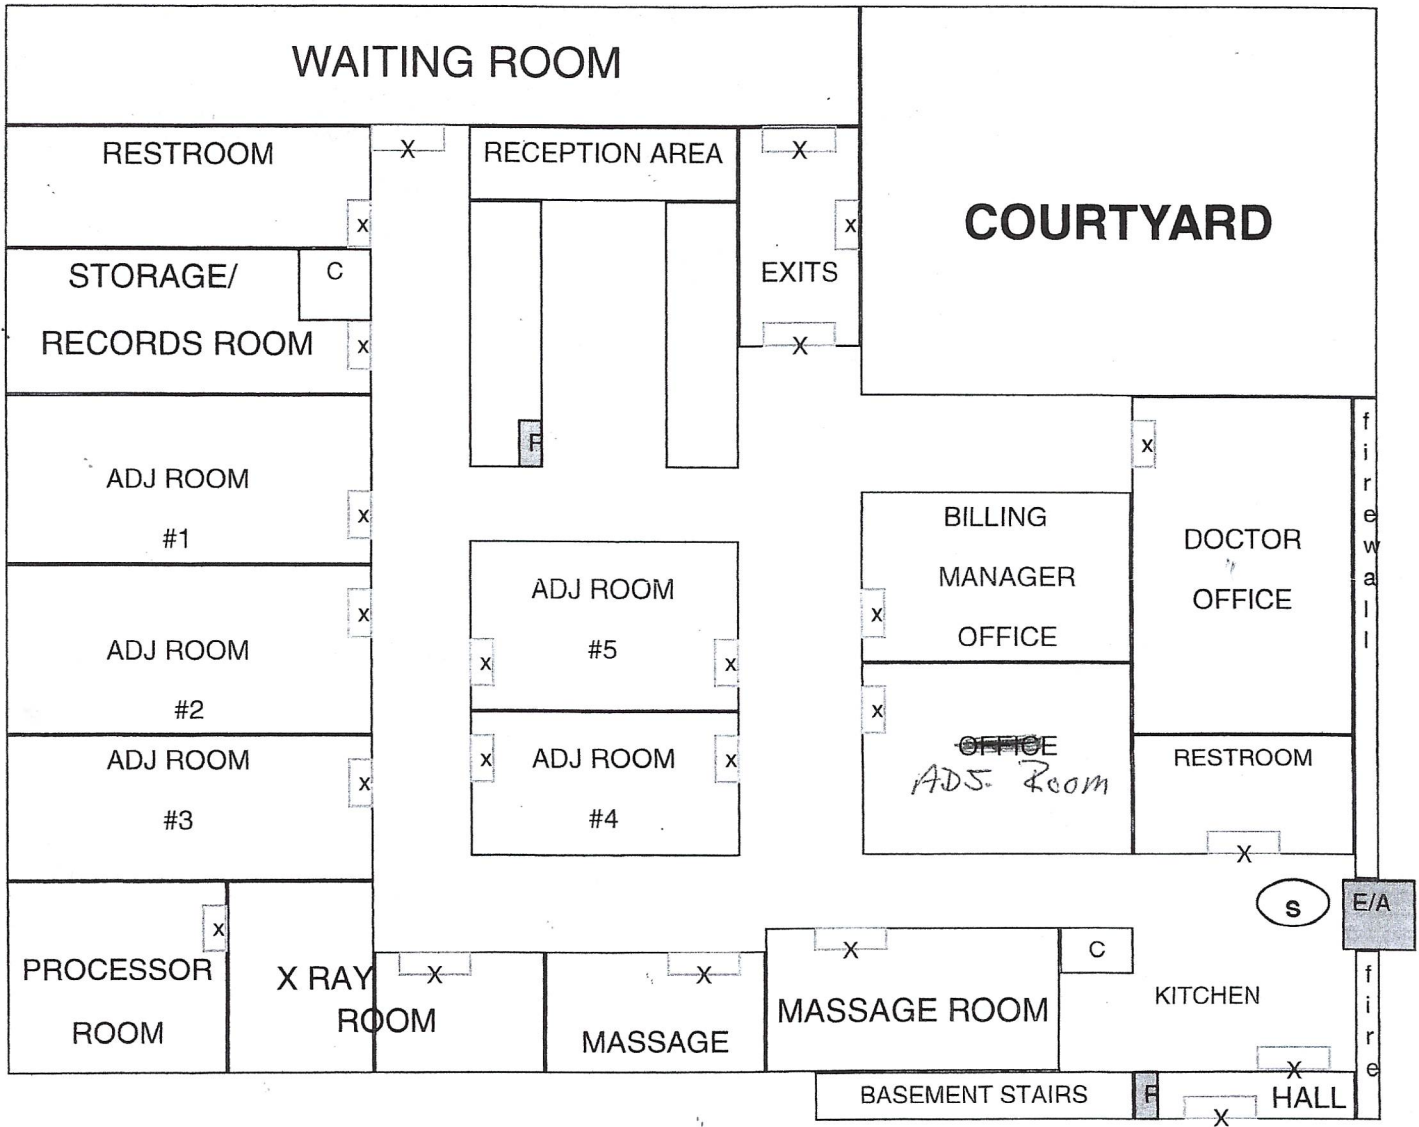

- ALL EXITS (X)
- LOCATION OF FIRE EXTINGUISHERS (F) – reception area and kitchen area
- LOCATION OF SMOKE DETECTORS (S) – kitchen area
- LOCATION OF FIRE ALARMS (A) - elevator (E)
- LOCATION OF SPRINKLER SYSTEM (SS) – furnace room and storage/records room (in basement)