


# SHELL EXTERIOR LIGHTING PLAN

1/16" = 1'-0"

| re Schedule | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| Qty | Label | Arrangement | Description | LLF | Lumens/Lamp | Arr. Lum. Lumens | Arr. Watts | REMARKS |
| 16 | D | SINGLE | PWM-S-LED-HD-CW-UE | 1.000 | N.A. | 5184 | 36 | (WALL PACK) |
| 20 | C | SINGLE | XSL2-S-LED-50-SS-CW | | | | 46 | (AWNING) |

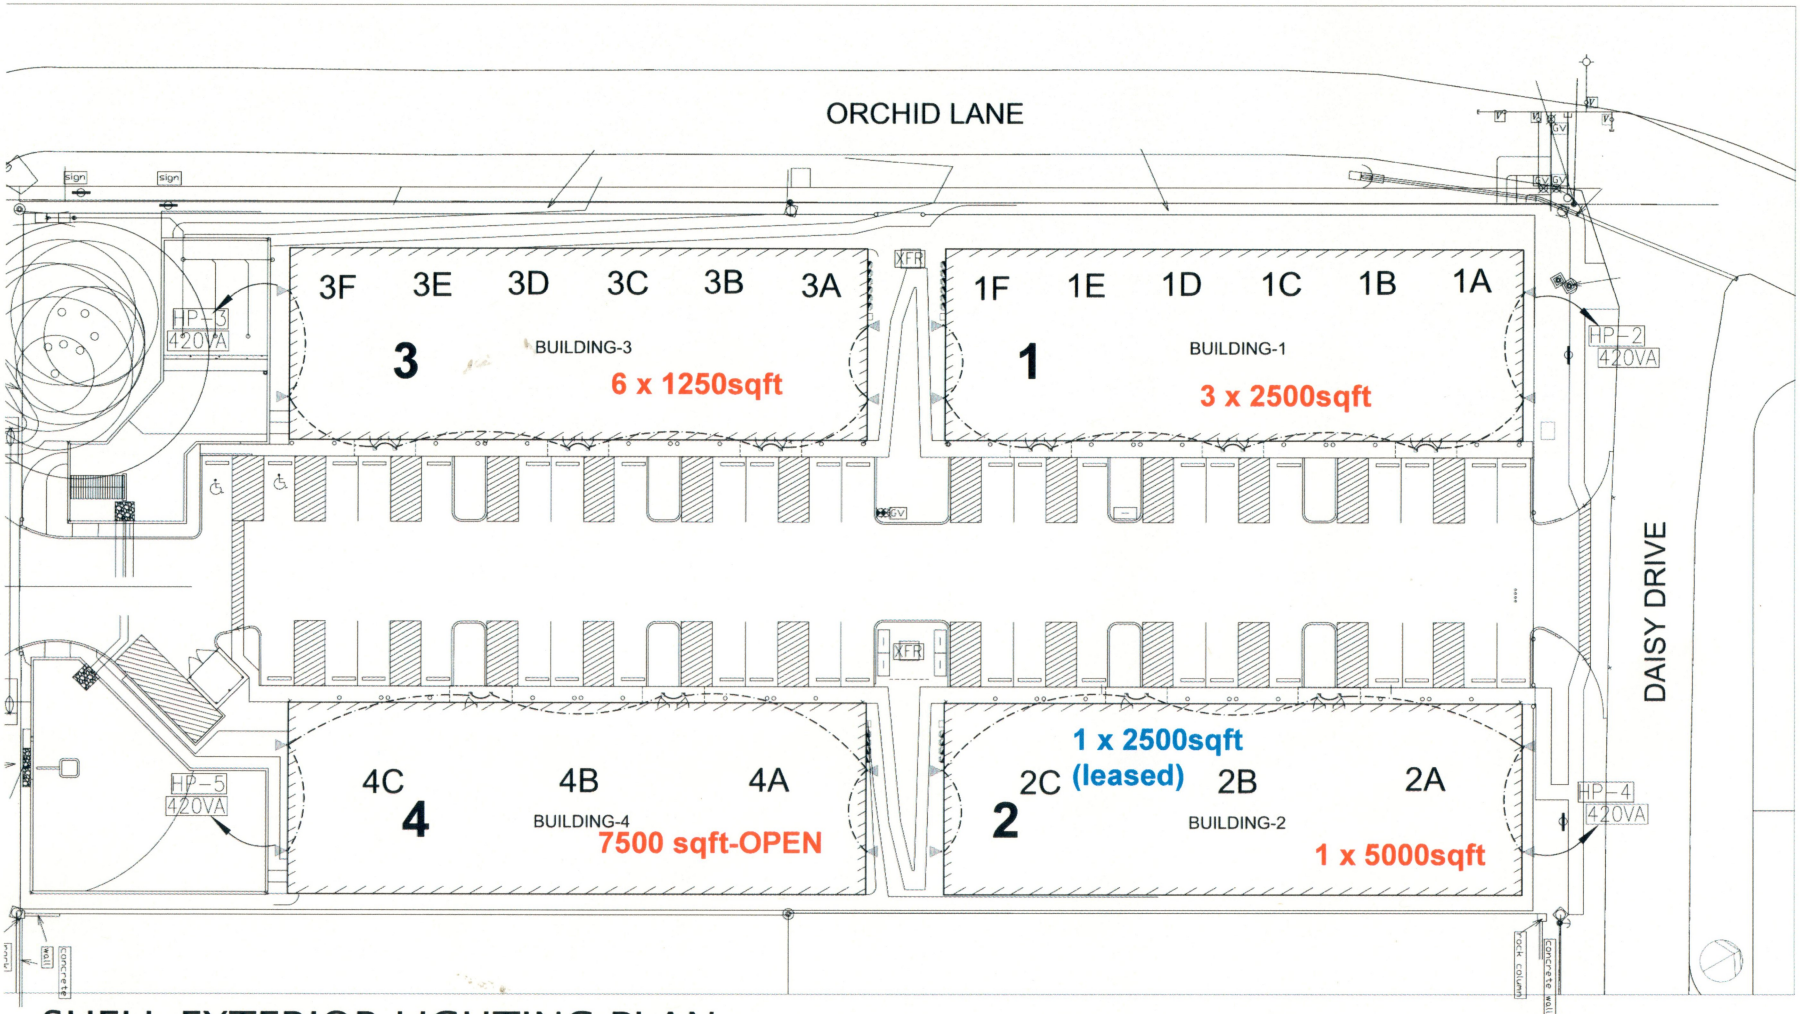


2 EXTERIOR LIGHTING CONTROL DETAIL N.T.S.

Tchen

GENERAL NOTES:
1. ALL WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE LOCAL, STATE AND NATIONAL CODES AND ORDINANCE AND ALL AUTHORITIES HAVING JURISDICTION FOR CITY OF AUSTIN, 2015 IBC, 2015 UPC, 2015 UMC, 2015 IFGC, 2015 IFC, 2017 NFC, AND CITY OF AUSTIN CODE AMENDMENTS.

ISSUE DA
DRAWN
CHECKE
SCALE
REVISION

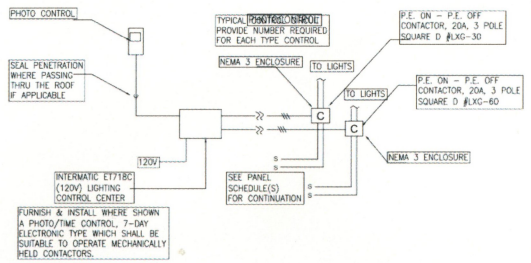PROJECT NAME
DAISY DRIVE INDUSTRIAL CENTER
OVERALL SITE

SHEE
E0