


CONSTRUCTION TYPE: VB

RECEIVED BY
FEB 09 2017
CODMASTER

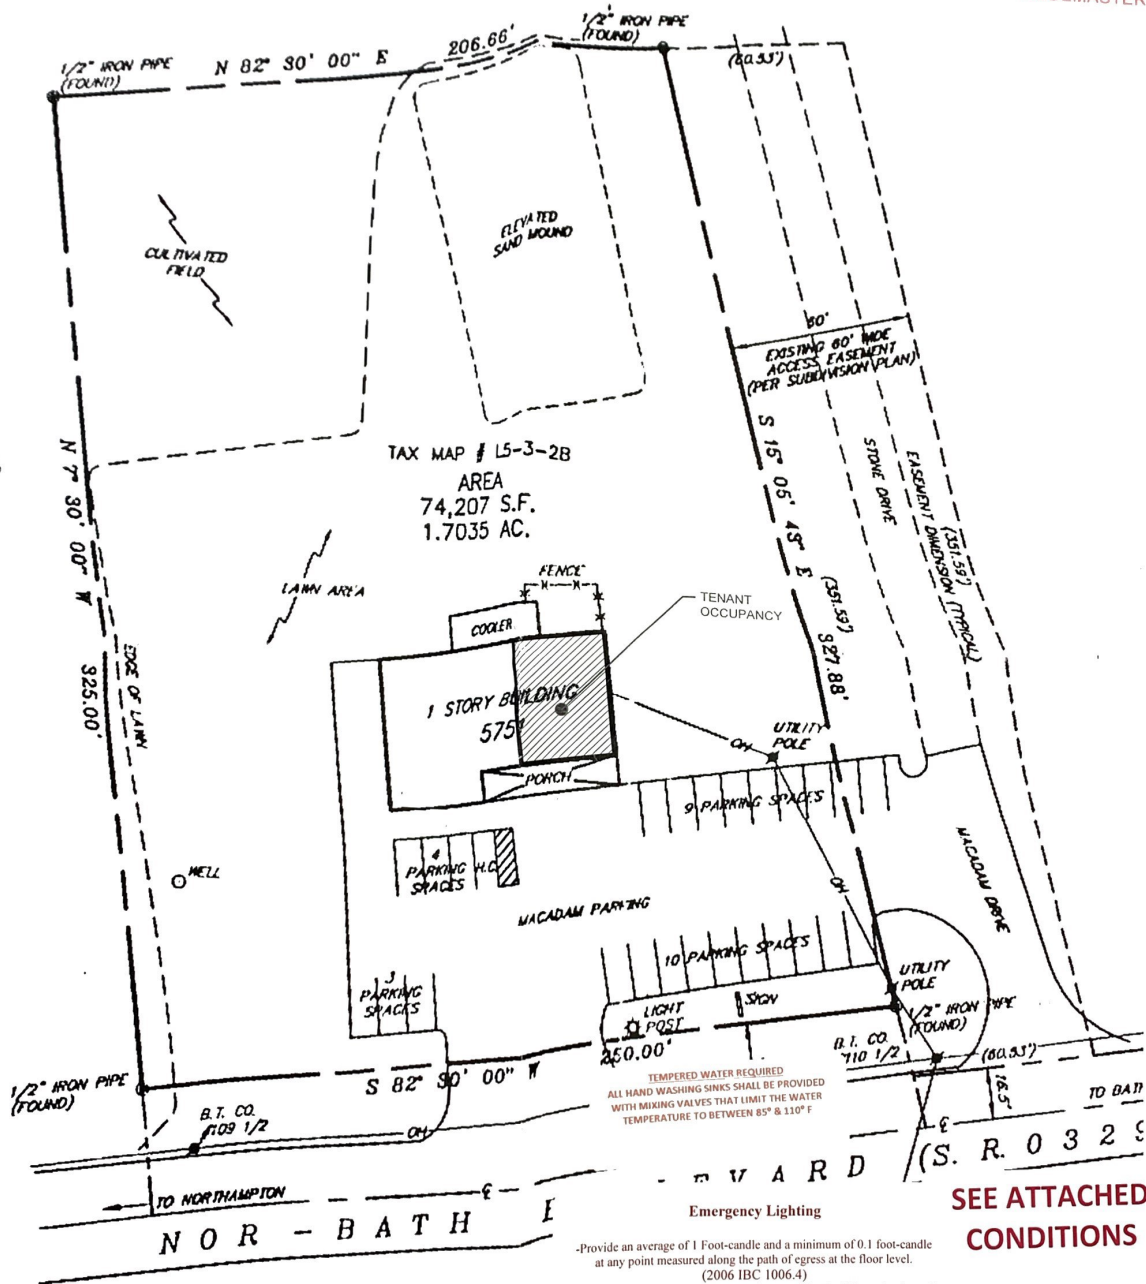

SITE PLAN

SCALE: 1/32" = 1'

SURVEY BY: BASCOM & SEIGER INC.
116 N. FIFTH ST.
ALLENTOWN, PA 18102-4108
P#: 610-770-0888

- Emergency Lighting
- Provide an average of 1 Foot-candle and a minimum of 0.1 foot-candle at any point measured along the path of egress at the floor level. (2006 IBC 1006.4)
 - The feed for the emergency lighting must be feed from the branch circuit feeding the lighting of the area the emergency light serves. (2005 NEC 700.12(F))
 - When installing emergency light there is a 2 head minimum rule. See (2005 NEC 700.16)

SEE ATTACHED
CONDITIONS

NOTE: ALL Construction shown on these Plans, whether noted or not, MUST COMPLY with applicable provisions of all adopted codes



APPROVED
FEB 09 2017
CODMASTER

MUNICIPALITY
COPY

CMI# 005-0114-17

REVISIONS	
NO.	DATE: REMARKS

GIBSON ASSOCIATES
220 Winged Foot Drive
Blue Bell, PA 19422
Phone: (215) 380-0400

CS

PROJECT:
ALTERATIONS TO:
5155 NOR BATH BOULEVARD
NORTHAMPTON, PA 18014

COMM. No. 17102

CS

DATE: 1/28/17

COVER SHEET