



# Department of Public Health

Monroe County, New York

Division of Environmental Health

## On-Site Wastewater Treatment System (OWTS) - Installation Inspection

Address: 5692 Pittsford Palmyra Road

Town: Pittsford

Tax ID#: 165.09-1-12

Subdivision: \_\_\_\_\_ Lot: \_\_\_\_\_

Bedrooms: 2 Design Flow: 250 GPD

Installation Type: Repair, Standard System

Waiver of Standards  Surface Discharge

Water Supply: Public

Installer: Gordon Beh Excavating

### Sandbed Approval Information

Plow Date: \_\_\_\_\_ Inspector: \_\_\_\_\_

Sample Test Date: \_\_\_\_\_ Time: \_\_\_\_\_ Insp: \_\_\_\_\_

Bed Test Date: \_\_\_\_\_ Time: \_\_\_\_\_ Insp: \_\_\_\_\_

Length: \_\_\_\_\_ Width: \_\_\_\_\_ Depth: \_\_\_\_\_

Bed Approval Date: \_\_\_\_\_ Inspector: \_\_\_\_\_

### Septic Tank

Type: Poly (new) Size: 1500 Gallons

Separation to House: >10 Feet

Separation to Well: n/a

Baffles  Gas Baffles  Filter

Influent/Effluent Pipe: Sch. 40/Sch. 40 Slope: O.K.

### Pump Station

Type: \_\_\_\_\_ Size: \_\_\_\_\_ Gallons


### Distribution Box

Type: Poly

Inlet Above Outlet  Outlets Equal

Speed Levelers  Tight Seal  Baffle

### Sketch

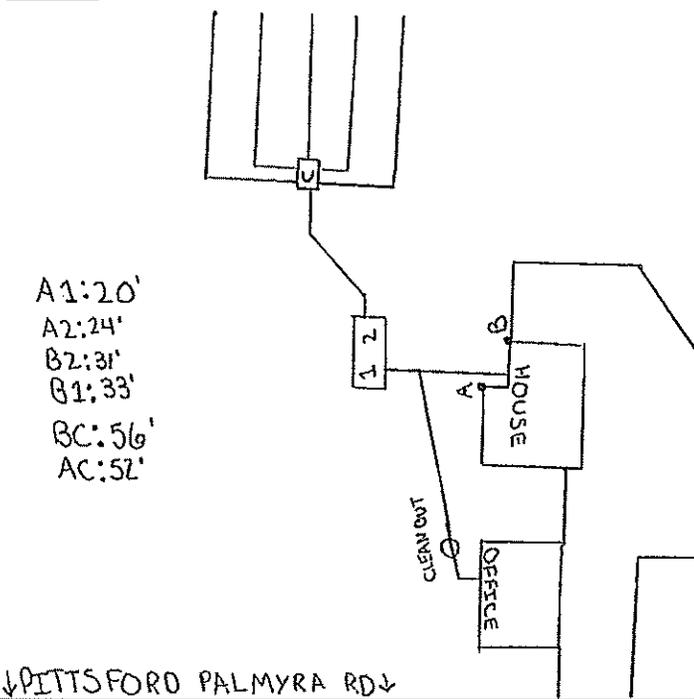

### Leach Field Information

Design Rate: 5 MPI

Required: 104'

Installed: 250'

# Laterals: 5 Length: 50 Feet

Lateral Spacing: 6 Feet (on center)

Trench Depth: 18-36 Inches

Trench Width: 24"

Stone Depth Above Pipe: 2"

Stone Depth Below Pipe: 6"

Membrane Type: Fabric

Header Slope: O.K. Leach Slope: O.K.

Pipe Between Drop Boxes: n/a

Separation to House: >20 Feet

Separation to Water Line: >10 Feet

Separation to Property Line: >10 Feet

Curtain Drain  Ends Capped  End Vented

Product Used: Stone and Pipe

### Approval to Backfill

Inspector: Hannah Froster Date: 5/12/2025

### Final Grade

Swales/Grading: \_\_\_\_\_ Septic System Cover: \_\_\_\_\_

Roof Gutters / Sump Discharge: \_\_\_\_\_

Final Grade O.K. Date: \_\_\_\_\_

Inspector: \_\_\_\_\_

### Comments:

-250 GPD is based off the 2-bedroom house and the 2-employee office

-System functionality may be impacted by groundwater. At time of inspection mottled soil was visible on excavation walls near the distribution box, about 2.5 feet deep from ground level. If the system experiences failure due to ground water or drains slowly, a pump station and sand bed design may be required

Conditional Approval Date: \_\_\_\_\_

Final Approval: 5/12/2025 Inspector: Hannah Froster

Date Payment Received: 3/31/2025

**Gordon Beh Excavating Contractors, Inc**  
 Mailing Address: P.O. Box 142, Union Hill, NY 14563  
 Physical Address: 1835 Ridge Road Junction, Webster, NY 14580  
 Phone: (585) 265-0140 or (585) 265-0277  
 Email: ch@chamberlainseptic.com  
 www.chamberlainsepticandsewer.com



**PAID**  
**10/14/2025**

**BILL TO**

Ruth Hill  
 5692 Pittsford Palmyra Rd  
 Pittsford, NY 14534

**Invoice**

DATE                      INVOICE #  
 6/4/2025                      10332  
 JOB ADDRESS

**TERMS**

SERVICED	ITEM	Hours/QTY	DESCRIPTION	RATE	AMOUNT
5/7/2025	Miscellaneous		Pump and fill in two existing septic tanks Owner to change plumbing inside house to the back Install a new 1500 gallon poly septic tank Install 250 feet of leach lines Inspected by Monroe County Health Department Grade to a rough grade Owner to rake and seed	18,000.00	18,000.00
	Permit		Permit fee - please remit to our office a check made payable to the MCHD in the amount of \$200.00	200.00	200.00
	Miscellaneous		Please hold \$600.00 from balance until we fill the one tank in the parking lot after your plumbing is done. Please contact Dean when the plumbing is done	0.00	0.00

**Subtotal**                      \$18,200.00  
**Sales Tax (8.0%)**                      \$0.00  
**\*Total**                      \$18,200.00

\*Total includes discount for payment by cash or check. If using a credit card, add 2% to the total above.

Please Mail Payment To:  
 Gordon Beh Excavating  
 P.O. Box 142  
 Union Hill, NY 14563

Payments not received within 15 days may accrue finance charges of 1.5% per month.


**Balance Due**                      \$0.00

# MONROE COUNTY DEPARTMENT OF PUBLIC HEALTH

## CONSTRUCTION PERMIT FOR THE RESIDENTIAL REPAIR OF AN ONSITE WASTEWATER TREATMENT SYSTEM

Address: 5692 pittford palmyra Rd Town: Pitt

Draw a plot plan showing location of house, septic tank, leaching system, other components and well or water Service.

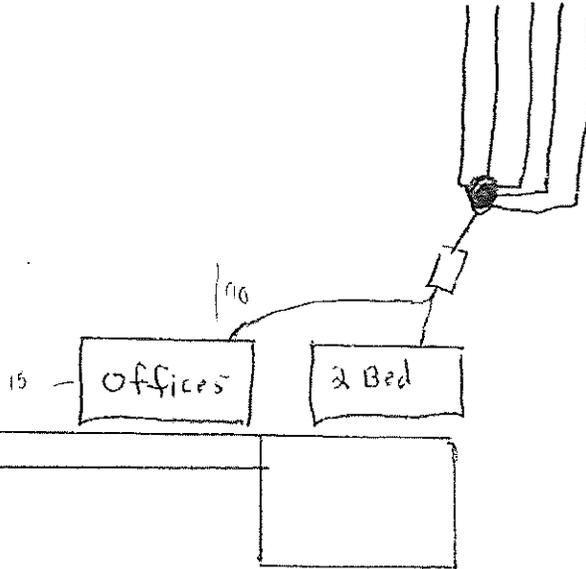

Call the Monroe County Department of Public Health at 753-5060 (24 hours in advance) for inspection of the system before backfilling

Number of bedrooms 2 New or Existing septic tank 1500 New Size of septic tank

Percolation Rate (highest of three) 5 Depth of percolation tests 24"

I certify that these percolation tests were done on 11/23/25 (date) in accordance with NYS and Monroe County standards. Dean S. Beh (Installer's signature)

Total amount of leach 250 Length of laterals 50 Number of laterals 5

Width of trench 24 Depth of trench 24"

Leaching method (gravelless leaching product make/model or stone and pipe) stone + pipe

**THIS PERMIT MAY BE REVOKED IF FIELD CONDITIONS ARE FOUND TO DIFFER FROM INFORMATION SUBMITTED ON THE APPLICATION PLAN**

The proposed arrangements for wastewater treatment for the above named property have been reviewed and found to meet the requirements of the Monroe County Department of Public Health with the information provided herein. This permit is issued as per provisions of Article IIA of the Monroe County Sanitary Code

### FOR OFFICE USE ONLY

Payment date \_\_\_\_\_

Permit Approval Date 4/2/25

Received by \_\_\_\_\_

Signature [Signature]

NOTE: APPROVAL GRANTED WITH THE UNDERSTANDING THAT SAID PLANS ARE SUBJECT TO REVIEW AND REAPPROVAL AFTER TWO YEARS FROM THE APPROVAL DATE, IF INSTALLATION IS NOT COMPLETED BY THAT TIME

**CONSTRUCTION PERMIT FOR THE RESIDENTIAL REPAIR OF AN  
ONSITE WASTEWATER TREATMENT SYSTEM**

Name of Owner Ruth Hill Date 1/23/25

Mailing Address 5692 Pittsford Palmyra Rd. Phone (585) 905-4075

Pittsford, NY 14534 E-Mail\* idela12@yahoo.com

Name of Installer Gordon Beh Excavating Contractors, Inc Phone 585-265-0140

Mailing Address PO Box 142 E-Mail\* gbeh@chamberlainseptic.com  
Union Hill, NY 14563

\* If an e-mail address is provided, an inspection report including a system location map will be e-mailed to you upon completion of system installation and passing inspection.

Water supplied by: Public Water  Private Well

Approximate distance to nearest sanitary sewer: NONE

**Internal Plumbing Check**

All wastewater pipes, including laundry, must connect directly to a septic tank or aerobic treatment unit. Sump pumps must NOT discharge to the septic system.

Does the internal plumbing meet these requirements? Yes  No

If no, explain \_\_\_\_\_

Is the house equipped with water saving fixtures? Yes  No   
(1.6 gallons per flush max toilets and 3.0 gallons per minute max faucets and shower heads)

I hereby certify that all information provided hereon is true and I understand and agree with this onsite wastewater treatment system repair proposal. If approved, the proposed system, the water supply, and drainage facilities will be installed as indicated.

Signed [Signature] Owner  
\_\_\_\_\_  
Buyer  
Dean Beh Installer

**DO NOT WRITE BELOW THIS LINE**

Inspector Hannah Frasier Date 3/28/25  
 - Confirmed with contractor, office only uses ~~rest~~ restroom, -no shower or extreme water usage.  
 - office has 2 employees  
 - ~~water~~ Absorption field length based off 220 GPD (2 bedroom) + 30 GPD (15 GPD per employee)  
250 / 1.20 (application rate)  
208.33 sq ft / 2 ft (trench width)  
104 required absorption field length  
 - Maintain 10 ft from water line

RETURN TO: Monroe County Department of Public Health  
 Bureau of Public Health Engineering  
 111 Westfall Road, Room 910  
 Rochester, New York 14620  
 Phone: (585) 753-5060; Fax: 753-5098