

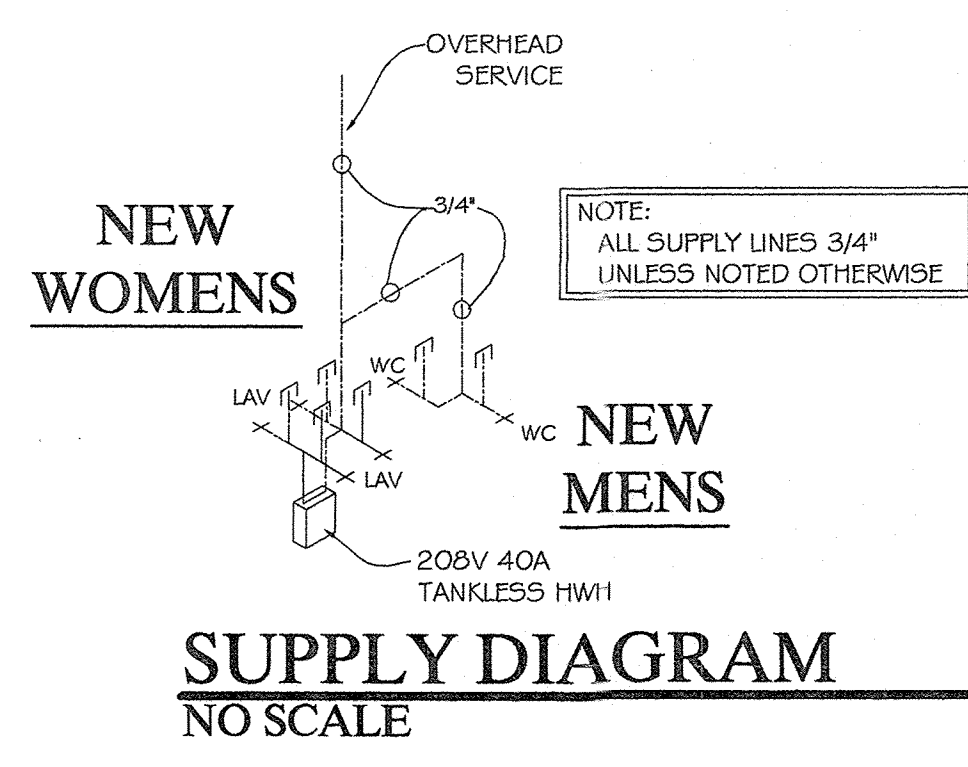
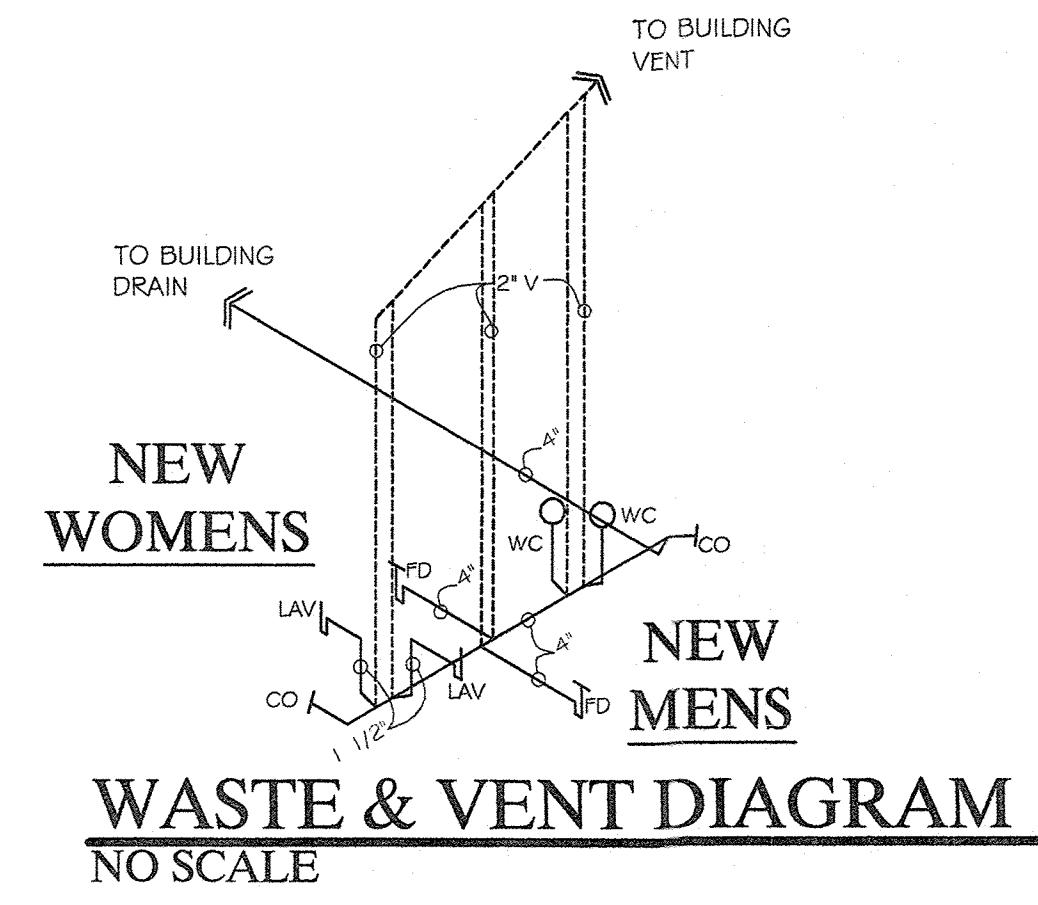
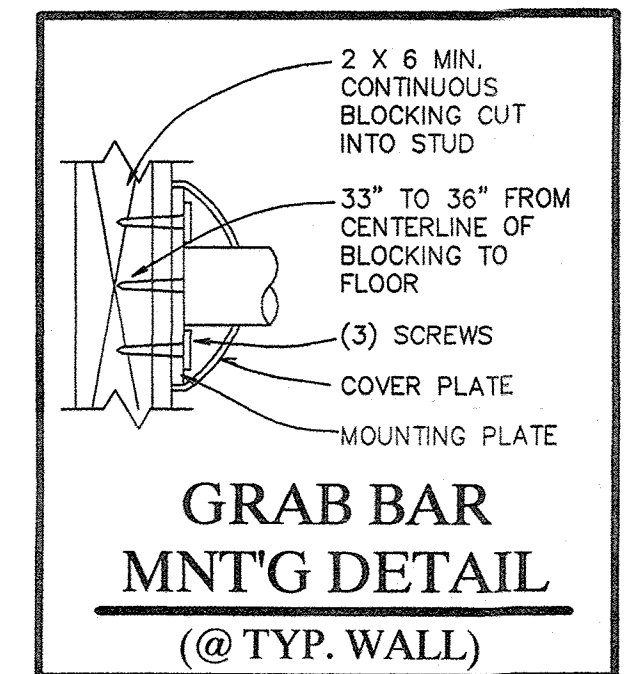


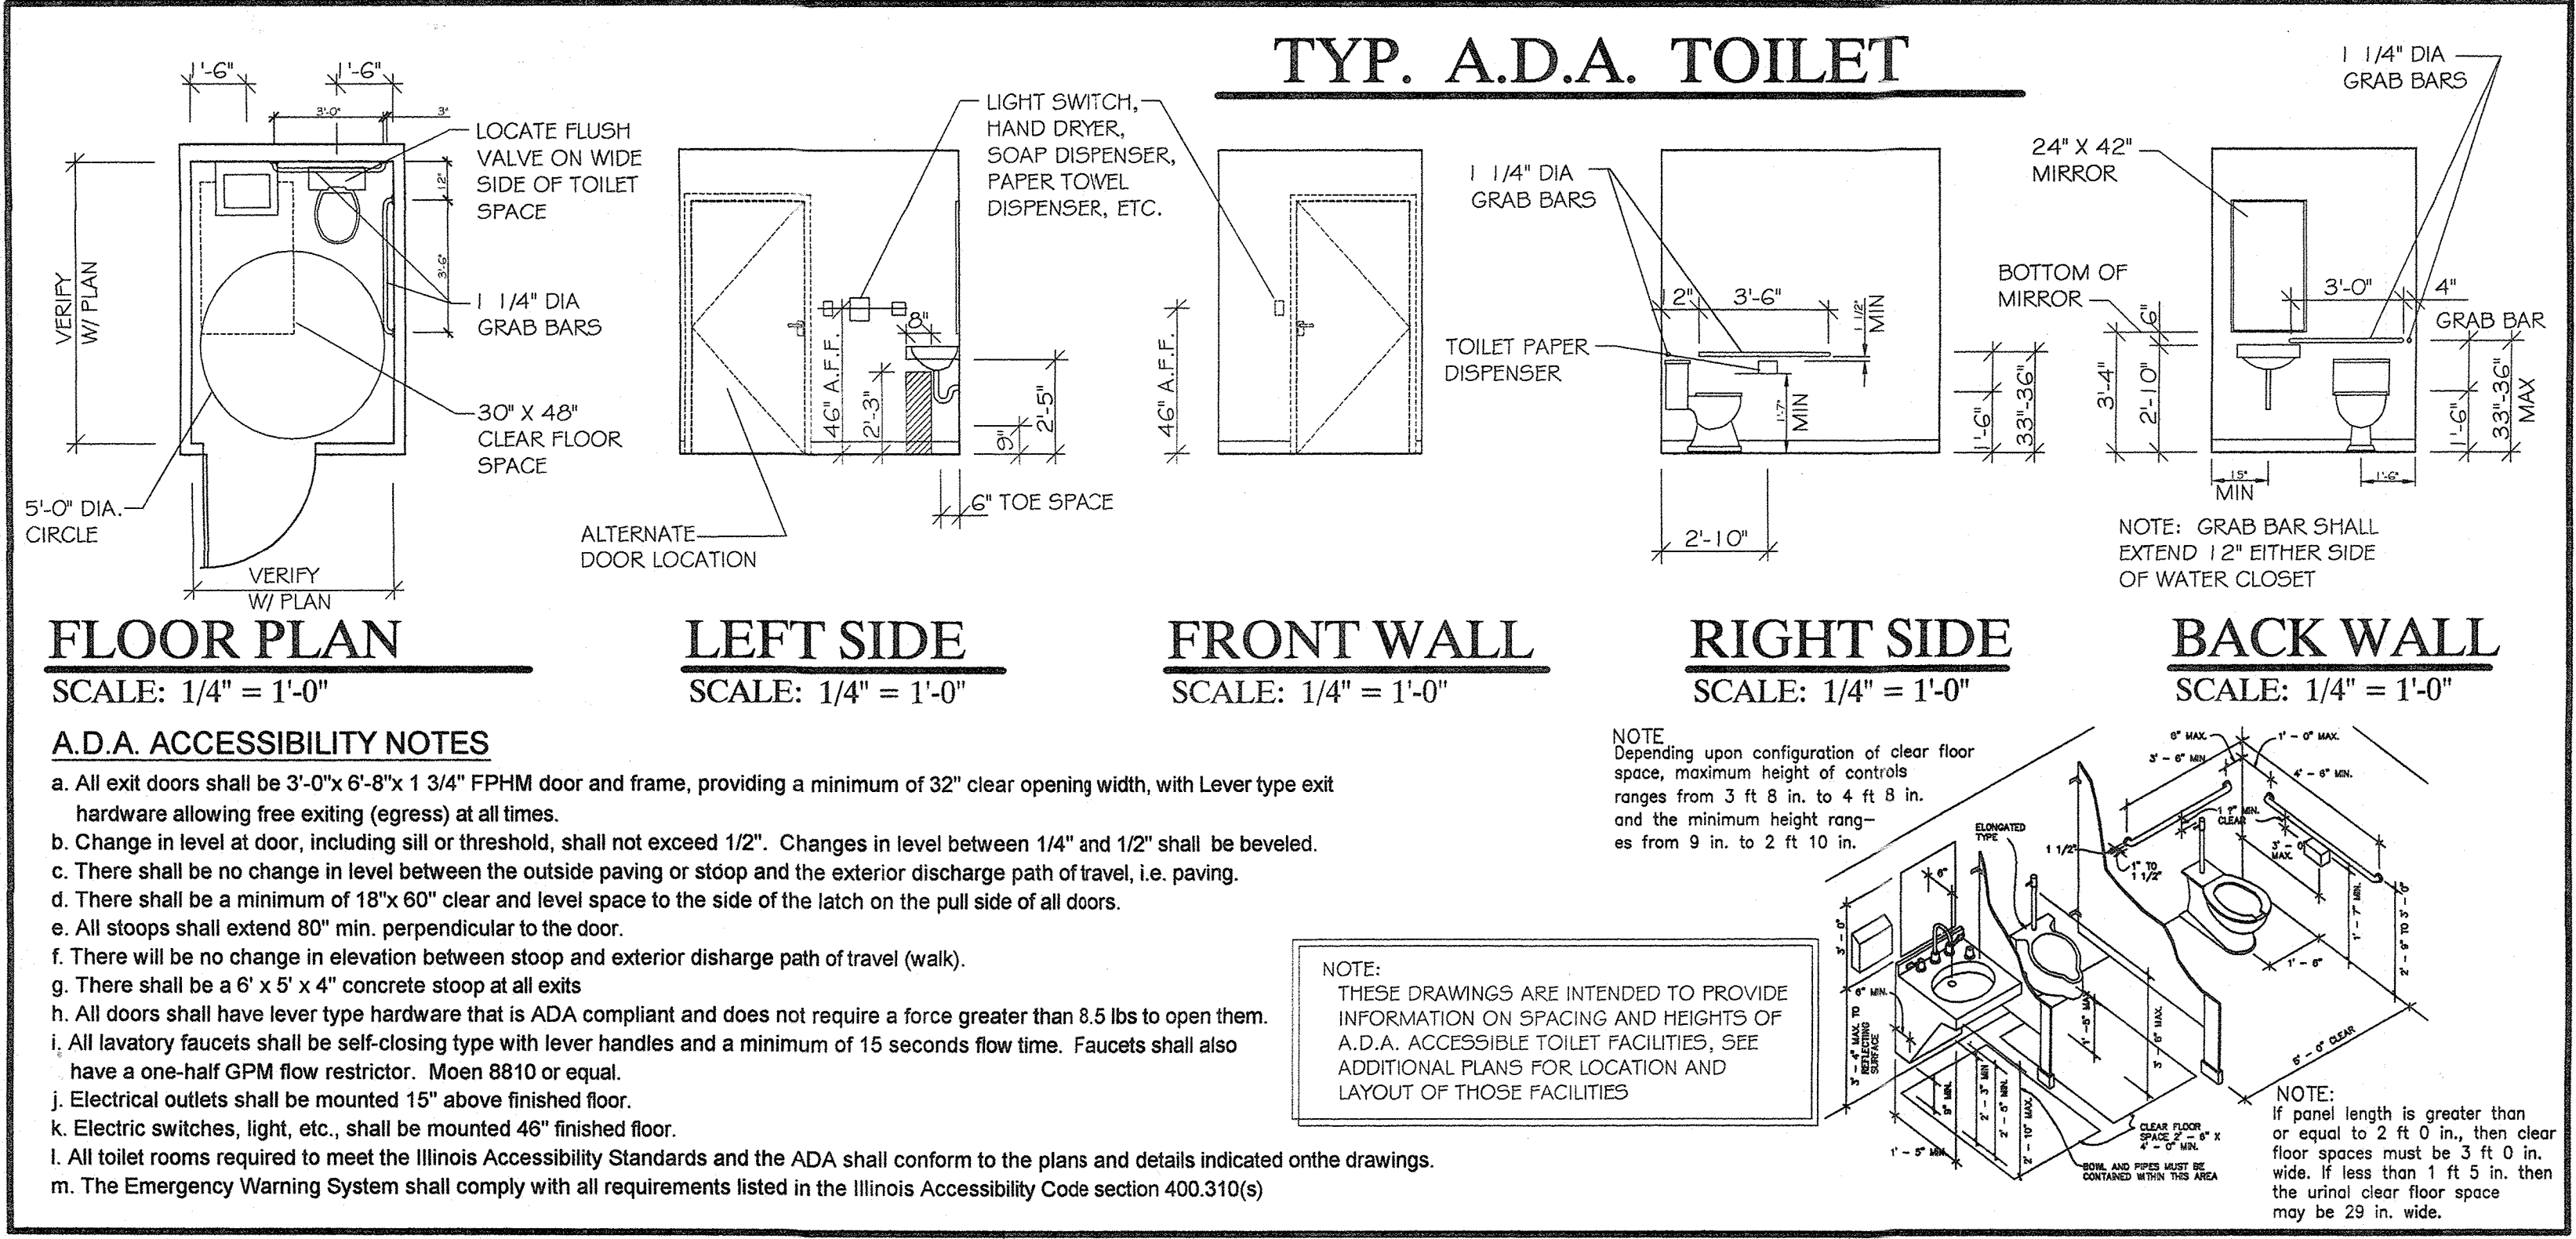

ELECTRICAL NOTES

1. Electric Service: New 200 amp, 3 phase, 36 circuit panel.
2. Electrical outlets shall be mounted 15" above finished floor.
3. Electric switches shall be mounted 46" finished floor.
4. Pipe size for homerun shall be 3/4" minimum.
5. All wire shall be copper w/ Thhn/Thwn insulation. Minimum wire sizes: Home runs #12; All runs over 75' #10.
6. All 120V circuits shall be 20A.

ELECTRICAL SYMBOLS	
Ⓐ	ALARM
Ⓙ	THERMOSTAT
Ⓢ	110V INTERCONNECTED SMOKE DETECTOR w/ BATTERY BACK-UP
Ⓛ	DUPLEX OUTLET MTD 15" AFF
Ⓛ	DUPLEX OUTLET (DEDICATED)
Ⓛ	DUPLEX OUTLET (GROUND FAULT)
Ⓢ	ELECTRICAL SWITCH MTD 46" AFF
Ⓛ	ELECTRICAL SUBPANEL
Ⓛ	EMERGENCY LIGHT, BATTERY BACKUP
Ⓛ	EXIT SIGN
Ⓛ	PULL STATION MTD 46" AFF
Ⓛ	STROBE/HORN
Ⓛ	STROBE
Ⓛ	PHONE
Ⓛ	CAT 5e DATA CONNECTION
Ⓛ	SOUND SYSTEM
Ⓛ	SURFACE MOUNTED INCANDESCENT
Ⓛ	RECESSED CAN LIGHT
Ⓛ	WALL MOUNTED SCOUNCE
Ⓛ	FAN/LIGHT
Ⓛ	CHANDELIER (BY TENANT)
Ⓛ	TRACK LT. MTD. ____ A.F.F.
Ⓛ	2X4 (4 - 40w TUBES) FLOURESCENT
Ⓛ	LUMARK HIGH BAY #MDXB-DB22-320-277V

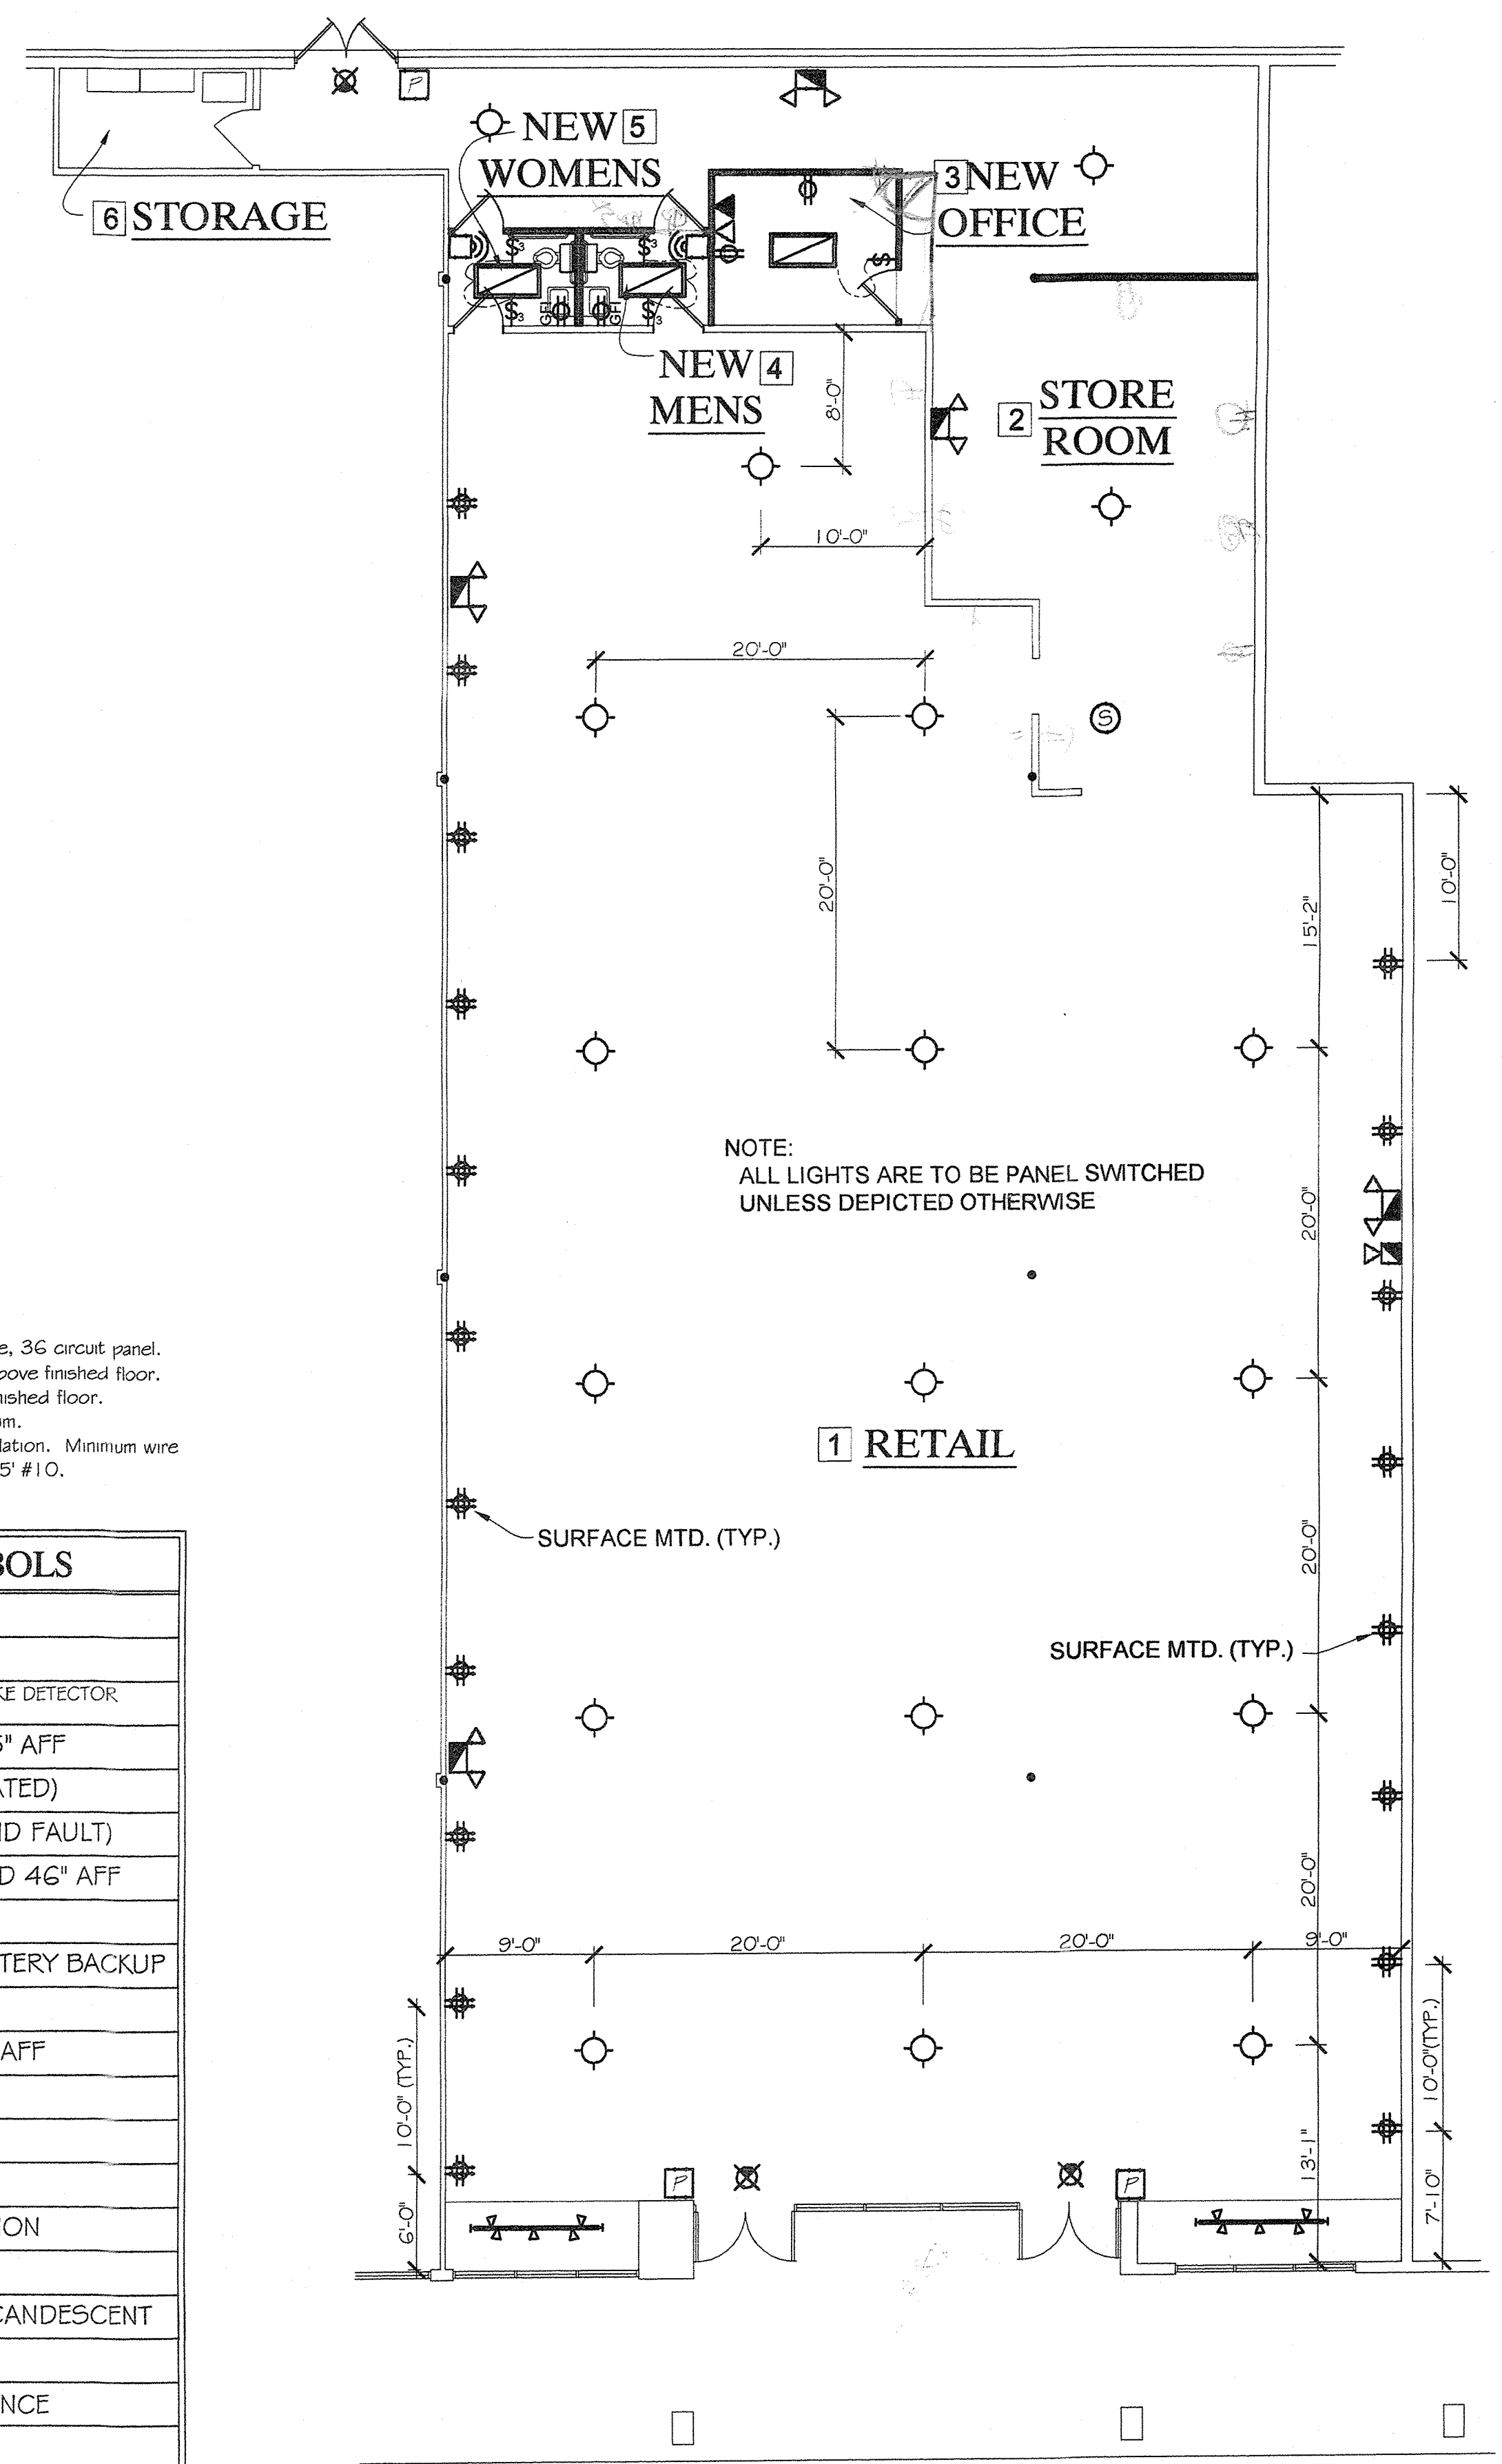

REVISIONS	BY:





ARCHITECTURAL RESOURCES, LLC
W. Alex Teipel - Architect
427 West State Street
Geneva, Illinois 60134
(630) 232-1774
File #0733242

I hereby certify that these plans were prepared under my supervision and to the best of my knowledge they comply with the building ordinances, zoning ordinances and all other applicable codes and ordinances including the Illinois Accessibility Code and ANSI A117.1-1986
Expires: 11/30/12

ADA TOILET DET. ELECT. PLAN, DETAIL & NOTES
New Tenant Build-out for:
Hobby Town
Tri-City Center - Suite 2061
St. Charles, Illinois 60174


Date 05/03/11
Scale AS NOTED
Drawn R.M.A.
Job 11-2006

Sheet
E1
Of 2 Sheets

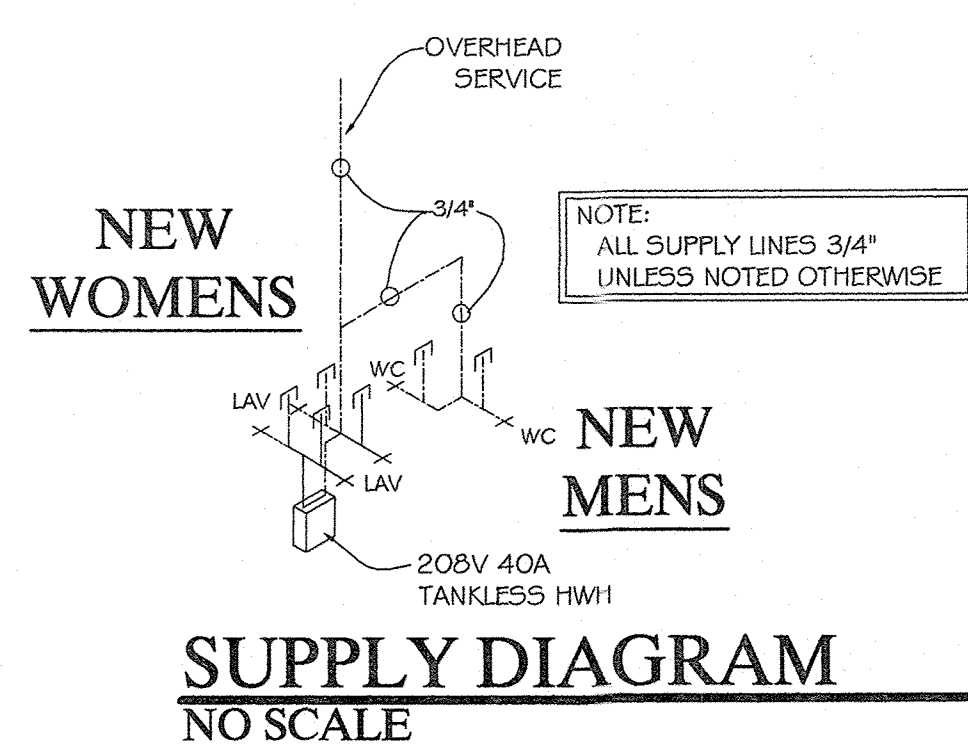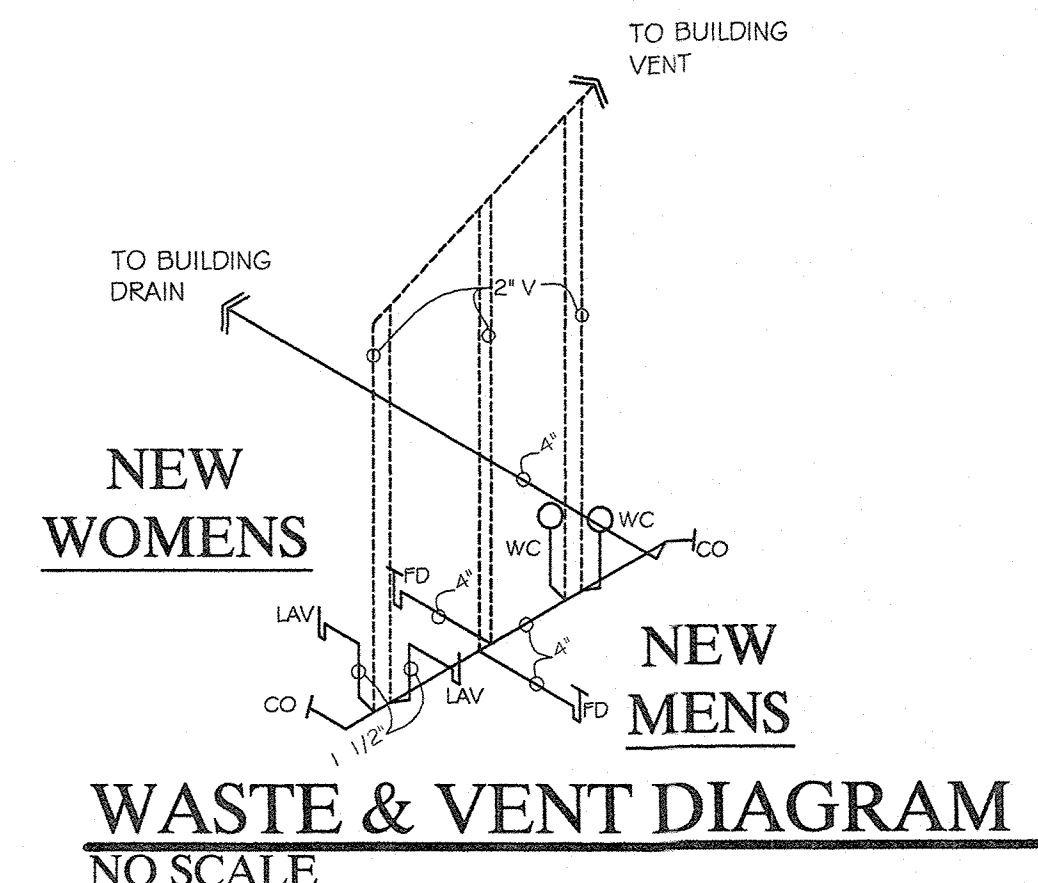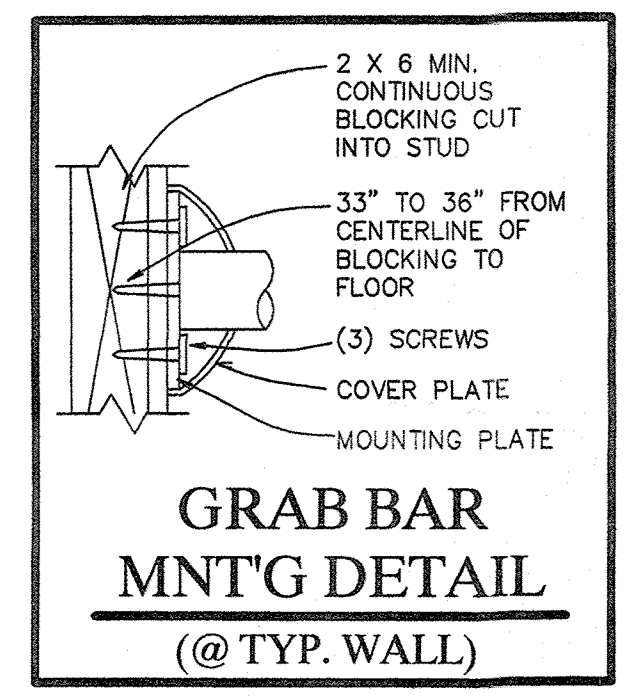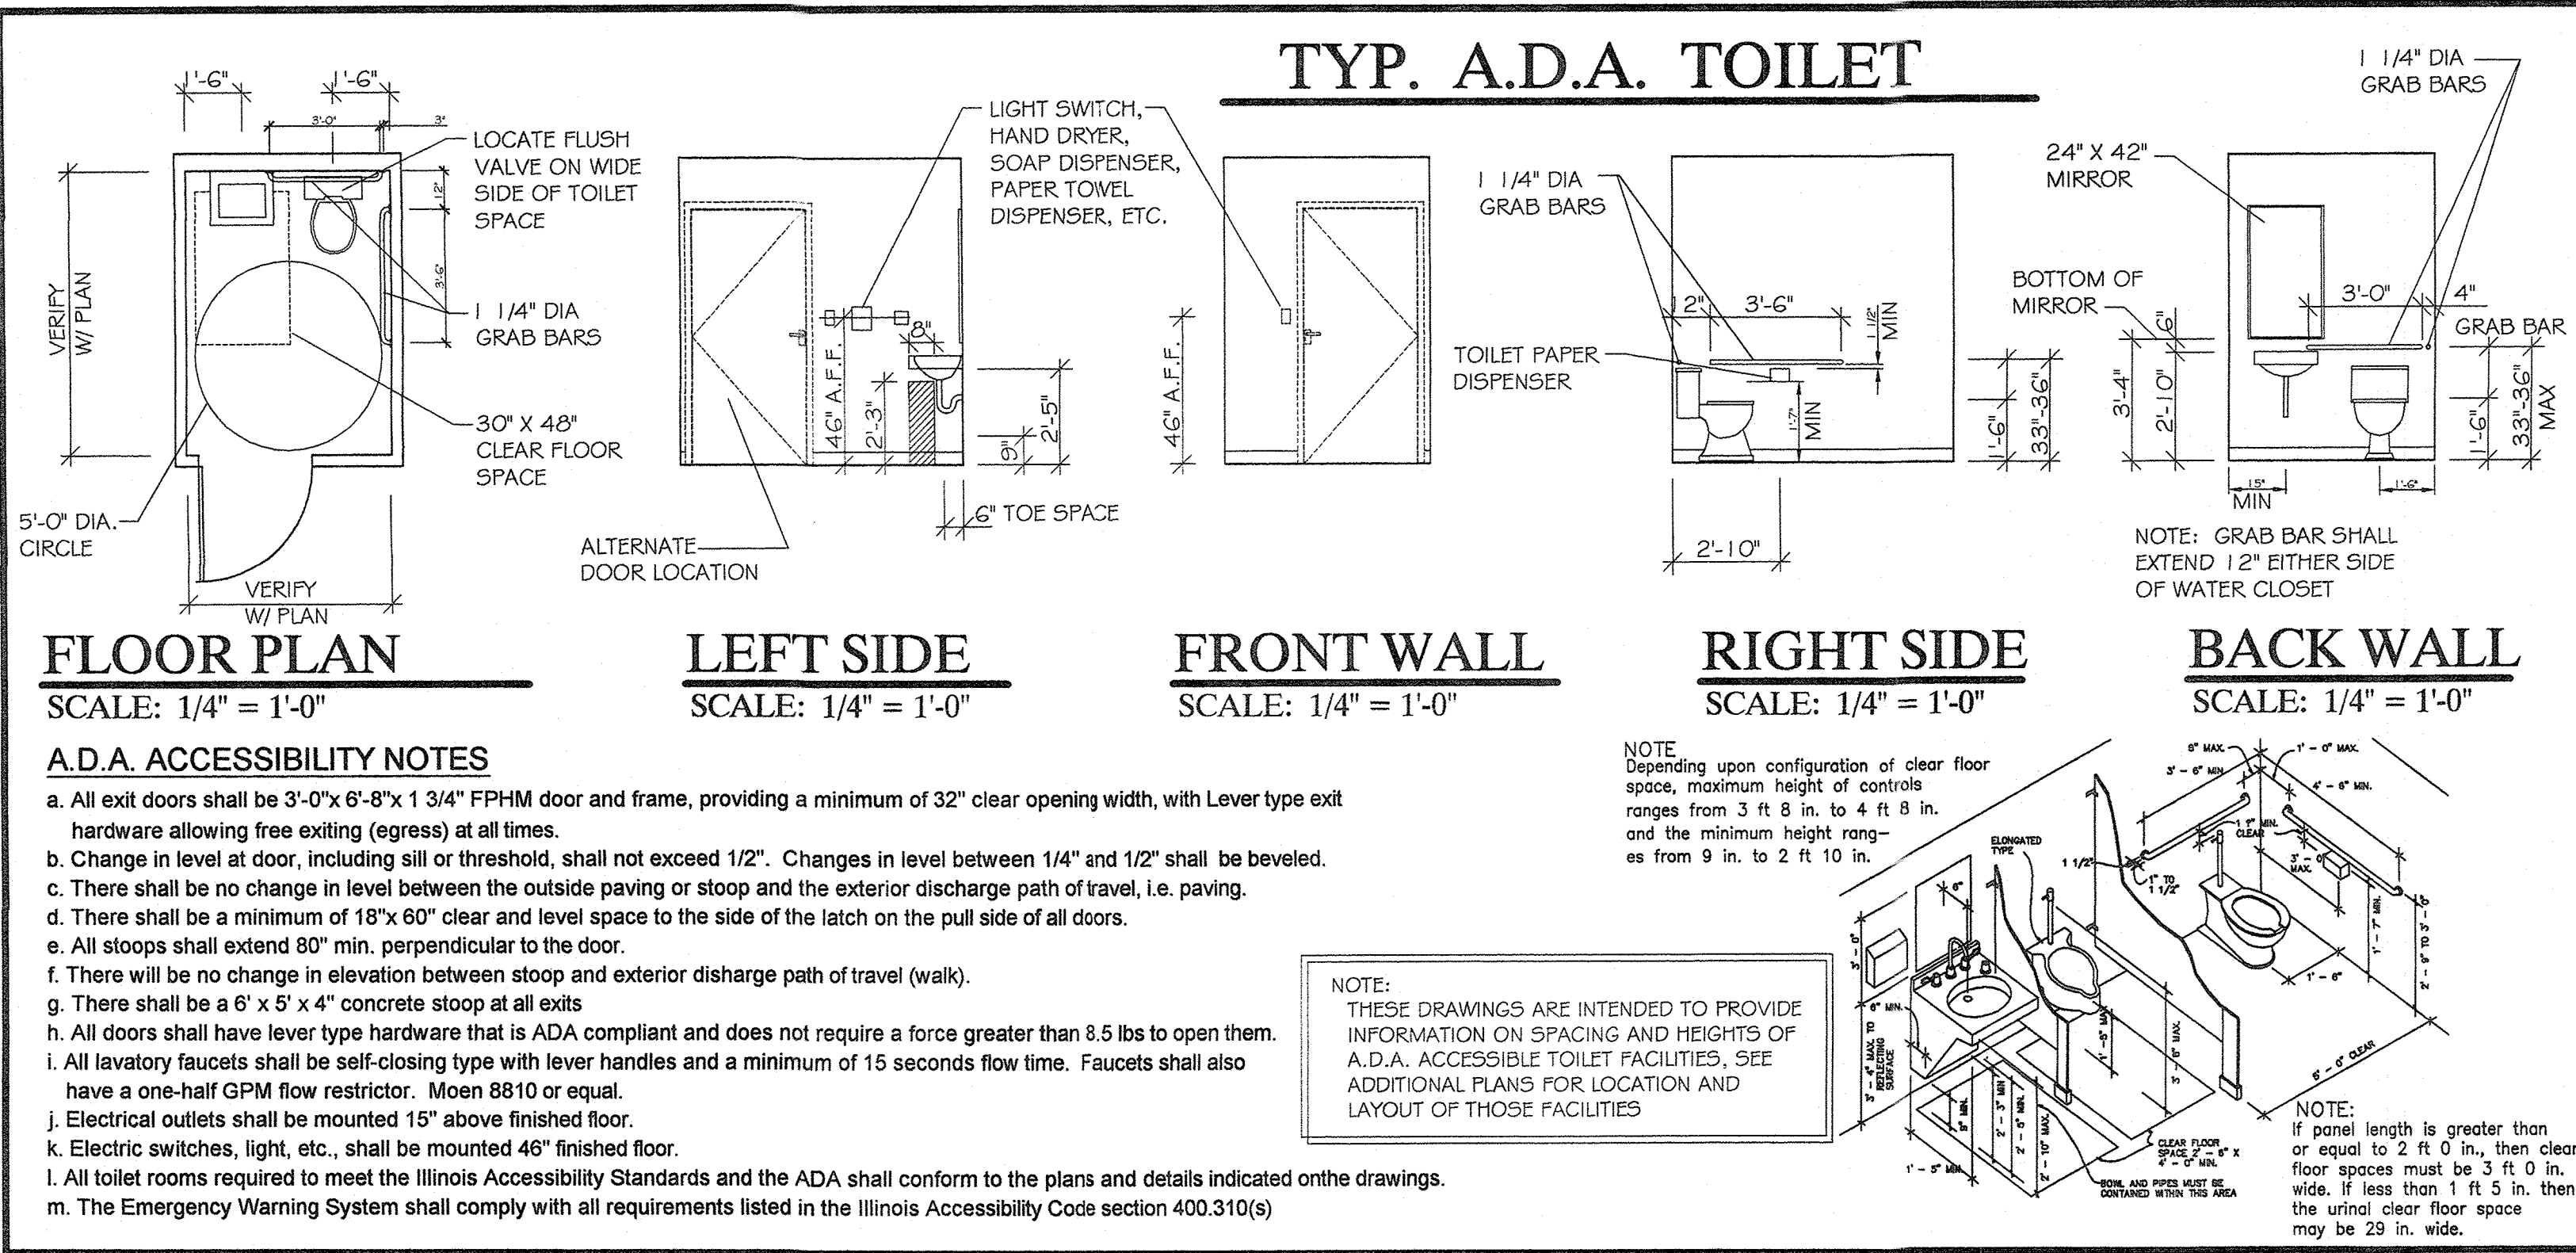

- ELECTRICAL NOTES**
1. Electric Service: New 200 amp, 3 phase, 36 circuit panel.
 2. Electrical outlets shall be mounted 15" above finished floor.
 3. Electric switches shall be mounted 46" finished floor.
 4. Pipe size for homerun shall be 3/4" minimum.
 5. All wire shall be copper w/ THHN/THWN insulation. Minimum wire sizes: Home runs #12; All runs over 75' #10.
 6. All 120V circuits shall be 20A.

ELECTRICAL SYMBOLS	
Ⓐ	ALARM
Ⓣ	THERMOSTAT
Ⓢ	110V INTERCONNECTED SMOKE DETECTOR w/ BATTERY BACK-UP
Ⓛ	DUPLEX OUTLET MTD 15" AFF
Ⓛ	DUPLEX OUTLET (DEDICATED)
Ⓛ	DUPLEX OUTLET (GROUND FAULT)
Ⓢ	ELECTRICAL SWITCH MTD 46" AFF
Ⓛ	ELECTRICAL SUBPANEL
Ⓛ	EMERGENCY LIGHT, BATTERY BACKUP
Ⓛ	EXIT SIGN
Ⓛ	PULL STATION MTD 46" AFF
Ⓛ	STROBE/HORN
Ⓛ	STROBE
Ⓛ	PHONE
Ⓛ	CAT 5e DATA CONNECTION
Ⓛ	SOUND SYSTEM
Ⓛ	SURFACE MOUNTED INCANDESCENT
Ⓛ	RECESSED CAN LIGHT
Ⓛ	WALL MOUNTED SCOUNCE
Ⓛ	FAN/LIGHT
Ⓛ	CHANDELIER (BY TENANT)
Ⓛ	TRACK LT. MTD. ____ A.F.F.
Ⓛ	2X4 (4 - 40w TUBES) FLOURESCENT
Ⓛ	LUMARK HIGH BAY #MDXB-DB22-320-277V

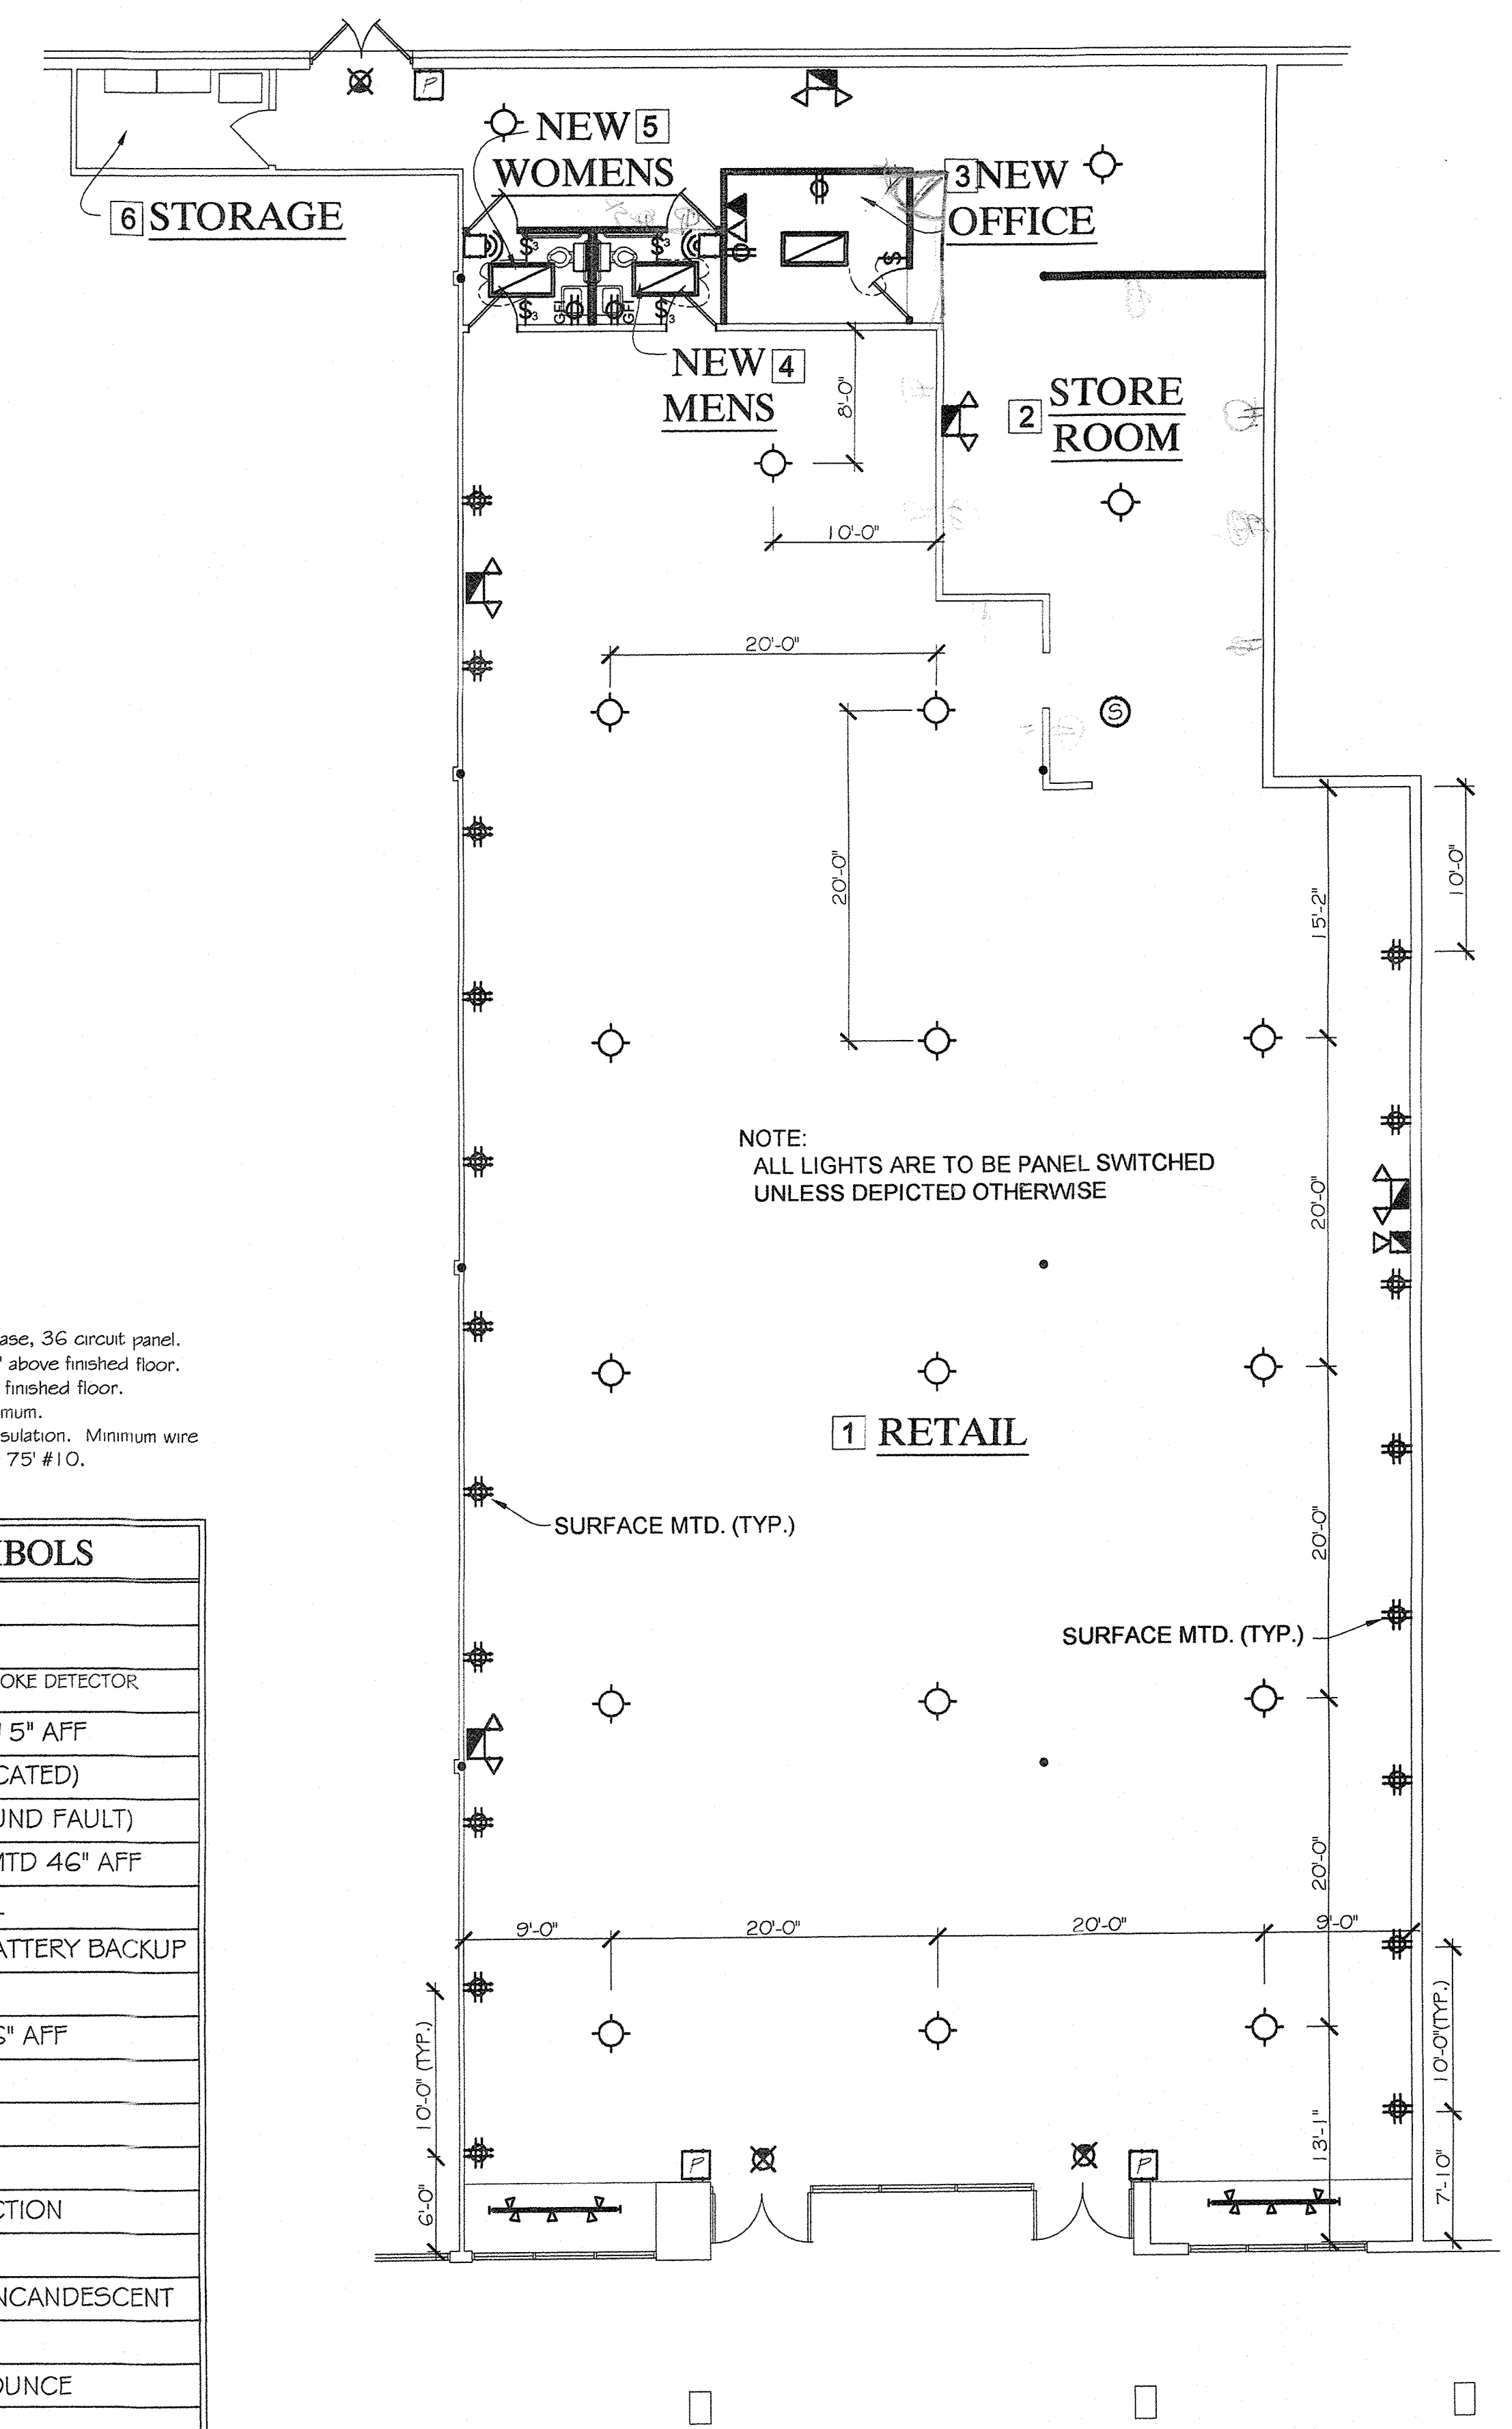

REVISIONS BY:

ARCHITECTURAL RESOURCES, LLC
W. Alex Teipel - Architect
427 West State Street
Geneva, Illinois 60134
(630) 232-1774

I hereby certify that these plans were prepared under my supervision and to the best of my knowledge they comply with the building ordinances, zoning ordinances and all other applicable codes and ordinances including the Illinois Accessibility Code and ANSI A117.1-1986

Expires: 11/30/12

ADA TOILET DET. ELECT. PLAN, DETAIL & NOTES

New Tenant Build-out for:
Hobby Town
Tri-City Center - Suite 2061
St. Charles, Illinois 60174

Date 05/03/11
Scale AS NOTED
Drawn R.M.A.
Job 11-2006

Sheet
E1
Of 2 Sheets