



LEGEND	
[FP]	MANUAL PULL STATION
[SP]	STANDPIPE HOSE OUTLET
[WS]	FIRE WARDEN STATION
[FCS]	FIRE COMMAND STATION
[S]	FIRE DEPT. CONNECTION (SIAMOSE CONNECTION)
[S]	STANDPIPE CONTROL VALVE
[S]	SPRINKLER CONTROL VALVE
[S]	DOMESTIC WATER MAIN CONTROL VALVE
[E]	EVACUATION ROUTE
[F]	FURNITURE/EQUIPMENT
[P]	NON-RATED PARTITION
[B]	FIRE BARRIER
[Hatched]	NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
[Dotted]	IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE	NAME	REVISION COMMENTS
1	10.01.20	MM	ISSUED FOR PERMITTING (AS PER ISSUED FOR PERMITTING AND FILING)
2	10.03.20	JW	REVISED PER COMMENTS FROM CLIENT

DRAWN BY/DATE:	CHECKED BY/DATE:
KM	DL

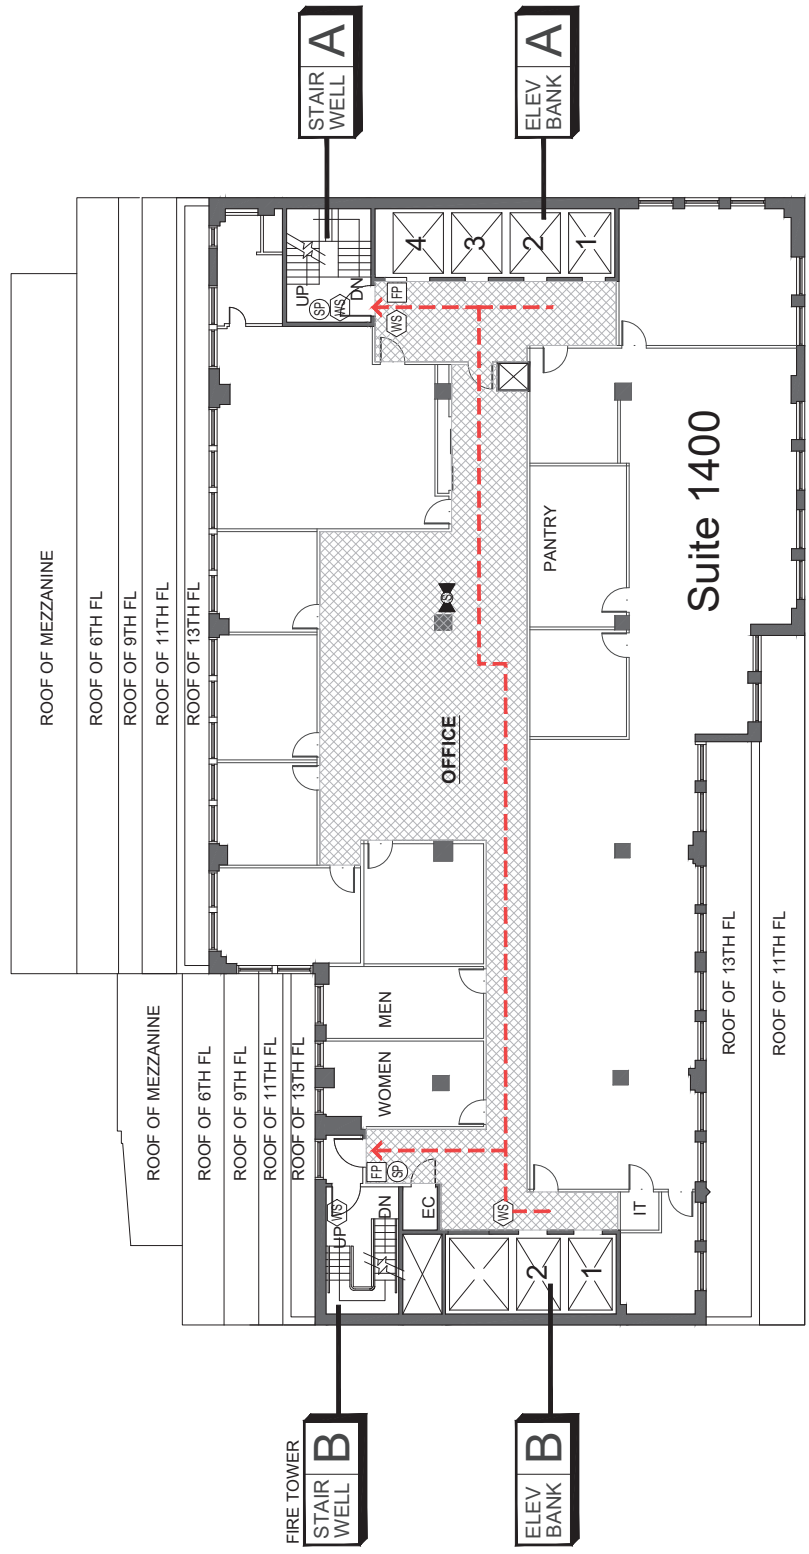
BUILDING ADDRESS:	150 WEST 30TH ST NEW YORK, NY 10001
-------------------	--

DRAWING TITLE:	<b>FL-14</b> 14TH FLOOR
----------------	----------------------------

SURVEY BY:	SURVEY DATE(S):
AR	09.15.20



NOTE: FULL SPRINKLER COVERAGE

WEST 30TH STREET