



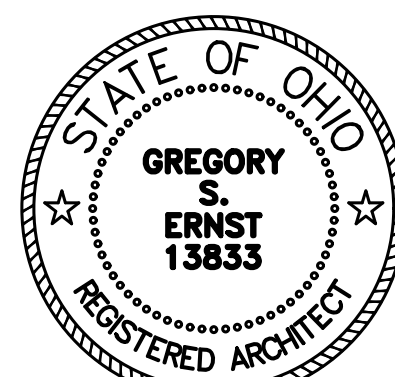

GREGORY S. ERNST | LICENSE NO. 13833
EXPIRATION DATE: 12/31/2025

Issued For:

Permit 05.17.2025

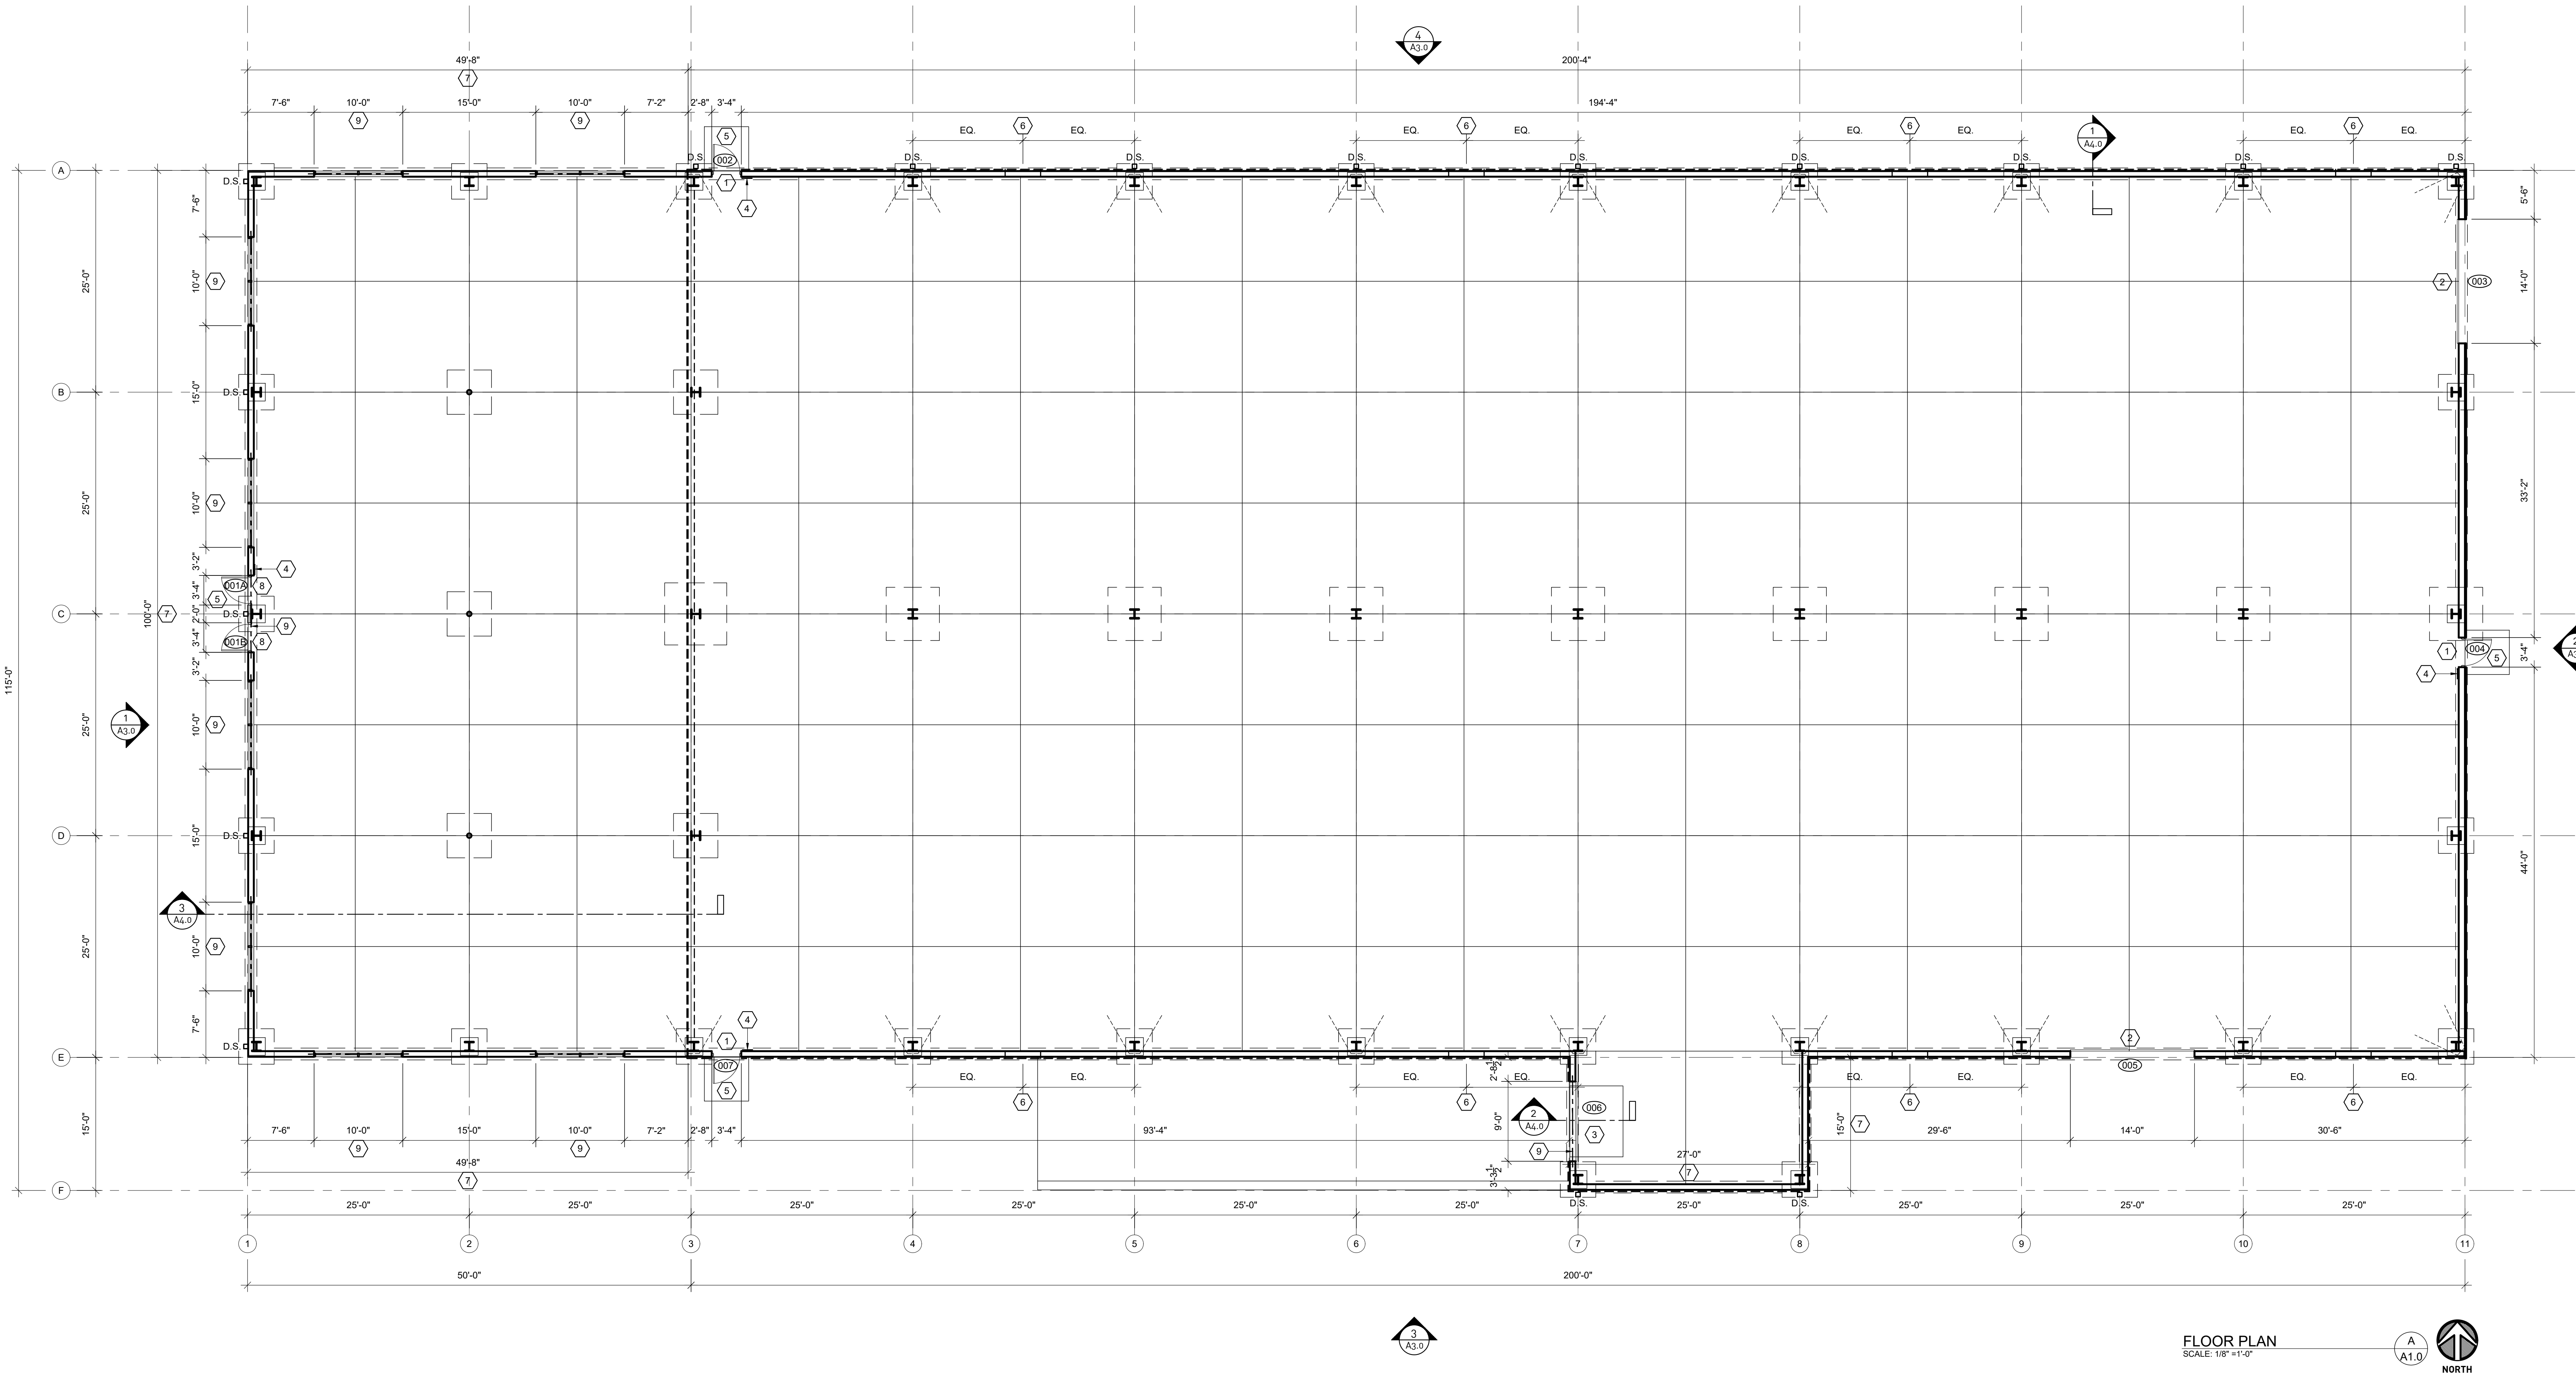

KEYED NOTES

- 3"x7" INSULATED HOLLOW METAL DOOR (U-0.57) WITH HOLLOW METAL FRAME, ENTRANCE LOCKSET, CLOSER, PANIC BAR.
- 14'X14' OVERHEAD DOOR.
- 9'X10' OVERHEAD DOOR.
- PER OBC SECTION 1013.4, PROVIDE RAISED CHARACTER AND BRAILLE EXIT SIGNS IN VISUAL CHARACTERS, RAISED CHARACTERS AND BRAILLE AND COMPLYING WITH CHAPTER 11.
- FROST SLAB, REFER TO 8/S1.1.
- CENTERLINE OF 4'X4' WINDOW ABOVE, RE: A3.0.
- FULL HEIGHT CMU WALLS, RE: A3.0.
- 3"x7" ALUMINUM STOREFRONT DOORS WITH 1" INSULATED GLASS AND ALUMINUM STOREFRONT FRAME, ENTRANCE LOCKSET, CLOSER, PANIC BAR.
- NEW STEEL BEAM, RE: LINTEL SCHEDULE.

DOOR SCHEDULE

- COORDINATE ALL HARDWARE WITH MANUFACTURER AND OWNER PRIOR TO PURCHASE.
- CLEAN AND PROTECT ALL DOORS FOLLOWING INSTALLATION, PROTECT ALL EDGES.
- ALL HARDWARE TO MEET CURRENT ADA CODES.
- COORDINATE KEYING SYSTEM WITH OWNER.
- NO THRESHOLD SHALL EXCEED 1/2" IN HEIGHT.
- ALL HARDWARE TO BE US26D FINISH.
- ALL EXTERIOR DOORS TO BE WEATHER-STRIPPED.
- EACH MAN DOOR TO RECEIVE THE FOLLOWING HARDWARE:
 - DOOR HANDLE: **BEST** CYLINDRICAL LOCKSET, 9K3-7-D
 - HINGES: 1 1/2 PAIR IVES 3CB1 4-1/2" NRP FULL MORTISE HINGE W/ NON-REMOVABLE PIN
 - FLOOR STOP: **IVES** #436
 - CLOSER: **DORMA** 8600 SERIES, ADA COMPLIANT

STEEL LINTEL SCHEDULE

- PROVIDE STEEL LINTELS AS PER THE FOLLOWING SCHEDULE IN ALL MASONRY WALL OPENINGS WHEN NOT SHOWN ON DRAWINGS, OR IN OPENINGS REQUIRED BY THE ARCHITECTURAL, MECHANICAL, AND ELECTRICAL DRAWINGS.

FOR OPENINGS UP TO 4'-0" :	L3-1/2x3-1/2x1/4
FOR OPENINGS FROM 4'-1" TO 6'-0" :	L5x3-1/2x 5/16
FOR OPENINGS FROM 6'-1" TO 7'-0" :	L6x3-1/2x3/4
FOR OPENINGS FROM 7'-1" TO 10'-0" :	W8x18 with 5/16" Plate
- FOR OPENINGS GREATER THAN 10'-0" AND NOT SHOWN ON PLANS ALLOW FOR A MINIMUM BEAM WEIGHT OF 36 PLF PLUS A 5/16" x 11" BOTTOM PLATE
- ALL LINTELS SHALL BEAR ON 8" OF SOLID MASONRY, U.N.O..
- USE ONE ANGLE FOR EACH 4" WYTHE OF MASONRY. PLATES ARE TO BE 1" LESS THAN NOMINAL WALL THICKNESS.
- MINIMUM THICKNESS OF LINTELS IN EXTERIOR WALLS TO BE 5/16".
- ANGLES OR PLATES IN EXTERIOR WIDTHS OF MASONRY WALLS ARE TO BE HOT DIPPED GALVANIZED.

Project:

Spec Building

New Shell

3601 Lane Road Ext
Perry, OH 44081

Project Number:

25016

Drawn By:

GSE

Date:

May 17, 2025

Sheet Title:

Floor Plan




Sheet Number:

A1.0



GREGORY S. ERNST LICENSE NO.: 13833
EXPIRATION DATE: 12/31/2025

Issued For:
Permit 05.17.2025

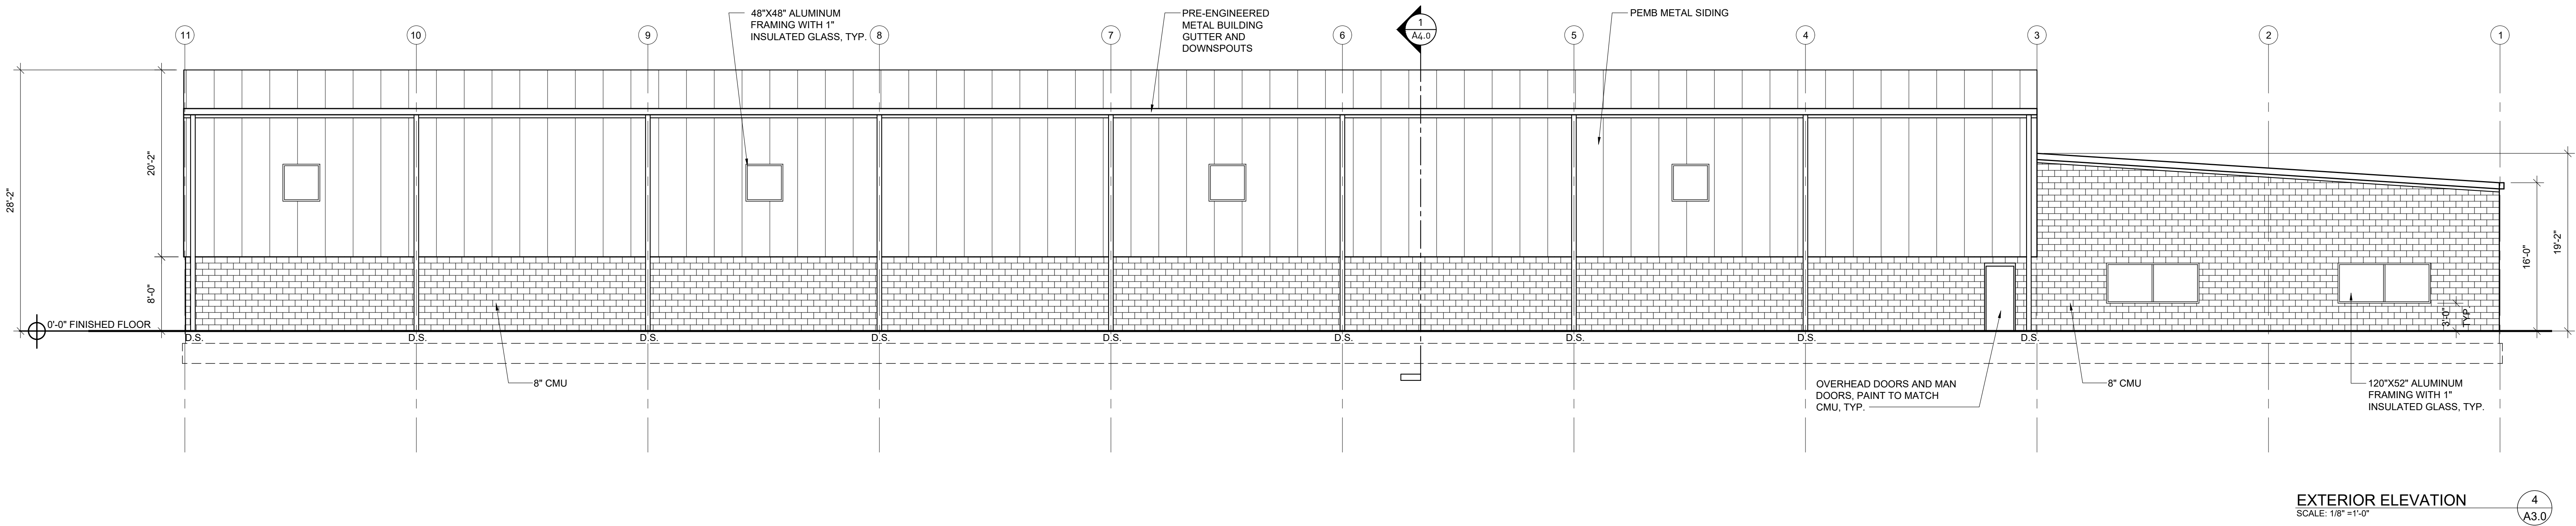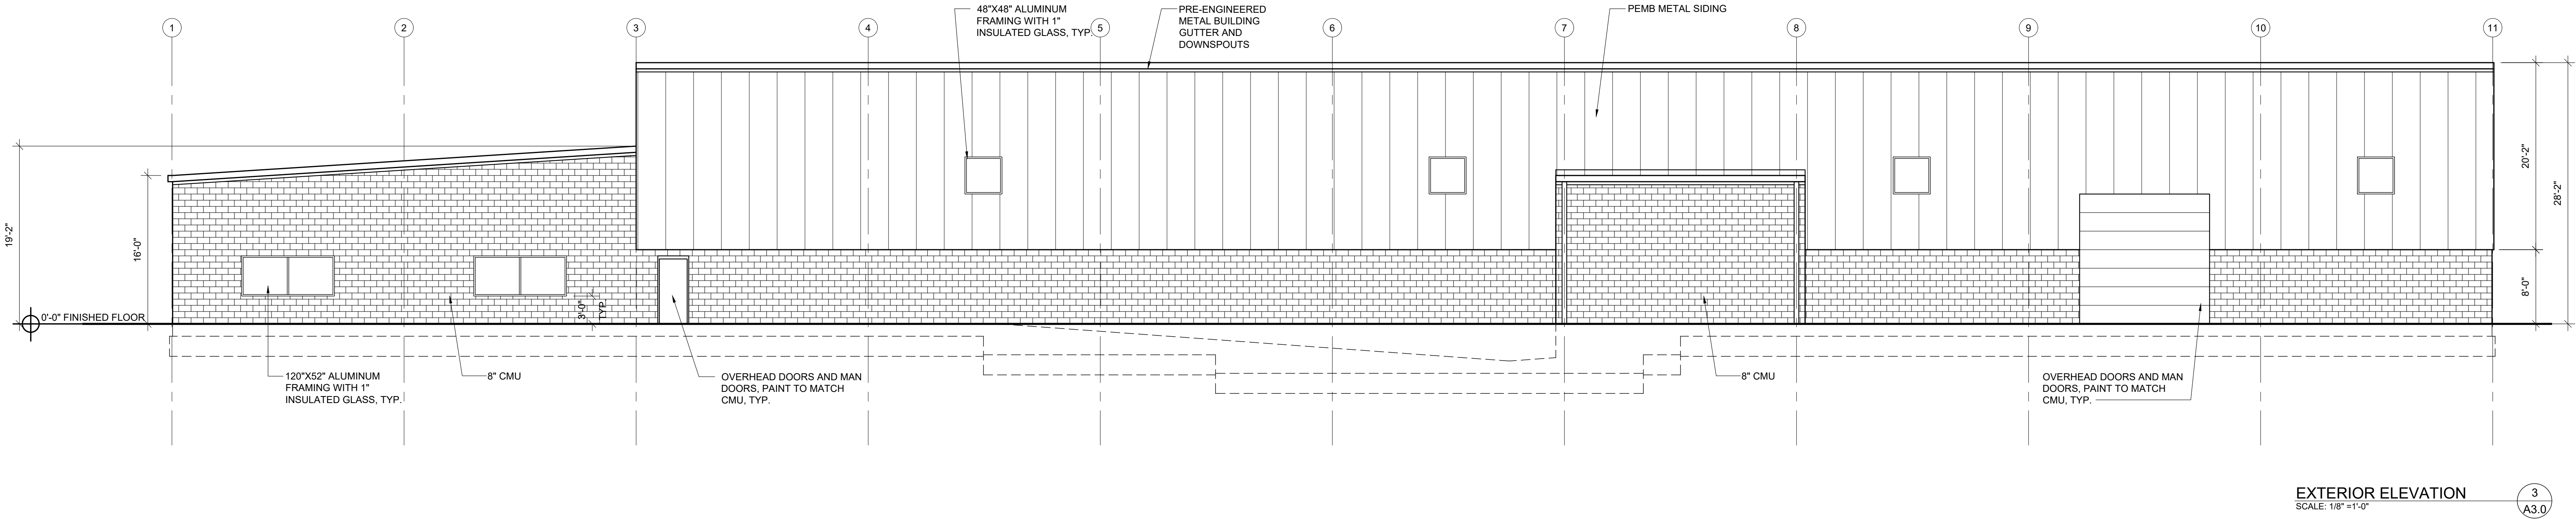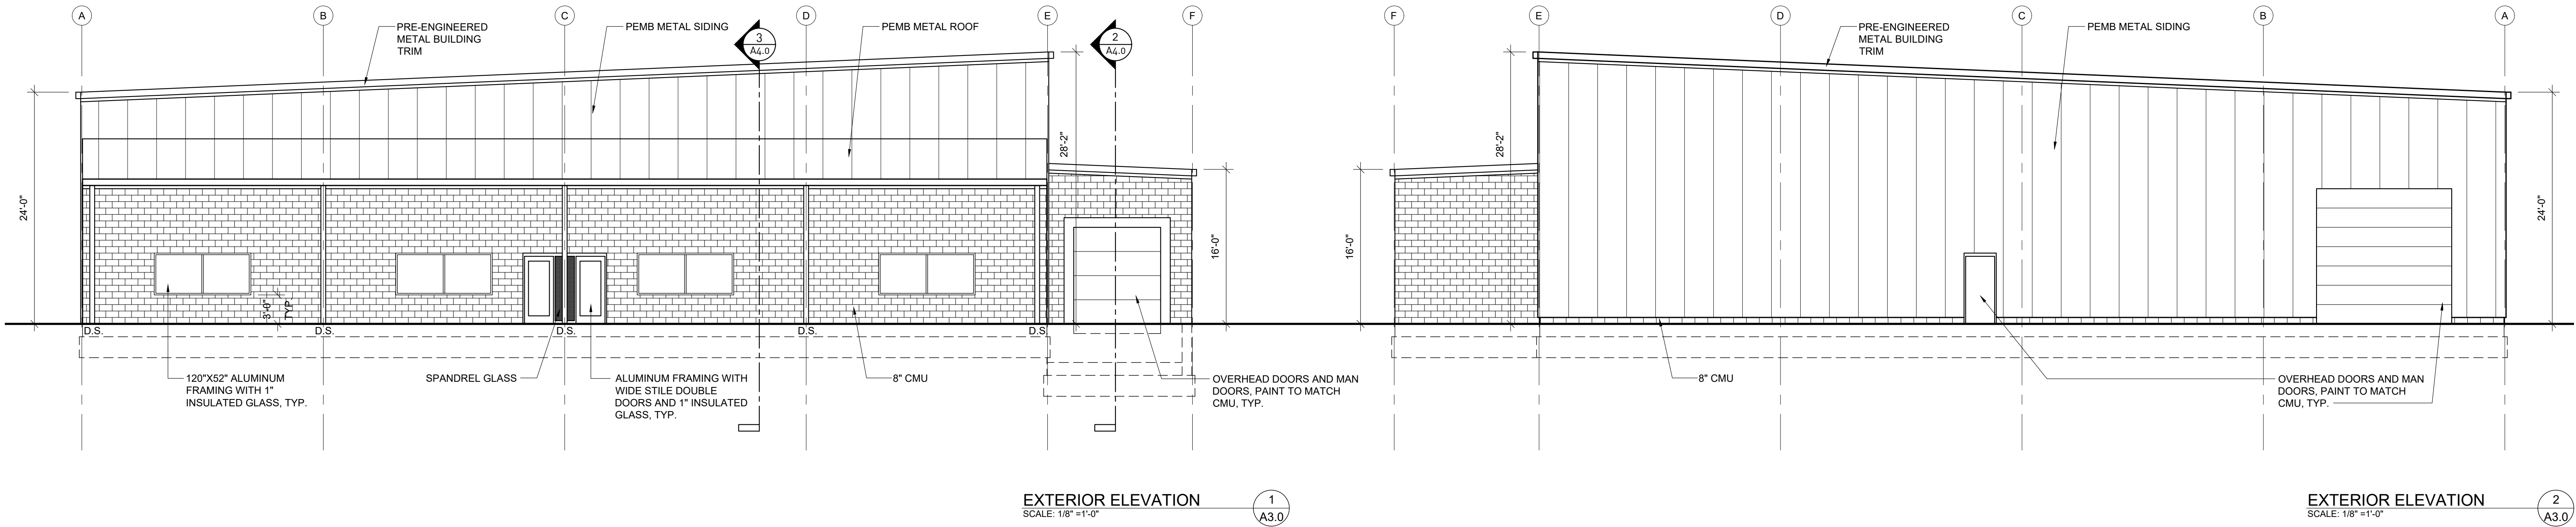

Project:
Spec Building

New Shell

3601 Lane Road Ext
Perry, OH 44081

Project Number:
25016

Drawn By:
GSE

Date:
May 17, 2025

Sheet Title:
Exterior Elevations

Sheet Number:

A3.0