


1 EXISTING REFLECTED CEILING PLAN

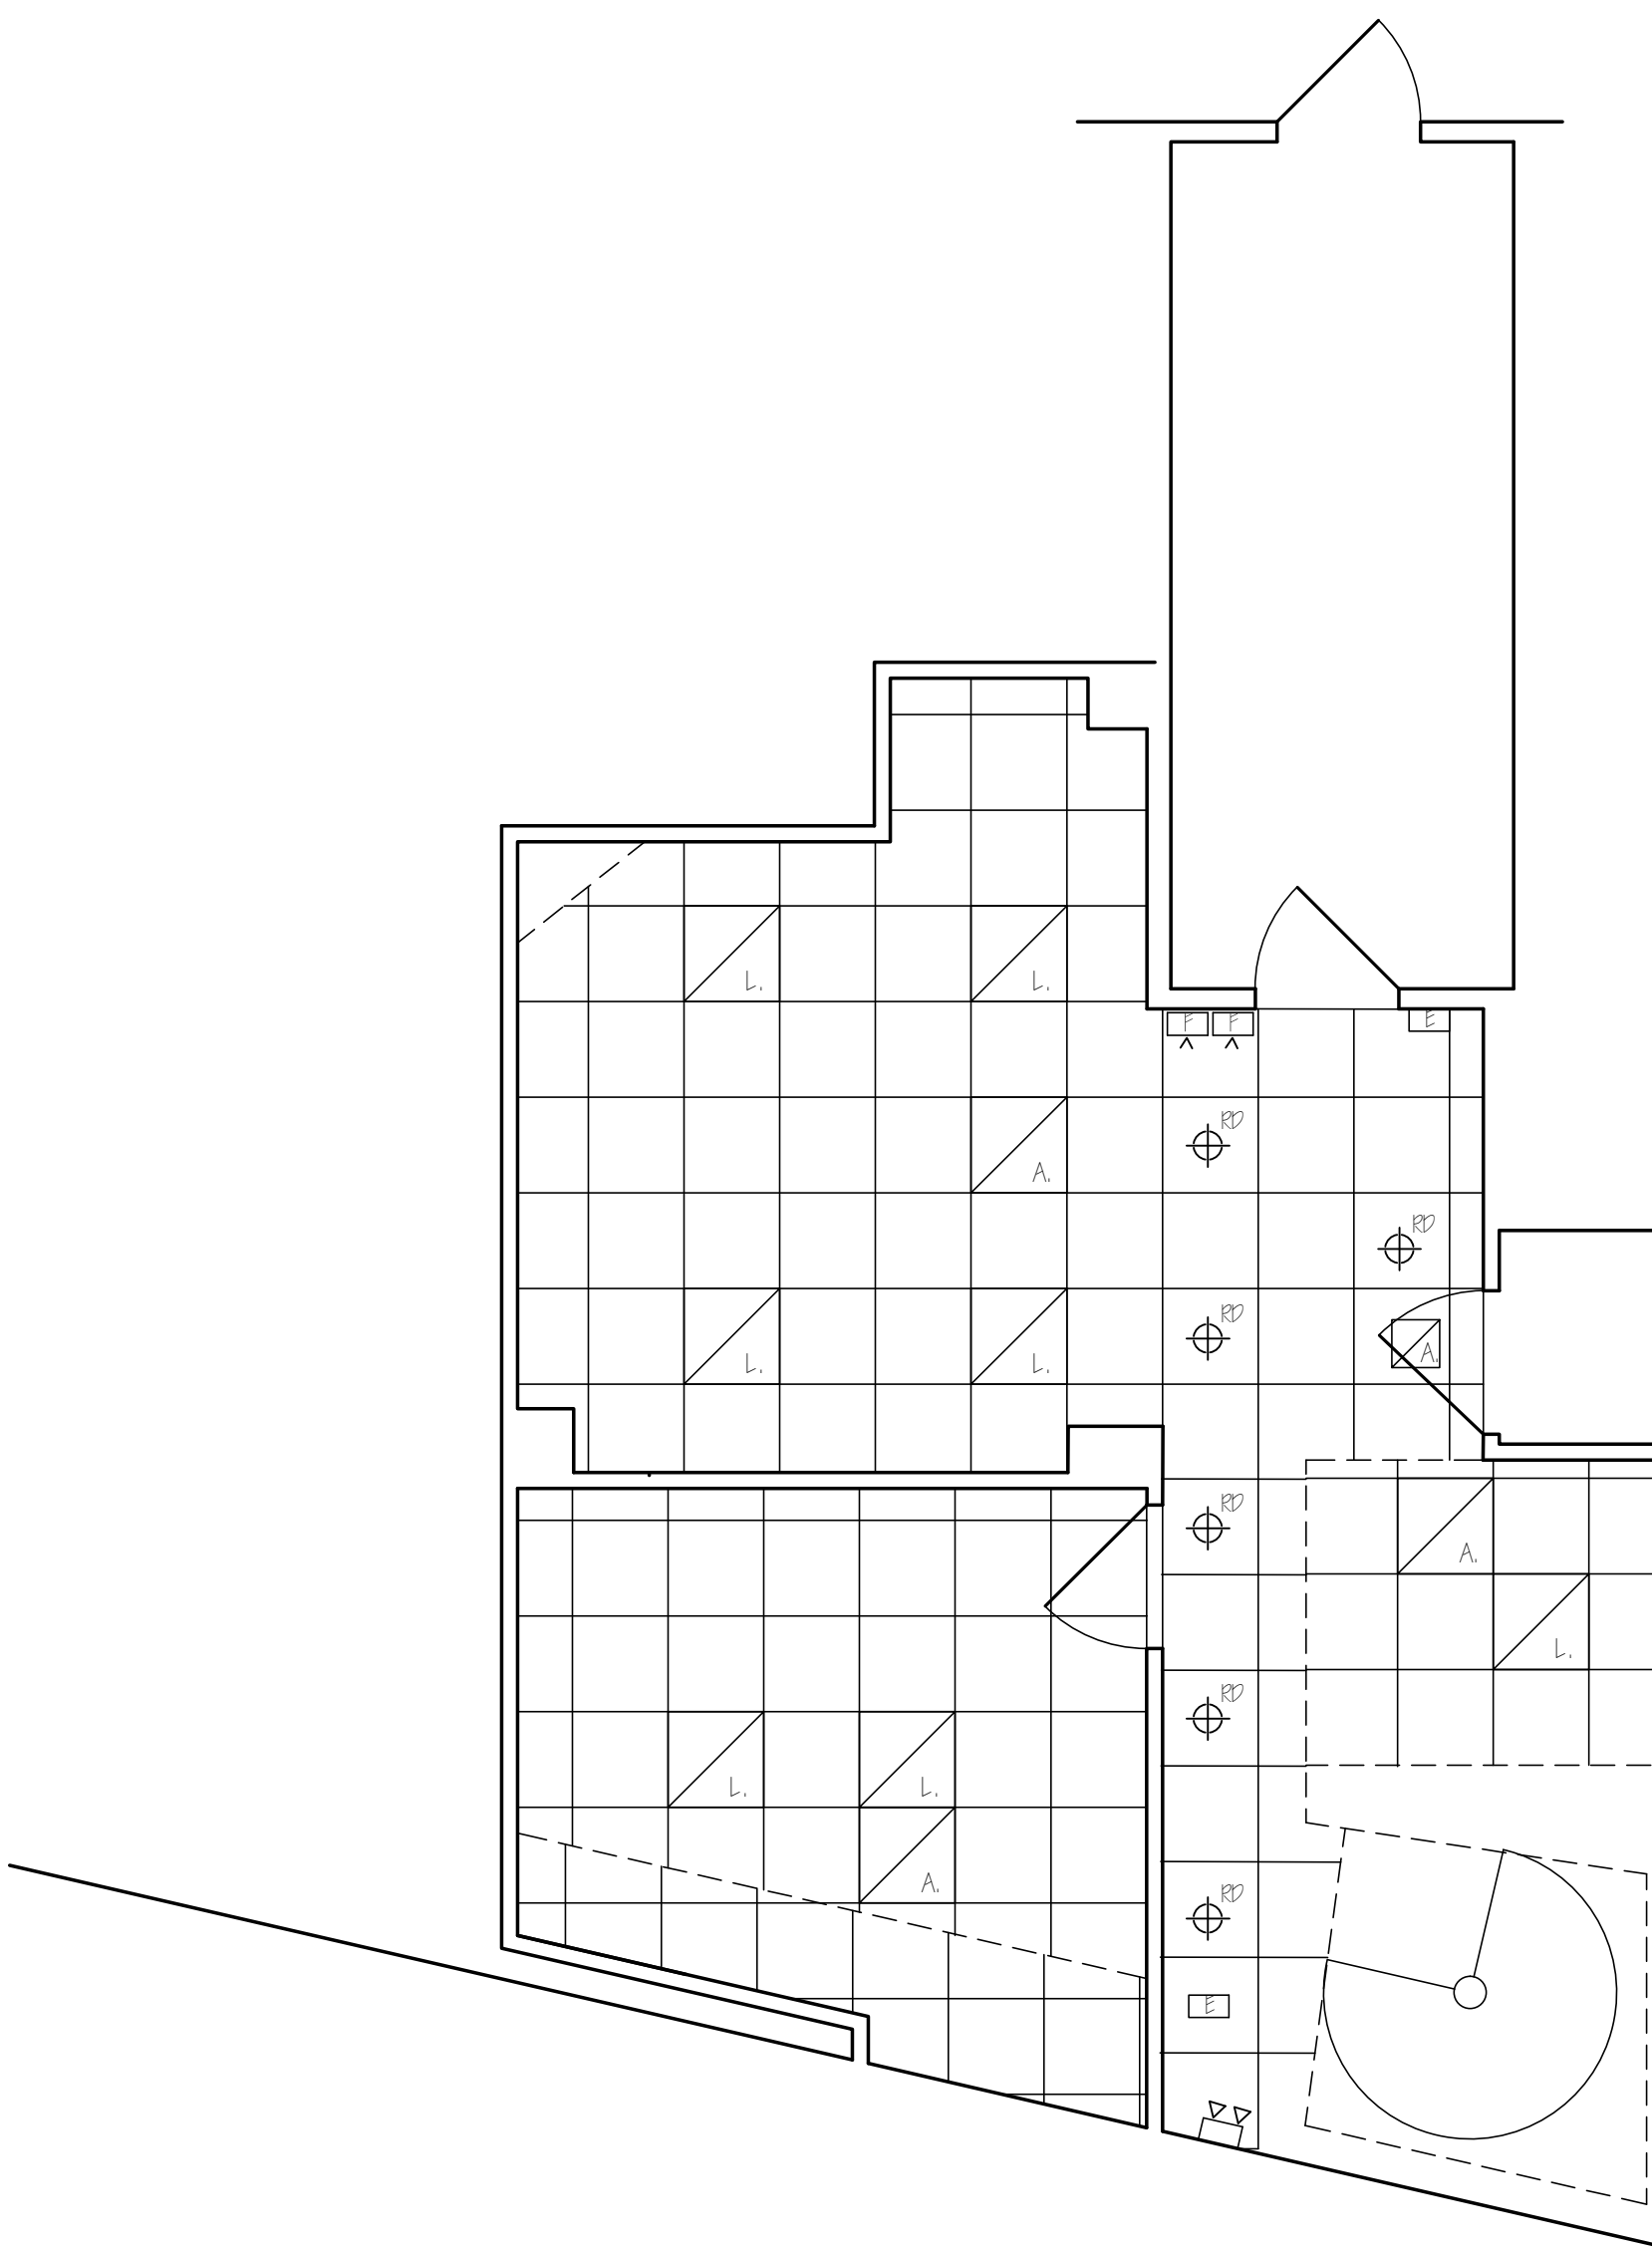

2 EXISTING REFLECTED CEILING PLAN

FIRE PROTECTION KEY

ALL FIRE PROTECTION AND LIGHT FIXTURES ARE EXISTING. NO CHANGES PROPOSED.

- HORN & STROBE ALARM
- HORN ALARM ONLY
- FIRE ALARM PULL STATION
- CLG. MOUNTED FIRE DETECTION SENSOR (SMOKE + /OR HEAD)
- EXIT SIGN
- EXIT W/ EMERGENCY LIGHTS
- EMERGENCY LIGHTS
- THERMOSTAT LOCATION
- WALL MOUNTED SENSOR

ELECTRICAL KEY

NOTE: ALL NEW WALL BOXES TO BE RECESSED IN WALL W/ FLUSH COVER PLATES.

- EXISTING WALL RECEPTACLE TO REMAIN
- 120V DUPLEX WALL RECEPTACLE 16" A.F.F. UNLESS OTHERWISE NOTED
- EXISTING NETWORK CONNECTION TO REMAIN
- NETWORK CONNECTIONS 30" A.F.F. UNLESS OTHERWISE NOTED.
- ALL NETWORK JACKS ARE REQUIRED TO BE MOD-RAP ENHANCED CAT V TELEPHONE JACK
- RECESSED DOWN LIGHT
- 2 X 4 LAY IN LIGHT FIXTURE
- HVAC REGISTER
- SURFACE MOUNTED CLG FIXTURE
- VANITY LIGHT