
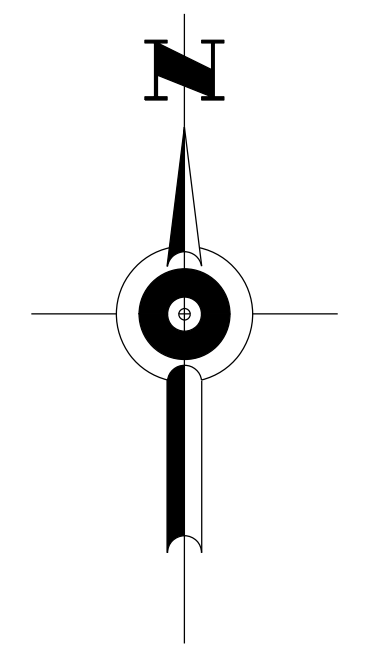


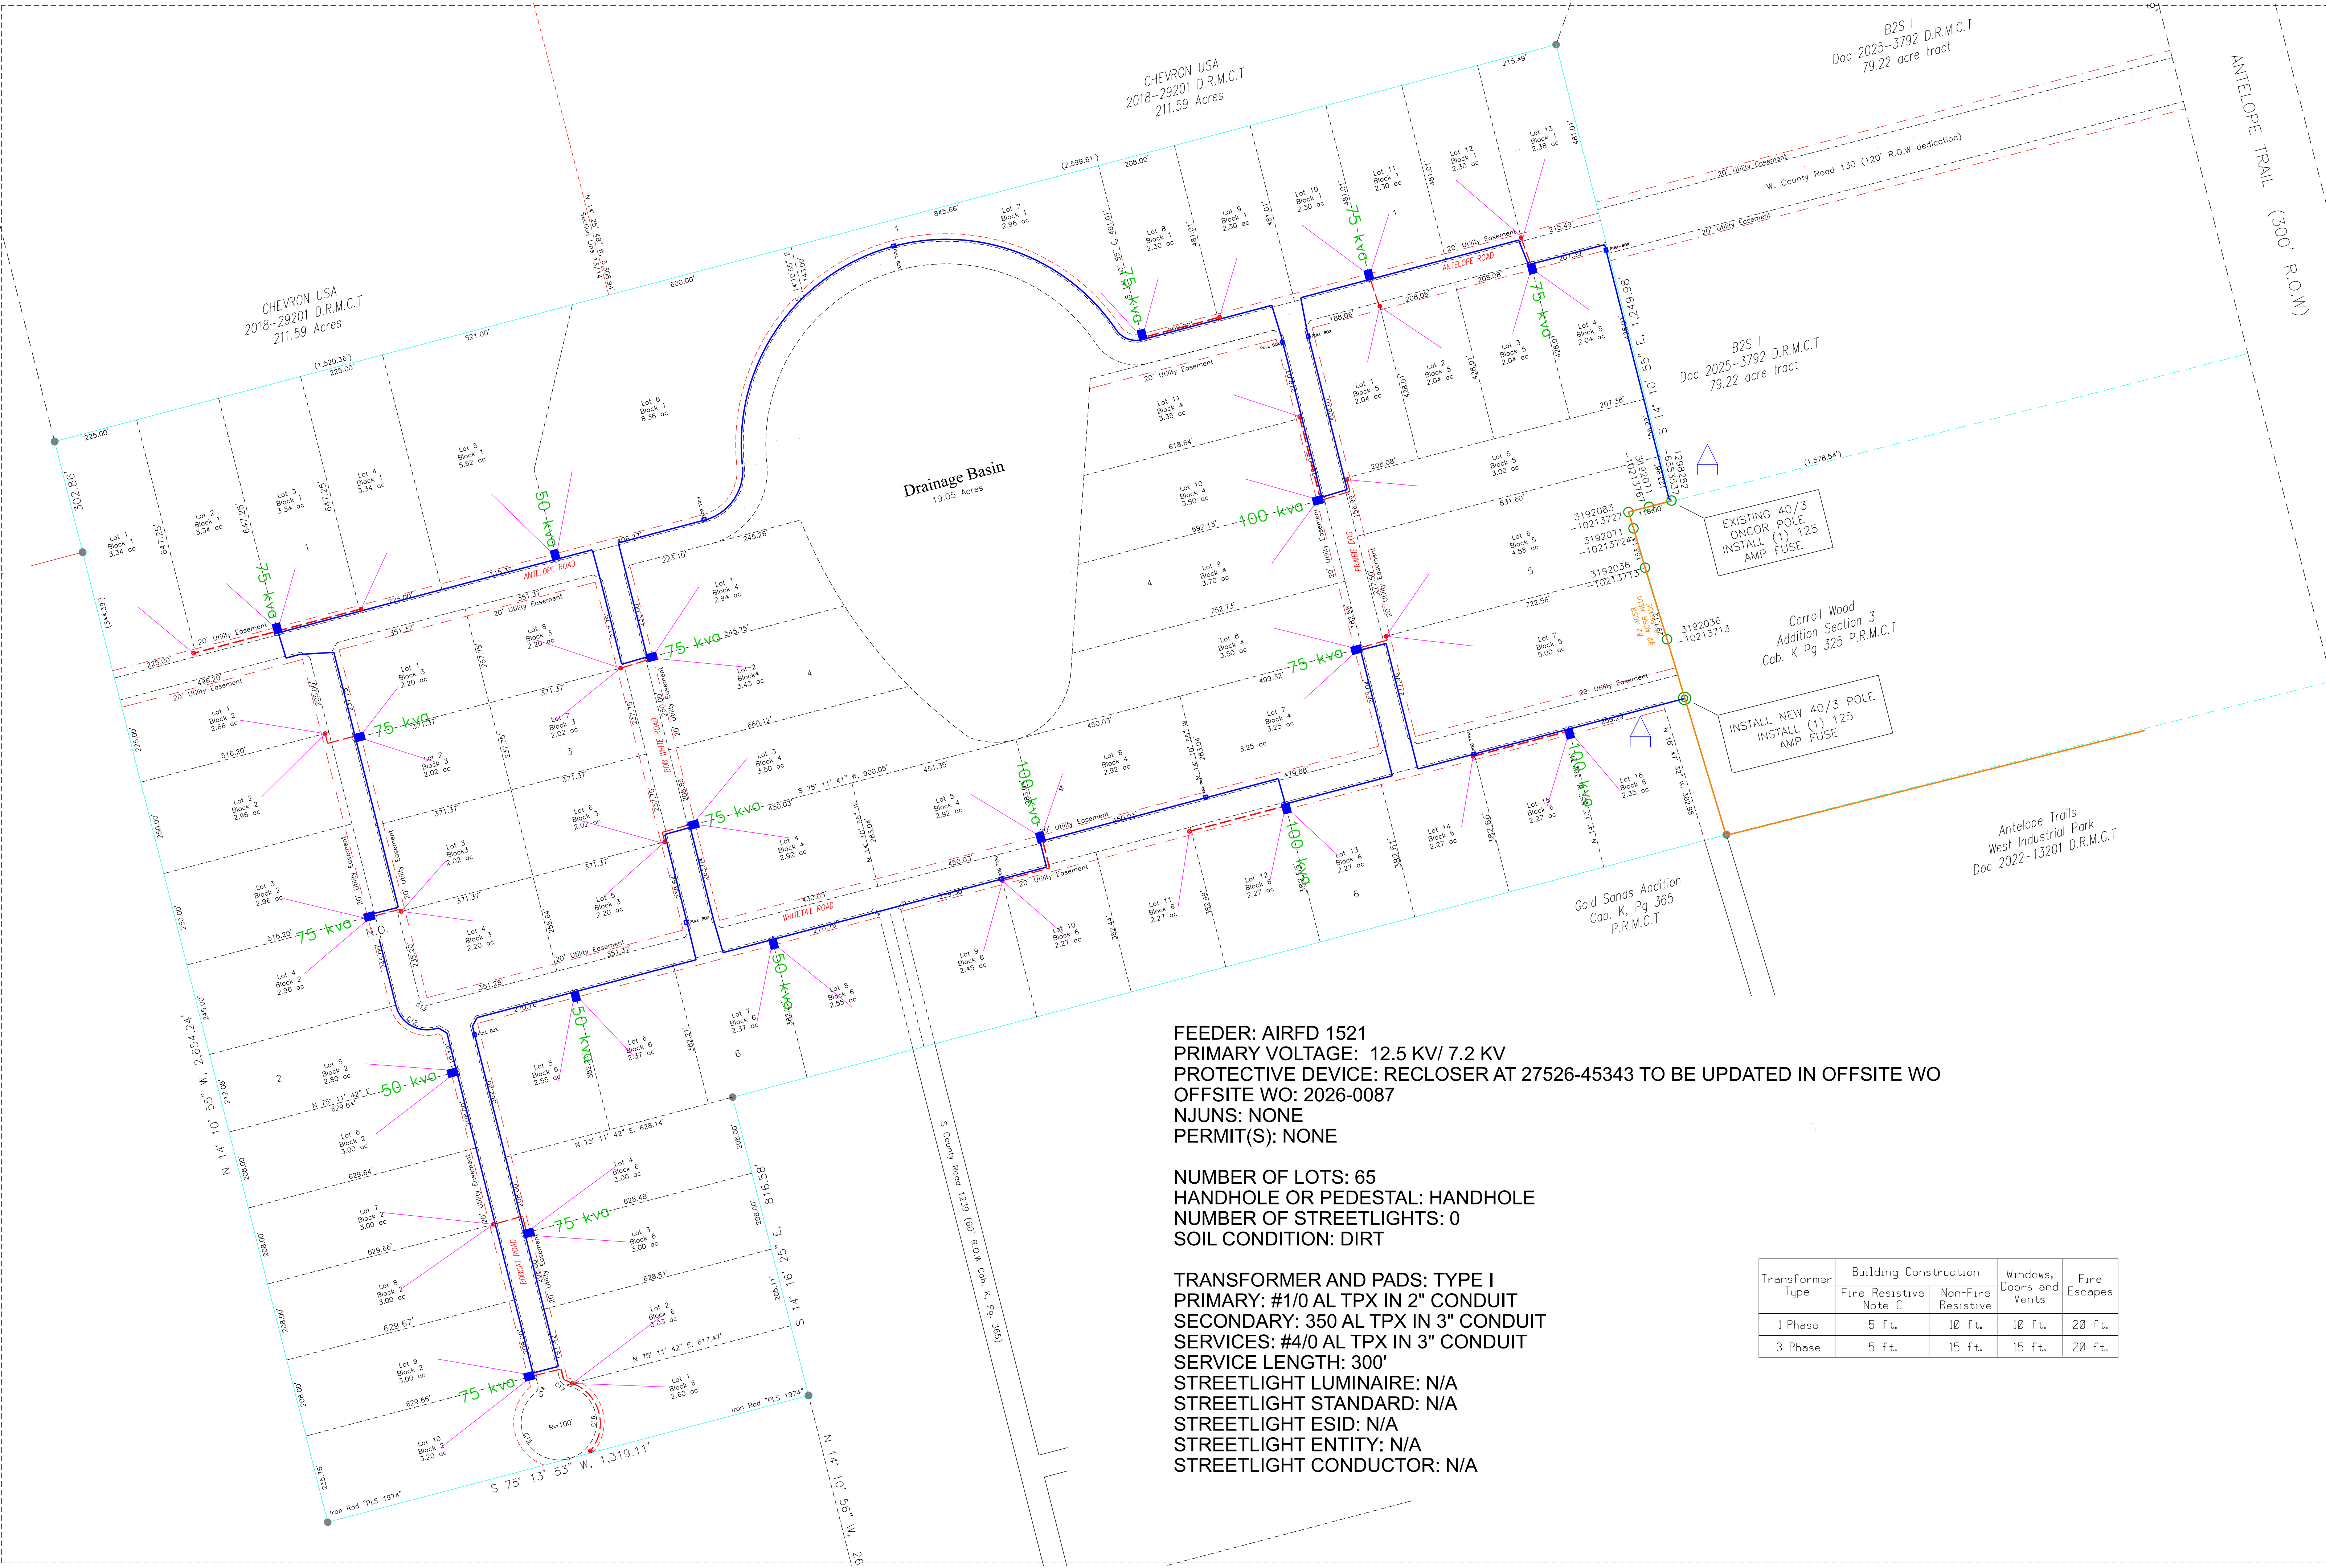

DESIGN CONCURRENCE
APPROVED AS DESIGNED DATE: 4/2/2026 | 9:03 AM PDT
CHANGES AS REQUESTED DATE: _____
NAME: Cody Stroud
TITLE: Property manager

ELECTRICAL FACILITIES LEGEND

- SECONDARY BOX
- STREET LIGHT
- TRANSFORMER PAD
- SWITCHGEAR PAD
- PULL BOX
- EXISTING ONCOR POLE
- PROPOSED ONCOR POLE
- DOWNGUY
- OVERHEAD TRANSFORMER

PRIMARY CONDUIT	SIZE	SECONDARY CONDUIT
	1 IN.	
	2 IN.	
	3 IN.	
	4 IN.	
	6 IN.	
EASEMENT LINE		PHASE DIVISION

FEEDER: AIRFD 1521
PRIMARY VOLTAGE: 12.5 KV/ 7.2 KV
PROTECTIVE DEVICE: RECLOSER AT 27526-45343 TO BE UPDATED IN OFFSITE WO
OFFSITE WO: 2026-0087
NJUNS: NONE
PERMIT(S): NONE

NUMBER OF LOTS: 65
HANDHOLE OR PEDESTAL: HANDHOLE
NUMBER OF STREETLIGHTS: 0
SOIL CONDITION: DIRT

TRANSFORMER AND PADS: TYPE I
PRIMARY: #1/0 AL TPX IN 2" CONDUIT
SECONDARY: 350 AL TPX IN 3" CONDUIT
SERVICES: #4/0 AL TPX IN 3" CONDUIT
SERVICE LENGTH: 300'
STREETLIGHT LUMINAIRE: N/A
STREETLIGHT STANDARD: N/A
STREETLIGHT ESID: N/A
STREETLIGHT ENTITY: N/A
STREETLIGHT CONDUCTOR: N/A

Transformer Type	Building Construction		Windows, Doors and Vents	Fire Escapes
	Fire Resistive Note C	Non-Fire Resistive		
1 Phase	5 ft.	10 ft.	10 ft.	20 ft.
3 Phase	5 ft.	15 ft.	15 ft.	20 ft.

ONCOR ELECTRIC DELIVERY
DISTRIBUTION PROJECT MANAGEMENT AND DESIGN SERVICES

PROJ. NAME : ANTELOPE RIDGE
LOCATION : MIDLAND
PROJ. MGR. : ASHWID JUDE
DESIGNER : MELINDA WOLFINBARGER
WO # : 30744671 0 500
PLOT SCALE : _____

DATE: 3-6-26