

Permit Name Mark Harrell
 Installed by Beeks Septic
 Issue Date 10-18-23 Expiration Date _____

3532 N Old 52
 PIN 5974-02-59-8160
 System Type Pump to PPBPS + Existing
 EHS Brandon Joyce

Operation Permit


Stokes County Health Department - Environmental Health Section

This system has been installed in compliance with applicable North Carolina General Statutes, Rules for Sewage Treatment and Disposal, and all conditions of the Improvement Permit and Construction Authorization.

Permit Conditions

- I. Performance: System shall perform in accordance with Rule.1961.
- II. Monitoring: System shall be monitored in accordance with Rule.1961.
- III. Maintenance _____
- IV. Operation _____
- V. Other _____

GPD 285 gpd # People 3 people # Bedrooms NA
 Food Stand for Hunt Brothers Pizza + ice cream only.
 No other food items.
 No ice cream dipper well.
 No expired/old/problem icecream dumped down drain.

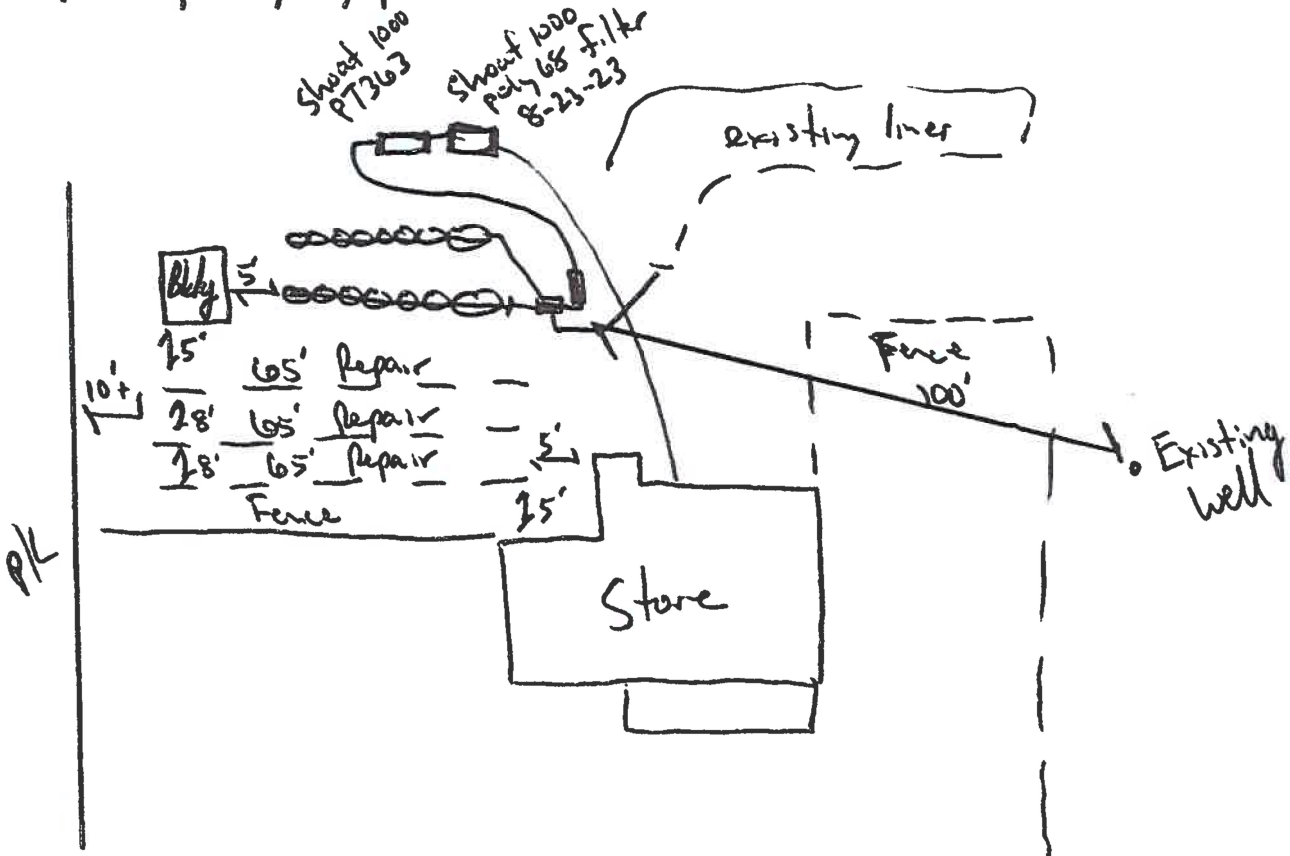

Old 52

System Code	System Description	New		Expansion		Repair	
		Gravity	Pressure	Gravity	Pressure	Gravity	Pressure
PPBPS	T + J Panel			Expansion Discharge			

IMPROVEMENT PERMIT-CONSTRUCTION AUTHORIZATION PERMIT

Stokes County Customer's

Stokes County Building Inspector

REQUIRED FOR BUILDING PERMIT

STOKES COUNTY HEALTH DEPARTMENT
ENVIRONMENTAL HEALTH SECTION
PHONE: 593-2403 FAX:336-593-4021

CONSTRUCTION AUTHORIZATION IS
REQUIRED BEFORE A BUILDING PERMIT
CAN BE ISSUED

ISSUE TO: <i>Mark Hassell</i>		PERMIT # <i>28338</i>	TAX MAP # <i>61-25</i>
INITIAL SYSTEM <i>PPBPS</i>	REPAIR SYSTEM <i>PPBPS Saprolite</i>	LOT SIZE (AC) <i>1.4</i>	
NEW PIN# <i>5114-02-59-8160</i>	PIN#	PROPERTY LOCATION <i>3532 N Old 52</i>	
DIRECTIONS <i>Old 52 to 3532</i>			
FACILITY TYPE <i>Fuel Stand</i>	SEPTIC (GAL) TANK <i>≥ 750</i>	# BEDROOMS —	STONE DEPTH (IN) —
BASEMENT YES <i>NO</i>	PUMP TANK (GAL) —	LTAR <i>.25</i>	TRENCH DEPTH (IN) <i>30</i>
BASEMENT FIXTURES YES <i>NO</i>	DRAIN LINES (LF) <i>65</i>	TRENCH WIDTH (IN) <i>24</i>	TRENCH SPACING (FT) <i>8</i>
COMMENTS AND/OR CONDITIONS <i>Fuel Stand to be built on 3' x 3' concrete pad. No ice cream dipper well. No expired/old/problem ice cream dumped down the drain.</i>			
EHS	DATE <i>8-3-2023</i>	THIS PERMIT EXPIRES 5 YEARS FROM THIS DATE UNLESS OTHERWISE NOTED.	

THE CONSTRUCTION AUTHORIZATION IS SUBJECT TO REVOCATION IF THE SITE PLAN, PLAT, OR THE INTENDED USE CHANGES. THIS CONSTRUCTION AUTHORIZATION IS SUBJECT TO COMPLIANCE WITH THE PROVISIONS OF THE LAWS AND RULES FOR SEWAGE TREATMENT AND DISPOSAL AND TO THE CONDITIONS OF THIS PERMIT. THE CONSTRUCTION AND INSTALLATION REQUIREMENTS OF RULES .1950, .1952, .1954, .1956, .1957, .1958, AND .1959 ARE INCORPORATED BY REFERENCE INTO THIS PERMIT AND SHALL BE MET. SYSTEMS SHALL BE INSTALLED IN ACCORDANCE WITH THE ATTACHED LAYOUT.

