

APPLICATION ONLY

Time 10:00

SEPTIC SYSTEM APPLICATION
FLATHEAD COUNTY

PERMIT NO. 9562
SANITATION OFFICE

- Lot 14 Country Village #2 Parcel Size _____
Legal Description of Property
- Church of God Prophecy Property Occupant Same
- Ch. Meredith E. Crow Address & Phone 752-3069 Property Address 554 Country Way N., Kal.
- Proposed Dwelling: Conv. Sing. Fam. _____; Mob. Home _____; Dupl. _____; 4-Plex _____; Apart. _____; Other Church
- No. of Bedrooms: _____ Existing Structures: none Water: Evergreen
- Septic System: New Remodel _____ Installer: on bid

I HEREBY DECLARE the above information is true, complete and correct to the best of my knowledge. I will install the system according to the FLATHEAD COUNTY REGULATIONS FOR SEWAGE TREATMENT SYSTEMS and the terms of the permit. I acknowledge that the County has not designed my system and that these requirements do not bind or obligate the County to guarantee this system's operation. I FURTHER AGREE to call and give 24 hours ADVANCE NOTICE for REQUIRED INSPECTIONS of the SYSTEM. PLEASE PHONE 755-5300 Ext. 350!!

7-11-86 Date Meredith E. Crow Signature of Applicant

- | | |
|---|--|
| 1. Septic Tank Size: <u>900</u> gallons (min.) | Site Evaluator's Comments |
| 2. Soil Type: <u>SILT LOAM OVER VFSANDY LM.</u>
How Determined: <u>SUBMITTAL</u> | <u>Congregation of 80 member
SYSTEM SIZED AT 3
80 people @ 5 gpd = 400 gal.
application rate 0.6 gpd/sf.
=> 660 SQ. FT. of
absorption area.</u> |
| 3. Depth of Water Table/Bedrock: <u>7 FT.</u>
How Determined: <u>SUBMITTAL</u> | |
| 4. Absorption Area: <u>660 SQ. FT.</u> | |

Describe Drainfield: USE 330 L.F. OF 2 FT. WIDE TRENCH OR 270 L.F. OF 3 FT. WIDE TRENCH. KEEP THE TRENCHES SHALLOW AND NO DEEPER THAN 36 INCHES.


PROPOSED DRAINFIELD SITE IS SOUTH AND SOUTH-EAST OF THE BUILDING. BE SURE TO LEAVE ENOUGH SPACE FOR A 100% REPLACEMENT AREA, PREFERABLY BELOW THE ORIGINAL DRAINFIELD

7/14/86 Date DREW PASLAWSKY Signature Authorizing Approval of Permit Application E003802

* These requirements establish the MINIMUM SIZE FOR THIS SEPTIC SYSTEM INSTALLATION. Permit will be voided and declared invalid if the system is not installed within 12 months of the issuance of this permit.

Please phone 755-5300 Ext. 350 for inspection when system is completely installed except for backfill. Please notify this office at least one day in advance for prompt service.

LAYOUT

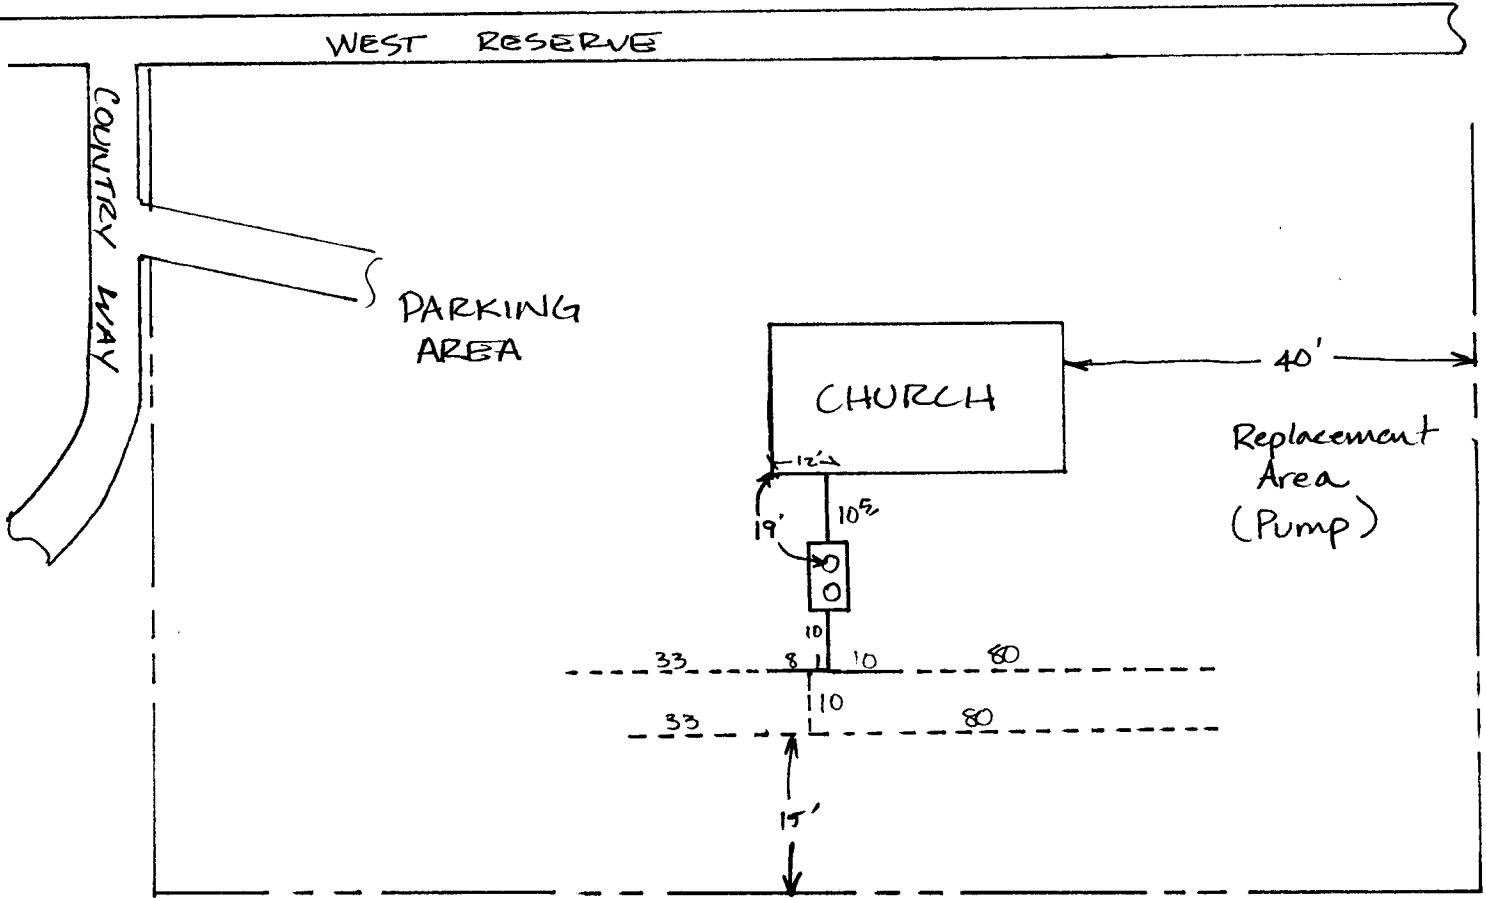

11000 gal
SCH 40



Date 8/26/86 Inspected by Joe Johnson

Approved Disapproved*

Inspector Comments Use of 226 LF of 2 ft wide trenches (452 ft²)
Replacement area will probably require pump system. Trench
depth 3 ft. Soils: 0-12" silt loam 12"-36"+ med. grained sand.

Name of Installer: Stillwater Builders
Larry Tracy

