ADA & ACCESSIBILTY SIGNAGE– DOOR & DOOR HARDWARE NOTES:

1. IT IS THE RESPONSIBILITY OF THE DOOR HARDWARE CONTRACTOR TO ENSURE THAT ALL DOORS AND DOOR HARDWARE COMPLIES WITH THE INTERNATIONAL BUILDING CODE, INDIANA ACCESSIBILTY CODE & CABO/ANSI A117.1 ACCORDING TO THE NOTES LISTED BELOW.
2. PROVIDE DETECTABLE WARNINGS (KNURLED HARDWARE) AT ALL DOORS TO HAZARDOUS AREAS INCLUDING BUT NOT LIMITED TO: JANITOR'S CLOSET, MECHANICAL & ELECTRICAL ROOMS, IN ACCORDANCE WITH ANSI 4.27.3.
3. ACCESSIBLE SIGNAGE AND WARNINGS MUST COMPLY WITH SECTION 1109.0 OF THE BNBC, SECTION 400.310.(U) OF THE IAC AND SECTION 4.28 OF ICC/ANSI A117.1
4. ACCESSIBILTY CONTROLS, OPERATING MECHANISMS AND HARDWARE MUST COMPLY WITH SECTION 1108.10 OF THE BNBC, SECTION 400.310.c OF THE AIC AND SECTION 4.25 OF THE CABO/ANSI A117.1
5. VERIFY ALL DOOR HARDWARE & FINISHES W/OWNER PRIOR TO CONSTRUCTION.
6. ALL EXTERIOR HOLLOW METAL AND OVERHEAD DOORS TO BE INSULATED.

DOOR SCHEDULE

DESIGNATION	SIZE	MATERIAL	FRAME	HARDWARE	FIRE RATING
A	3'-0" x 6'-8" x 1 3/4"	INSULATED HOLLOW METAL	STEEL	BY OWNER	1-HOUR
B	14'-0" x 14'-0"	INSULATED METAL	PER MFG DETAIL	BY OWNER	NOT REQ'D.
C	3'-0" x 6'-8" x 1 3/4"	HOLLOW METAL	STEEL	BY OWNER	1-HOUR

DOOR SCHEDULE NOTES

1.	HOLLOW METAL FRAMES SHALL BE 5 3/4" DEEP STANDARD DOUBLE RABBET 16 GA. FOR EXTERIOR DOORS AND 18 GA. FOR INTERIOR DOORS WITH 2" FACE AT JAMBS & 4" FACE AT HEADS. FURNISH & INSTALL SILENCERS ON STRIKE JAMB & HEADS. [illegible]
2.	HOLLOW METAL DOORS SHALL BE FULL-FLUSH DESIGN, [illegible] HOT-DIP GALVANIZED AND PRIME PAINTED, WITH [illegible] VERTICAL SEAM [illegible] TOP FLUSH CHANNEL AND BEVELED LOCK EDGE; REINFORCED FOR THE FINISH HARDWARE SELECTED. USE 16 GA. FOR EXTERIOR DOORS & 18 GA. FOR INTERIOR DOORS.

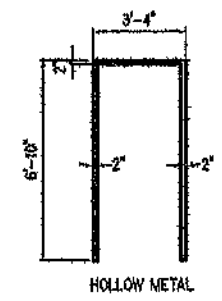

DOOR FRAME TYPES

ENERGY CONSERVATION & COMCHECK ENVELOPE COMPLIANCE REQUIREMENTS

1. ALL JOINTS AND PENETRATIONS SHALL BE CAULKED, GASKETED OR COVERED WITH A MOISTURE VAPOR-PERMEABLE-WRAPPING MATERIAL INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTALLATION INSTRUCTIONS.
2. WINDOWS & DOORS SHALL BE CERTIFIED AS MEETING LEAKAGE/INFILTRATION REQUIREMENTS.
3. THE COMPONENT R-VALUES & U-FACTORS ARE LABELED AS CERTIFIED.
4. INSULATION SHALL BE INSTALLED ACCORDING TO MFG. INSTRUCTIONS, IN SUBSTANTIAL CONTACT WITH THE SURFACE BEING INSULATED, AND IN A MANNER THAT ACHIEVES THE RATED R-VALUE WITHOUT COMPRESSING THE INSULATION.
5. OVERHEAD DOORS ARE WEATHER SEALED.
6. RECESSED LIGHTING FIXTURES SHALL BE: TYPE IC RATED AND SEALED OR GASKETED; OR INSTALLED IN AN APPROPRIATE AIR-TIGHT ASSEMBLY WITH A 0.5" CLEARANCE FROM COMBUSTIBLE MATERIAL AND WITH 3" CLEARANCE FROM INSULATION MATERIAL.
7. BUILDING ENTRY DOORS SHALL BE EQUIPPED WITH AUTOMATIC CLOSING DEVICES.
8. VAPOR RETARDER SHALL BE INSTALLED.

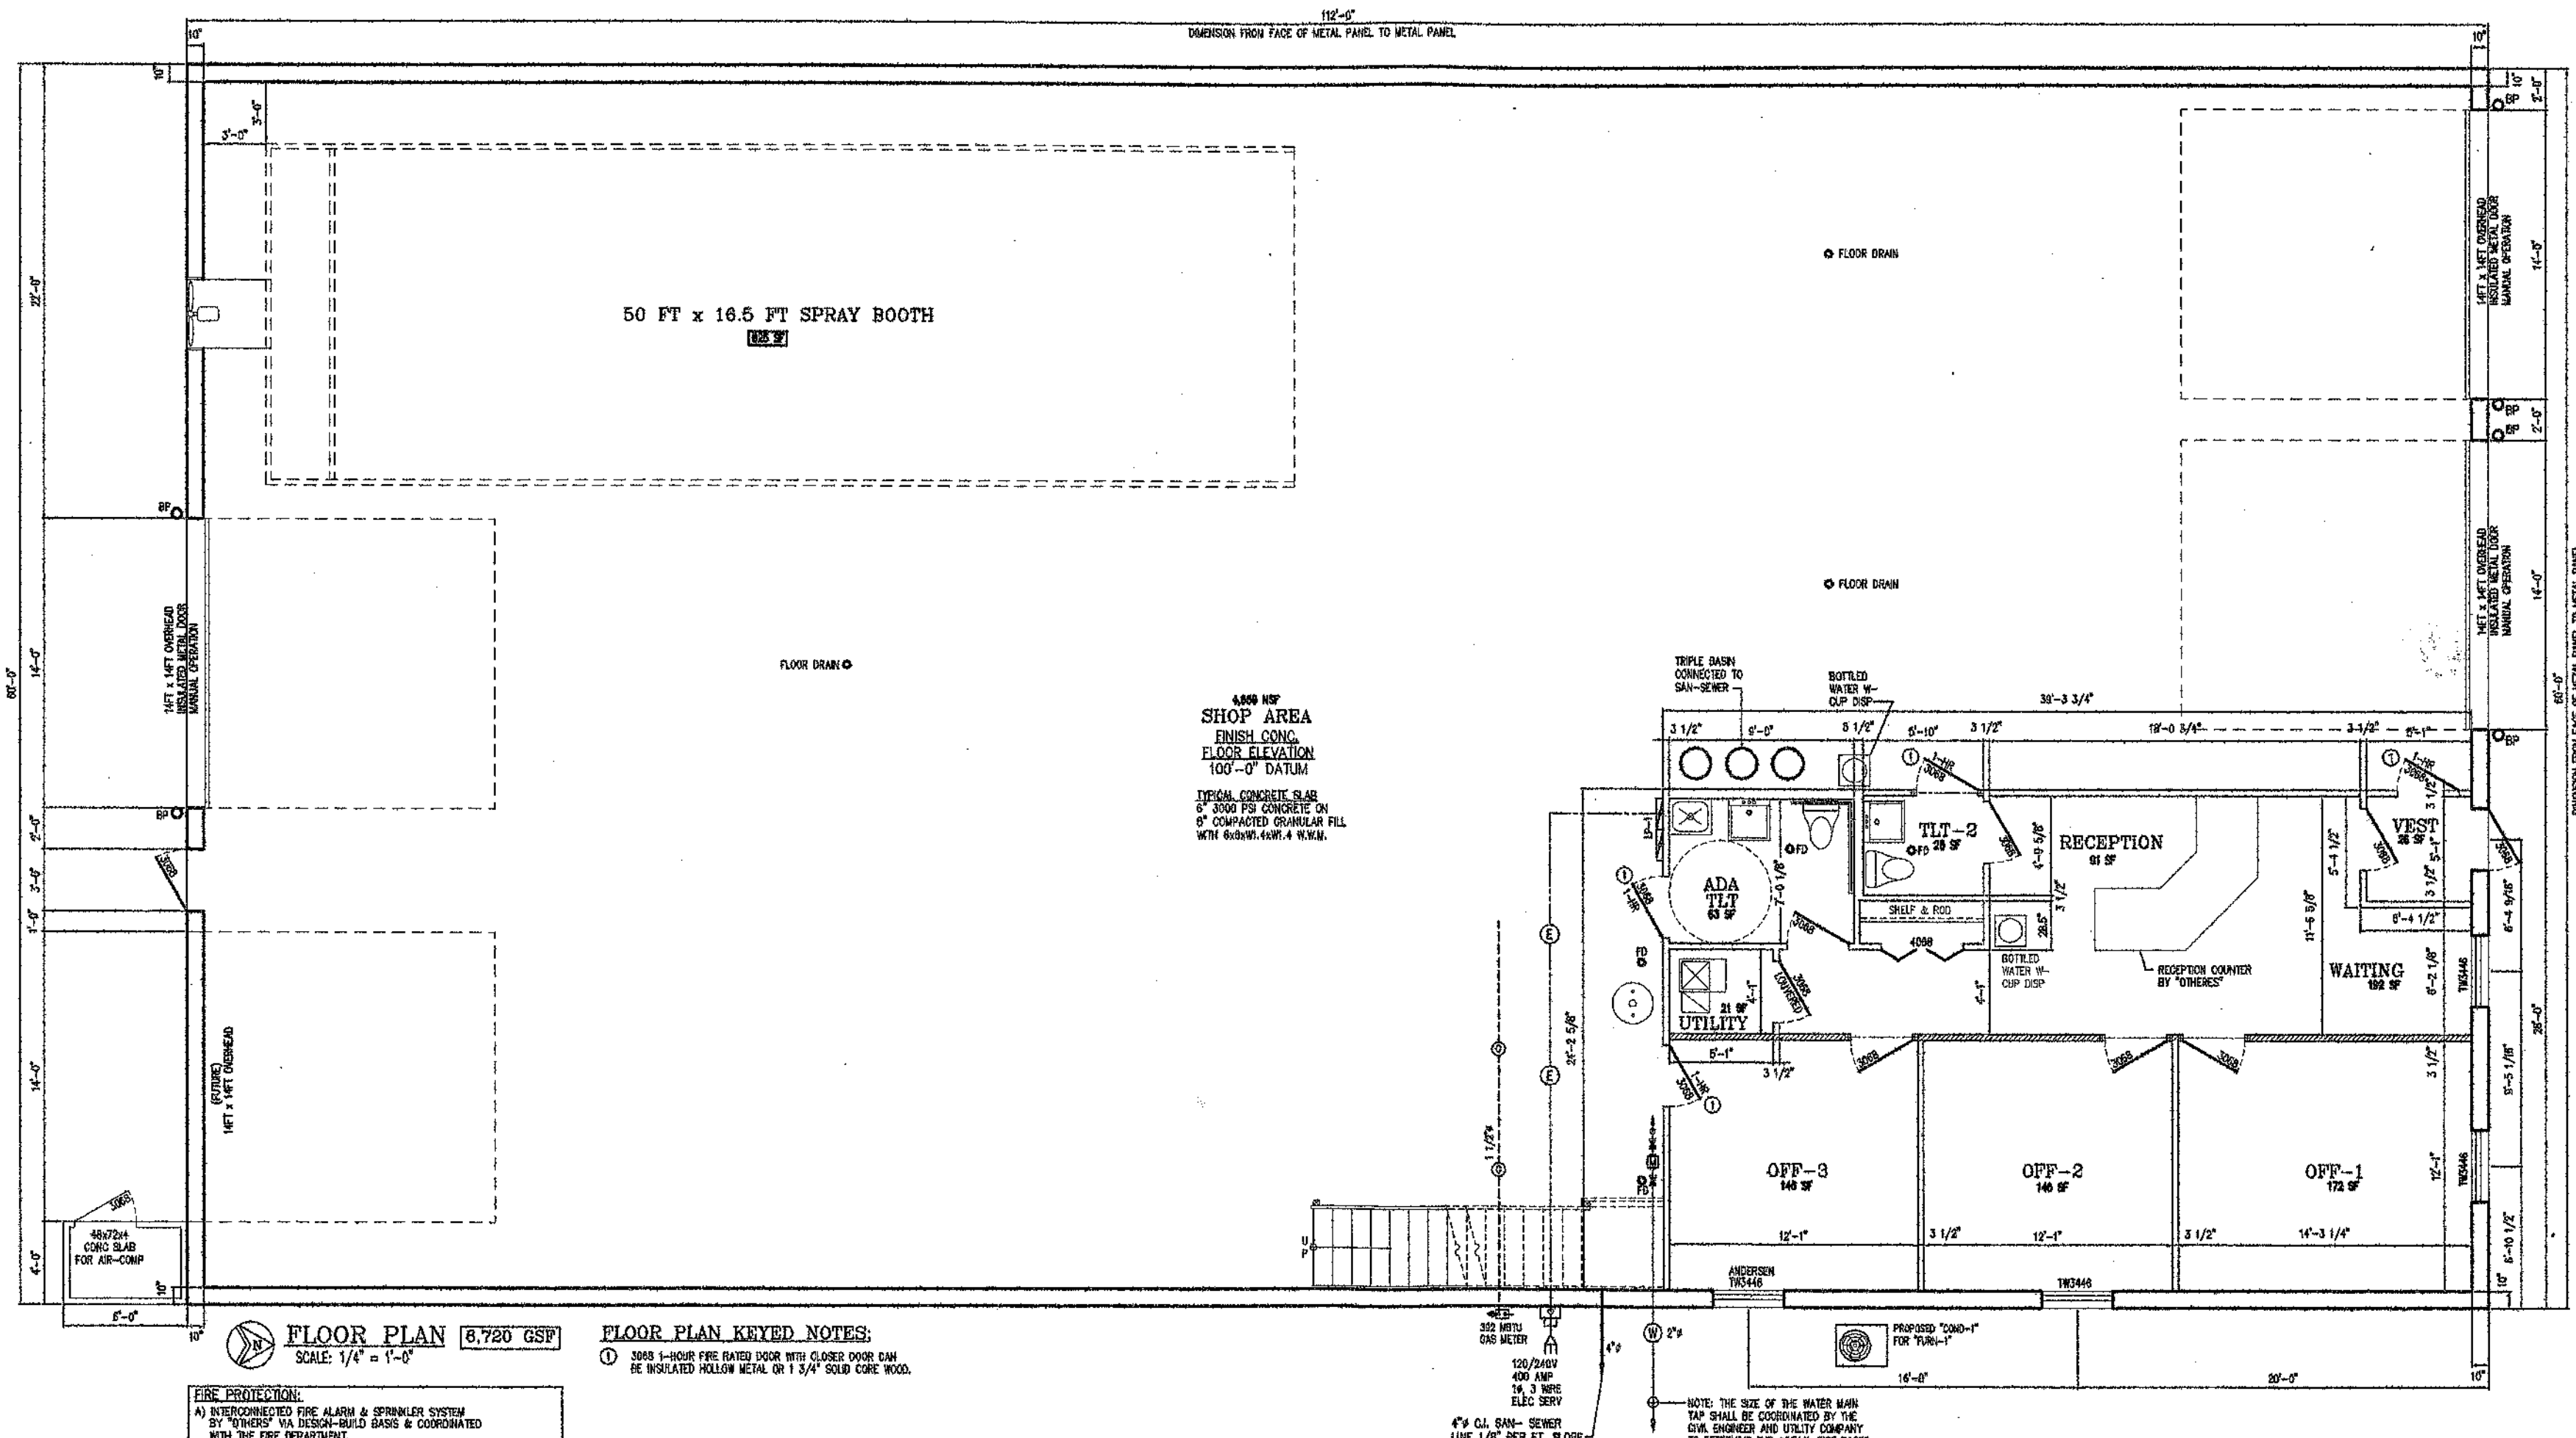

FLOOR PLAN [6,720 GSF]
SCALE: 1/4" = 1'-0"

FLOOR PLAN KEYED NOTES:

(1) 3068 1-HOUR FIRE RATED DOOR WITH CLOSER DOOR CAN BE INSULATED HOLLOW METAL OR 1 3/4" SOLID CORE WOOD.

FIRE PROTECTION:

A) INTERCONNECTED FIRE ALARM & SPRINKLER SYSTEM BY "OTHERS" VIA DESIGN-BUILD BASIS & COORDINATED WITH THE FIRE DEPARTMENT.

B) FIRE EXTINQUISHERS SHALL BE PROVIDED IN ACCORDANCE WITH LOCAL FIRE CODE REQUIREMENTS & COORDINATED WITH THE FIRE DEPT.

CONSTRUCTION ISSUE: 2-22-08

C:\ATLAS-PLANS.DWG

REVISIONS

MASTERSON SZAFASZ & SHAW ARCHITECTURAL GROUP

Jeffrey A. Shaw
RA-NCARB

7623 Oakdale Avenue
Hammond, IN 46324

219.937.0999
Fax 219.937.6977
shaws12@comcast.net

EXPIRES: 12-1-08
DATE: 2-22-08

FLOOR PLAN

PROPOSED OFFICE & BODY SHOP @ 451 WEST MAIN STREET SCHERERVILLE, IN 46375

DATE: 12-6-07
SCALE: AS NOTED
DRAWN: JAS
JOB: ATLAS-101-07
SHEET A3 OF SHEET