


NOTE:
 CONSTRUCT DEMISING WALL W/ MIN.
 3 1/2", 20 GA. METAL STUD @ 24" O.C.
 W/ GYP. BD ON EA. SIDE- MIN. 5/8"
 TYPE 'X' GYP. BD ON TENANT SIDE.

1. CONTRACTOR TO VERIFY ALL DIMENSIONS AND NOTIFY OWNER AND ARCHITECT OF ANY DISCREPANCIES PRIOR TO CONSTRUCTION.
2. ALL DIMENSIONS ARE TO FACE OF FINISH UNLESS OTHERWISE NOTED.

FLOOR PLAN


SCALE: 1/4" = 1'-0"

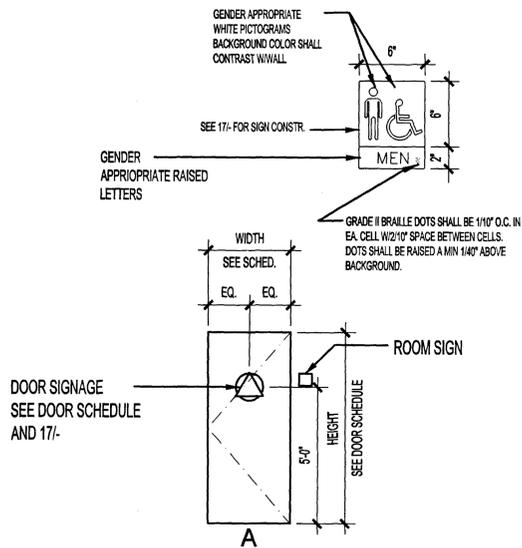

DOOR TYPES

1. ALL GYPSUM BOARD SHEETS ARE TO BE RUN VERTICALLY.
2. NO JOINTS EXCEPT AT STUDS.
3. STUD SIZES SHOWN ARE MINIMUM. LARGER SIZES MAY BE REQUIRED BASED ON HEIGHTS AND LOADING.
4. DRYWALL SCREW EDGE AND FIELD SPACING PER GYPSUM BOARD MANUFACTURER'S RECOMMENDATIONS. ALL SCREWS SHALL PENETRATE STUDS.
5. PENETRATIONS IN FIRE RESISTIVE WALLS SHALL COMPLY WITH SECTIONS 706.6
6. THE CONTRACTOR MUST PROVIDE ICBO NUMBERS FOR METAL STUDS PRIOR TO CONSTRUCTION. CONFIRMATION OF THE STUD GAUGE, SIZE AND ALLOWABLE SPAN IS THE RESPONSIBILITY OF THE CONTRACTOR.
7. GYP. BOARD WALL SURFACES TO HAVE SMOOTH FINISH.

TYPICAL WALL CONSTRUCTION



WALL / SYMBOL LEGEND

NOTE: ALL NEW WALLS WALL TYPE A UNLESS NOTED OTHERWISE

- A 3 5/8", 20 GA. (16 GA. @ WATER HEATER) METAL STUDS @ 16" O.C. WITH 5/8" GYP. BOARD; EACH SIDE TO 6" ABOVE CEILING - SEE DETAIL 20/A5.3
- B DOUBLE ROW OF 3 5/8" 20 GA. METAL STUDS @ 16" O.C. WITH 5/8" GYP. BOARD EACH SIDE TO 6" ABOVE CEILING - SEE DETAIL 16/A5.3
- C 6", 20 GA. METAL STUDS @ 16" O.C. WITH 5/8" GYP. BD. EACH SIDE TO 6" ABOVE CEILING, PLUMBING WALL - SEE DETAIL 20/A5.3

WALL TYPES

- 1 LINE OF SOFFIT OR CEILING ABOVE. SEE REFLECTED CLG. PLAN
- 2 FOOD SERVICE EQUIPMENT. SEE EQUIPMENT PLAN A2.4
- 3 CONFIRM AND COORDINATE DIMENSION WITH SIZE OF EQUIPMENT AT THIS LOCATION.
- 4 AT UN-FINISHED BUILDING SHELL WALLS, PROVIDE 5/8" GYP. BD. TO 6" ABOVE CLG. WITH SMOOTH PAINTED FINISH.
- 5 PROVIDE SOLID BACKING AT WALL MOUNTED EQUIPMENT, SEE 9/A7.1
- 6 30" WIDE, SIDE APPROACH, ACCESSIBLE AREA AT SALES COUNTER.
- 7 STAINLESS STEEL CORNER GUARD, SEE 16/A7.1

KEYNOTES