


4205 W. Atlantic Avenue, Suites #102 & #103
Delray Beach, FL 33445

GENERAL NOTES

- (A) CONTRACTOR SHALL COORDINATE THE ELECTRICAL REQUIREMENTS FOR ALL EQUIPMENT WITH THE EQUIPMENT MANUFACTURER PRIOR TO ROUGH-IN.
- (B) ALL BRANCH CIRCUITS SERVING PATIENT CARE AREAS SHALL BE PROVIDED WITH AN EFFECTIVE GROUNDING SYSTEM, INCLUDING THE PROVISION OF A METAL BACKBONE SYSTEM OF A CABLE HAVING A METALLIC ANCHOR OR SHEATH ASSEMBLY.
- (C) THE GROUNDING TERMINALS OF ALL RECEPTACLES AND ALL NON-CURRENT CARRYING COMPONENT SURFACES OF FIXED ELECTRICAL EQUIPMENT, LIKELY TO BECOME ENERGIZED THAT ARE SUBJECT TO ELECTRICAL SHOCK, SHALL BE CONNECTED TO AN INSULATED COPPER EQUIPMENT GROUNDING CONDUCTOR.

SHEET NOTES

- [illegible]

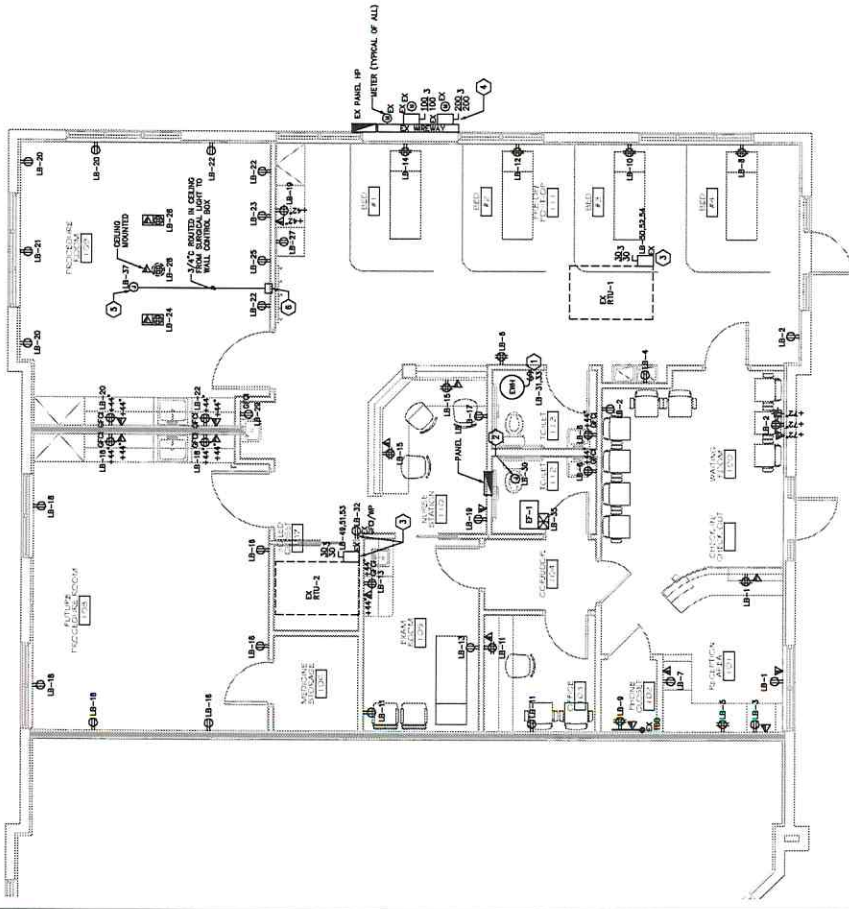

White Locke & Williams
 A COMMUNITY FUND FINANCIAL LLC

18448 OLD PRODUCTION LANE,
 SUITE 200
 TAMPA, FL 33613
 TEL: 813-703-0833
 FAX: 813-350-8173
 WWW.WL&W.COM
 CERTIFICATE OF AUTHORIZATION
 2008

STAMPS SOLD FOR: PRINT
 ORDER# 207-000 DATE: 02/04/2017

EXPIRATION OF RECORD: _____
 ISSUING AGENCY: _____
 FLORIDA LICENSE NO. 33009
 02/04/2017

[illegible]

2	FLOOR PLAN
---	------------

ADAM RYDZEWICZ CITY OF CHICAGO		DATE 2017-08-10	BY E.D.
		DATE 2017-08-10	BY A.R.
		DATE AS NOTED	BY 17-051

DEMOLITION AND FLOOR PLANS

A-1.0

A R Architecture, LLC.
7700 CONGRESS AVE., SUITE #1117
BOCA RATON, FLORIDA 33437
PH 561 241 6376 CELL 305 516 1178
aaron@ar-architecture.com