


Winchester Square


6442 Winchester Blvd
Suite 01130
Former The Mobile Center

CASTO




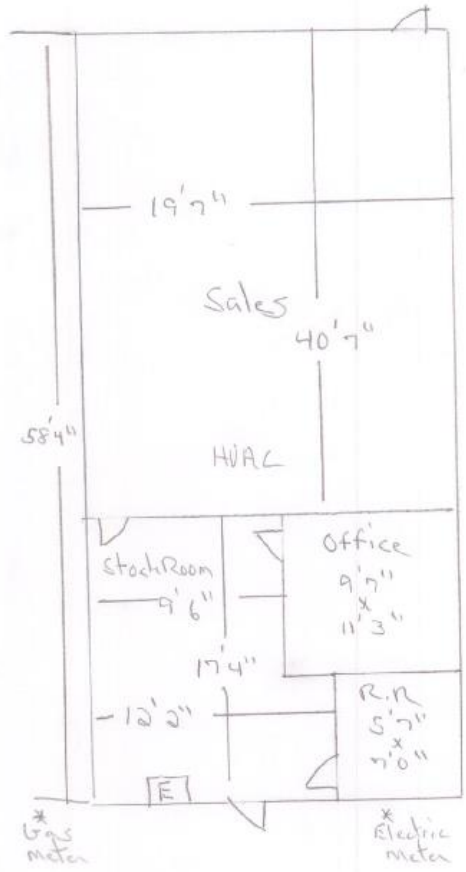



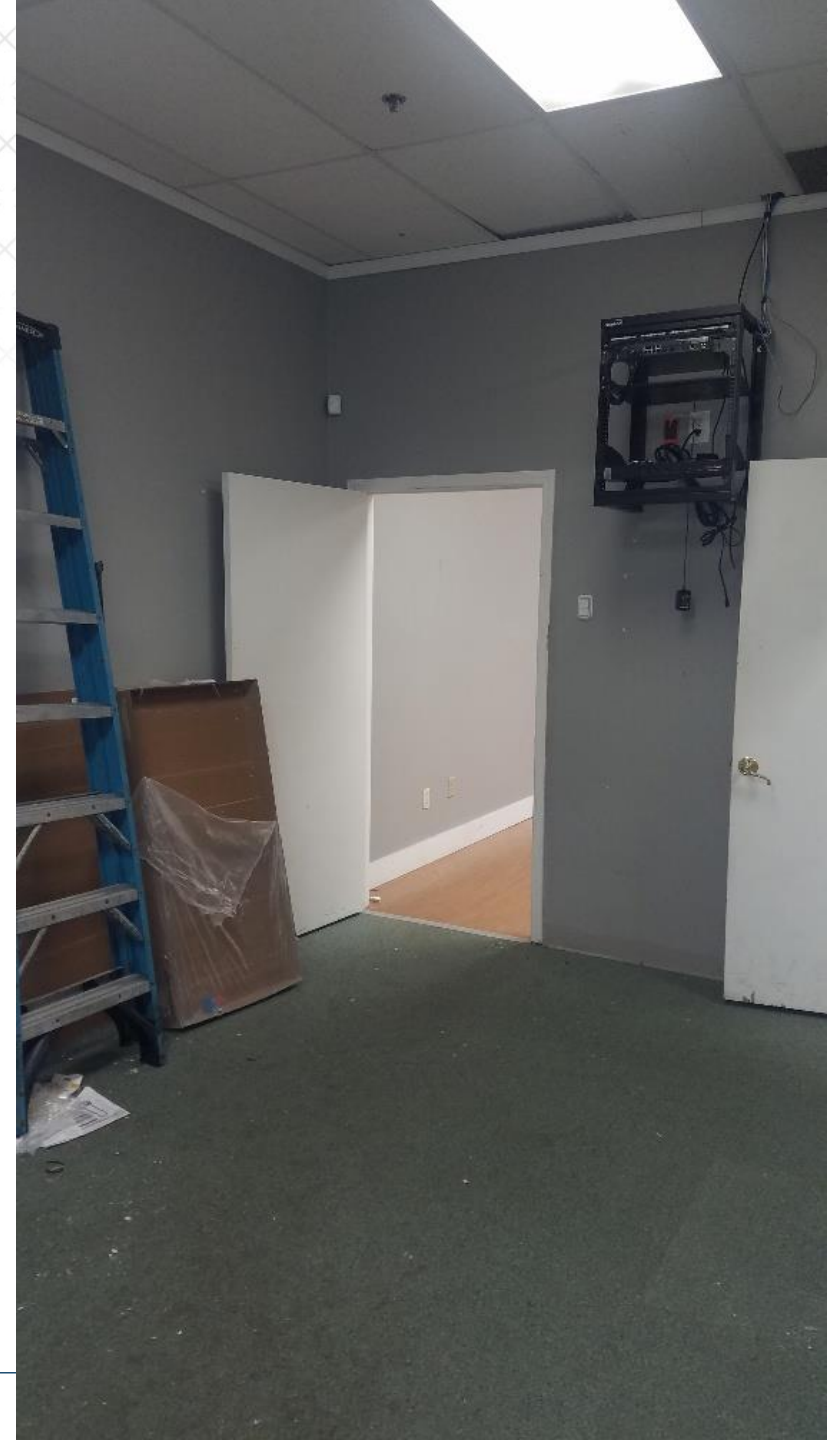



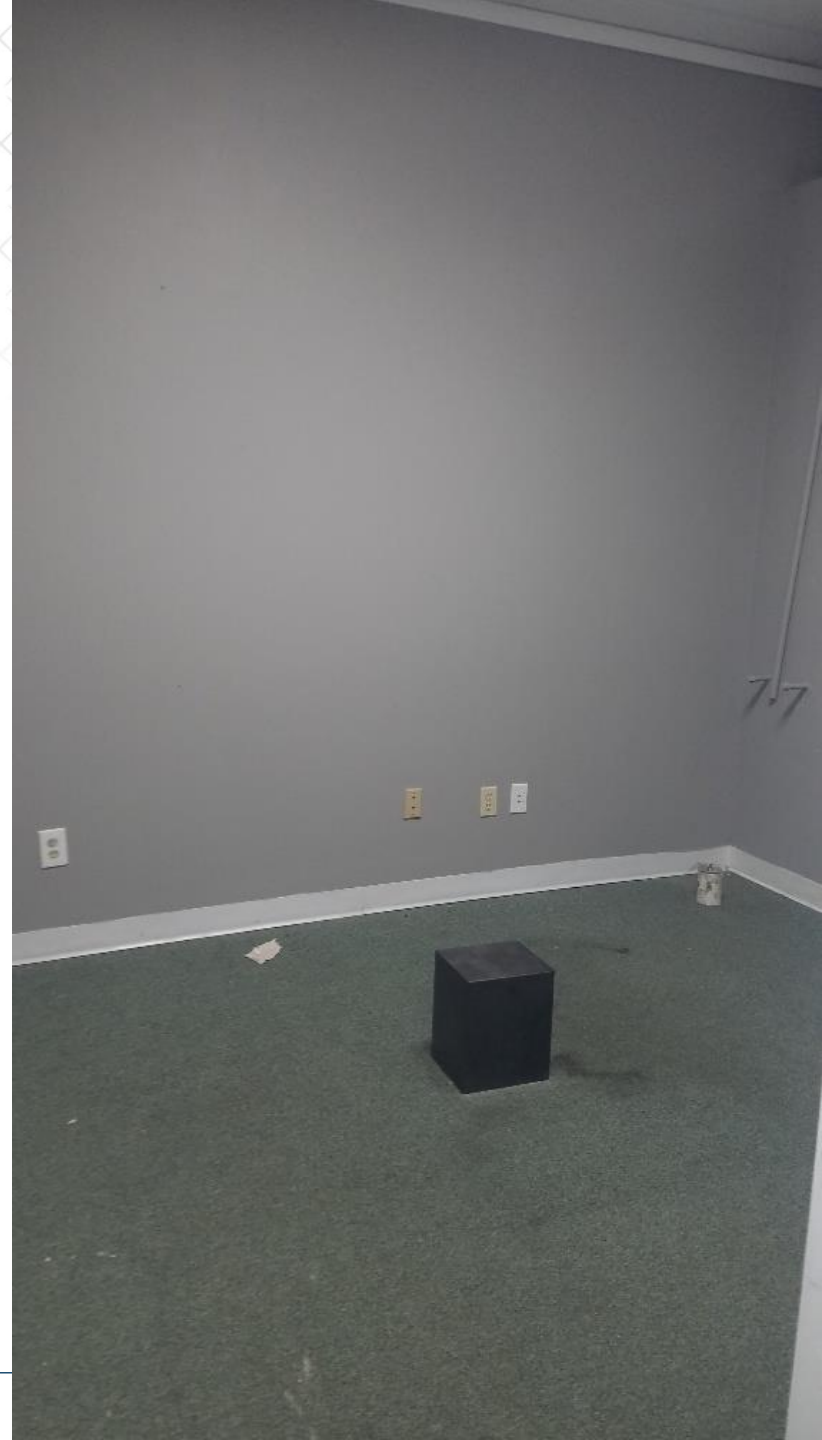



MODEL **48TCEA05A2A5A0A0A0**

SERIAL **1514C60176**

FACTORY CHARGED

TS AC	PH	HZ	RLA	LRA	REF. SYSTEM R-410A	TEST
230	3	60	13.7	83	11 LBS 5.0 kg	HI 65
						LO 45
TS AC	PH	HZ	FLA	CHARGE SYSTEM PER INSTALLATION INSTRUCTIONS FOR OUTDOOR INSTALLATION OF COMBINATION COOLING AND HEATING		
230	1	60	1.5			
230	3	60	5.2			
230	1	60	0.48			
POWER SUPPLY					PERMISS	
			208/230	3	60	253
			VOLTS PH		HZ	
VOLTS	PH	HZ	ACCESSORY POWER EXHAUST FLA	MINIMUM CIRCUIT AMPS	MAX FUSE OR HACR BREAKER PER NEC	MAXIMUM OVERCURRENT PROTECTION DEVICE
				24	30	-
208/230	1	60	1.9	26	30	-/-

CONTROL PANEL SCCR: 5kA RMS SYMMETRICAL VOLTAGE 253 MA

MINIMUM CLEARANCE TO COMBUSTIBLE MATERIALS

TOP	BOTTOM		SIDES	
N. 0 MM.	1 IN	25 MM.	0 IN	0 MM.
N. 0 MM.	1 IN	25 MM.	0 IN	0 MM.

INSTALLATION ON COMBUSTIBLE FLOORING OR CLASS A, B, OR C ROOFING MATERIAL (457mm) WITH ACCESSORY FLUE DISCHARGE DEFLECTOR



