




OVERALL PLAN - 1ST FLOOR
SES CONSTRUCTION AND ENVIRONMENTAL, LLC
SECOND FLOOR BUILD-OUT
OAK RIDGE, TN

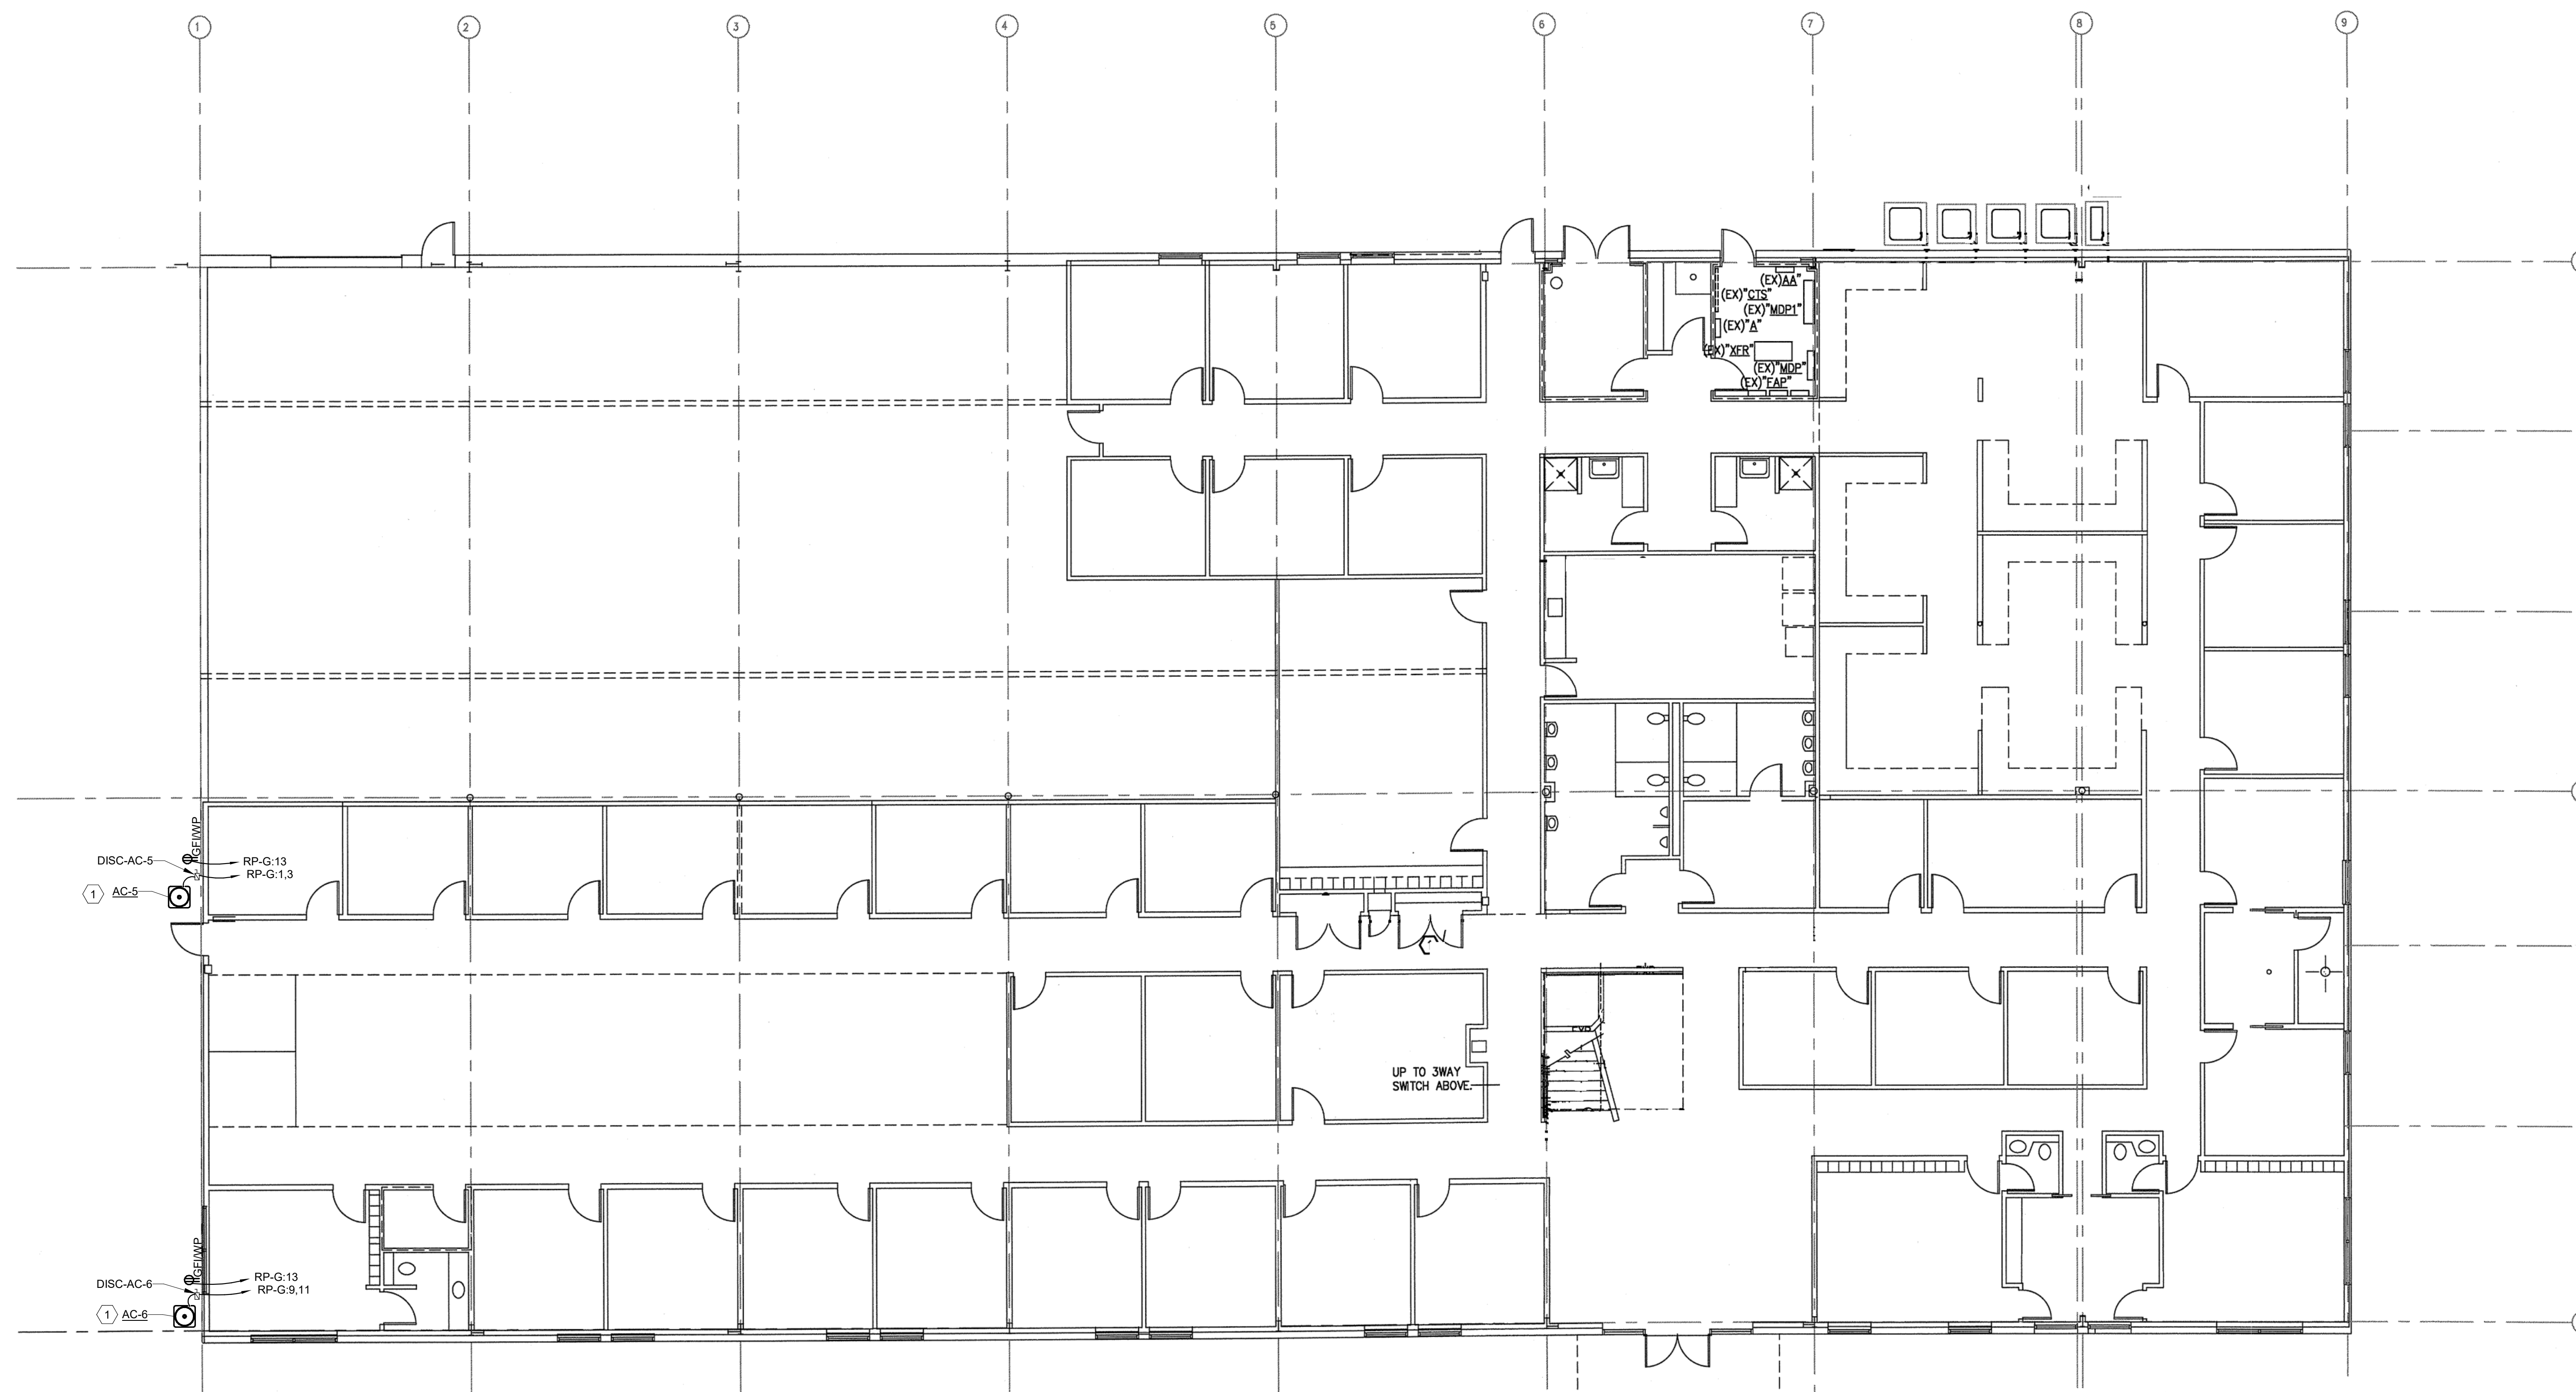

1 OVERALL PLAN - 1ST FLOOR
E-101
SCALE: 1/8" = 1'-0"

GENERAL NOTES

1. PROVIDE (2) #12, 1 #12G IN 3/4" CONDUIT FOR SINGLE POLE CIRCUITS UNLESS OTHERWISE NOTED.
2. MOUNT DEVICES PER DETAIL 4/E-501 UNLESS OTHERWISE NOTED.
3. COORDINATE WITH OTHER TRADES TO ENSURE THAT INSTALLATION MEETS ALL CLEARANCES AND WORKING SPACE REQUIREMENTS SPECIFIED BY NFPA 70.
4. DISCONNECTS SERVING HVAC EQUIPMENT SHOWN. REFER TO EQUIPMENT SCHEDULES ON SHEET E-301 FOR DISCONNECT SIZING. BRANCH CIRCUITS SERVING HVAC EQUIP SHALL BE (3) #10, 1 #10G IN 3/4" C

KEYED NOTES

1. PROVIDE COMMUNICATION WIRING BETWEEN CONDENSING UNIT AND AIR HANDLING UNIT LOCATED IN MECHANICAL ROOM (RM. 249) REFER TO DETAIL 2/E-501 FOR ADDITIONAL WIRING INFORMATION.

REV.	DR.	CHK.	DATE	DESCRIPTION
0			09-03-19	ISSUED FOR CONSTRUCTION