
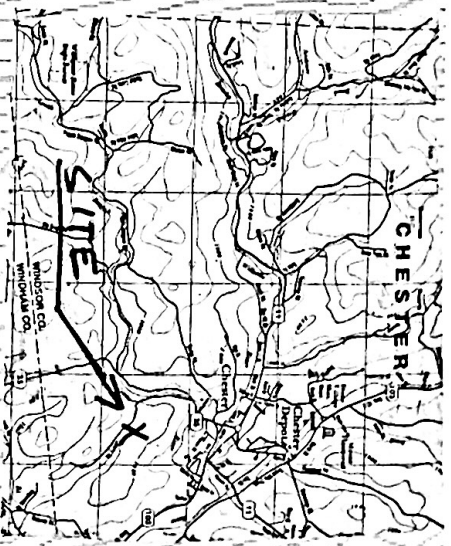


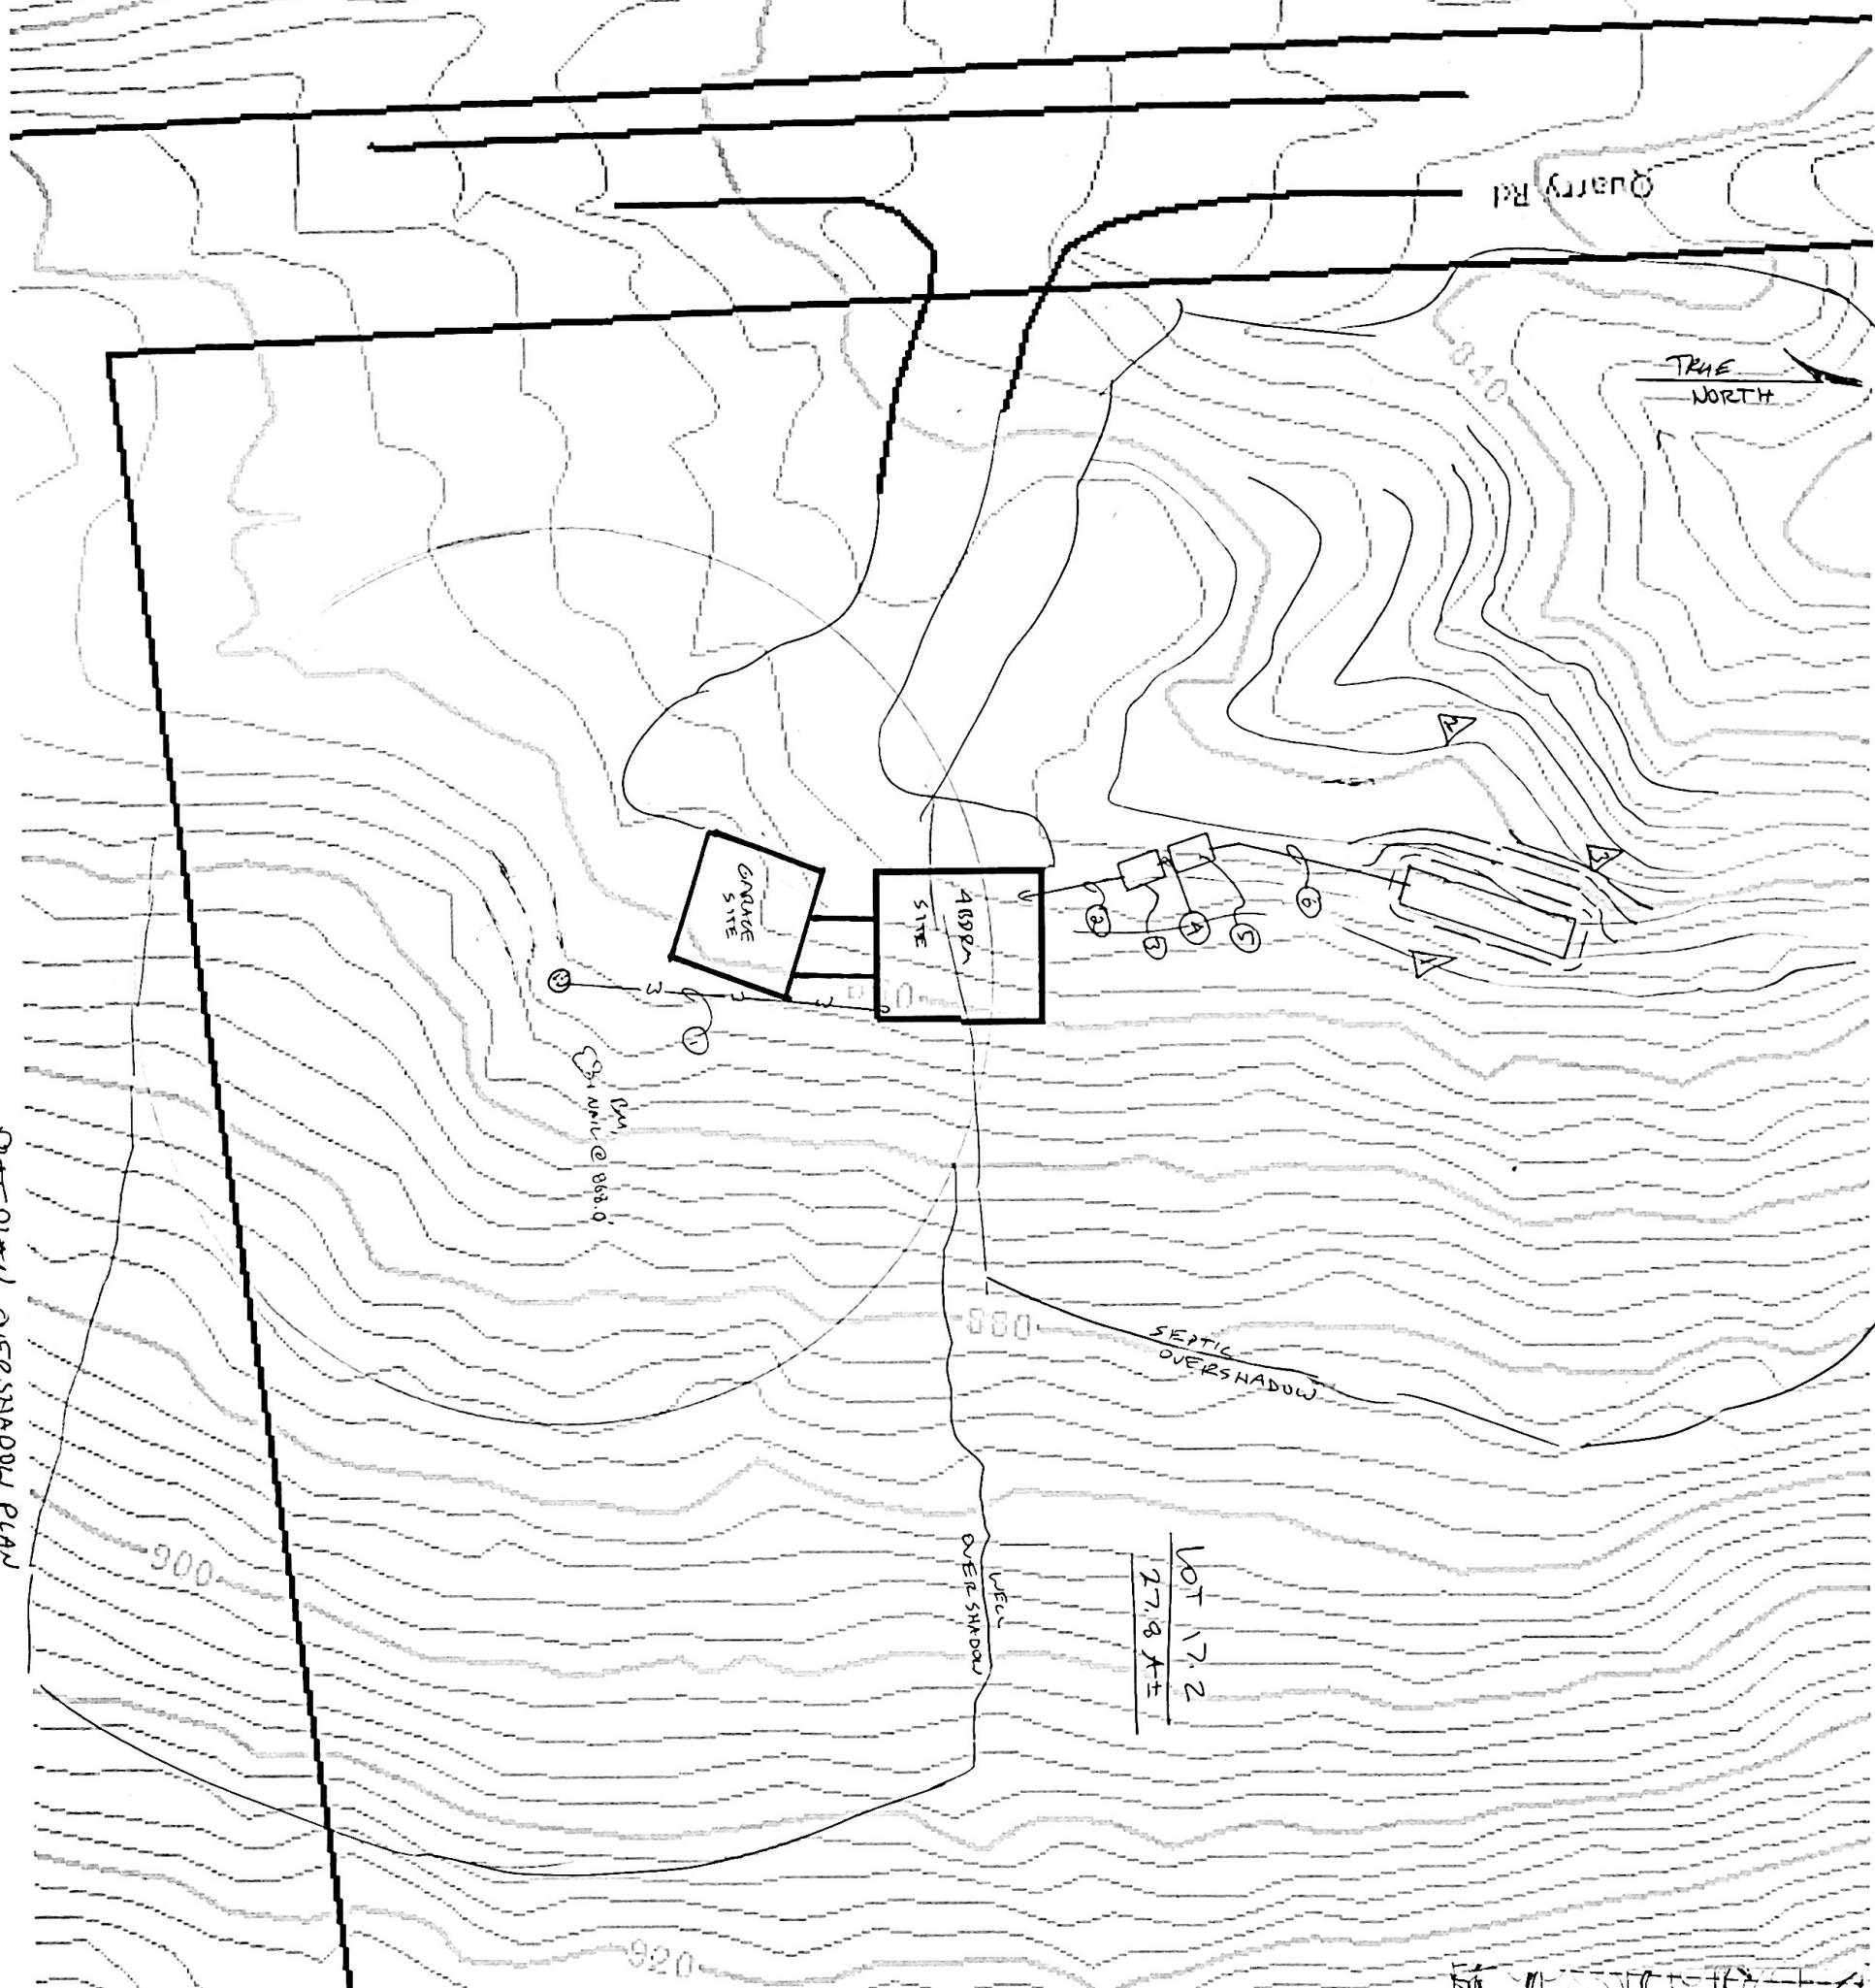

SYMBOL LEGEND

- 1. 1" WATERLINE, 160 PSI, 5'-6" DEEP
- 2. 4" 40' PVC SEWER PIPE
- 3. 1000 GAL TANK, SEE DETAIL
- 4. 4" SDR-35, SOLID
- 5. 1000 GAL PUMP TK, SEE DETAIL
- 6. 1 1/2" FORCE MAIN, 54x40

DESIGN CRITERIA

PIT	DATE	SIZE	TYPE	COMMENTS
1.	8-15-22	8'x8'	CONCRETE	
2.	8-15-22	8'x8'	CONCRETE	
3.	8-15-22	8'x8'	CONCRETE	
4.	8-15-22	8'x8'	CONCRETE	
5.	8-15-22	8'x8'	CONCRETE	
6.	8-15-22	8'x8'	CONCRETE	
7.	8-15-22	8'x8'	CONCRETE	
8.	8-15-22	8'x8'	CONCRETE	
9.	8-15-22	8'x8'	CONCRETE	
10.	8-15-22	8'x8'	CONCRETE	

WATER SUPPLY DESIGN BASIS

ADD: 400 GPD
MDD: 0.000 GPD
IPI: 5 GPM

GPS DATA

LOT CENTER: 43.25080° 72.60010°
SEPTIC: 43.24957° 72.60160°
WELL: 43.24924° 72.60152°

PLOT PLAN, OVERSHADOW PLAN

LOT 17.2, 27.8 A±

SCALE: 0 20 40 FEET

WATER SUPPLY & WASTEWATER PLAN

DES: PAUL LAMON
DRAWN: PAUL LAMON
CHECKED: PAUL LAMON
DATE: 8-15-22

WINDHAM CO. VERMONT