

Division of Industry Services

in accordance with SPS 385, Wis.Adm.Code

Attach complete site plan on paper not less than 8 1/2 x 11" in size. Plan must include, but not limited to: vertical and horizontal reference point (BM), direction and % slope, scale or dimensions, north arrow, location & distance to nearest road.

Please print all information

Personal information you provide may be used for secondary purposes (Privacy Law, s.15.04(1)(m)).

County	DODGE
Parcel I.D.	026-0916-2613-000
Reviewed by	Date

Property Owner CRAWFISH ROAD LLC			Property Location SW 1/4, NE 1/4, S 26, T 9 N, R 16 E		
Property Owner's Mailing Address W996 HARDING RD			Site Address or CSM and Lot #:		
City RUBICON, WI 53078	State	Zip Code	Phone Number	☐ City LEBANON	☒ Town CRAWFISH RD

☒ New Construction Use: ☒ Residential/No. bedrooms 4 Code derived design flow rate: 600 GPD

☐ Replacement ☐ Public or commercial- Describe: _____

Parent Material: LOESS, GLACIAL TILL Flood Plain elevation if applicable: _____ Unknown

General comments
and recommendations: PROPOSED SYSTEM SIZED FOR 4 BEDROOMS
MINIMUM 14" OF MOUND SAND REQUIRED
CHISEL PLOW TO 12" TO BREAK UP WEAK STRUCTURE

[illegible][illegible]

*Effluent #1 = $\text{BOD}_5 > 30 \leq 220 \text{ mg/L}$ and $\text{TSS} > 30 \leq 150 \text{ mg/L}$.

*Effluent #2 = $\text{BOD}_5 \leq 30 \text{ mg/L}$ and $\text{TSS} \leq 30 \text{ mg/L}$

CST Name	CLAY VANDERLEEST
Address	N7803 TOPPE RD WATERLOO, WI 53594

Signature: 
Date Evaluation Conducted: 9/29/2025

CST Number 1190689
SP-121100003
Telephone No. (608) 509-2855
SBD-8330(R03/22)

Property Owner: CRAWFISH ROAD LLC

Parcel ID: 026-0916-2613-000

Page 2 of 3

Boring ☐ Boring
☒ Pit
 13 # Ground surface elev. 875.34 Depth to limiting factor 23 in. / elev. 873.42 ft.

Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr.Sz.Sh.	Consistence (Moist)	Boundary	Roots	Soil Application Rate GPD/ft ²	
									*Eff#1	*Eff#2
Ap	0-12	10YR3/2		sil	1msbk	fr	as	2f	0.4	0.6
Bt1	12-23	10YR4/4		sicl	2fsbk	fi	cs	1f	0.4	0.6
Bt2	23-32	10YR4/4	c2d10YR5/8 6/3	sicl	1fsbk	fi	cs	1f	0.2	0.3
C	32-50	10YR4/4	m2d10YR5/8 6/2	sicl	0mass	fi			0	0

Boring ☐ Boring
☒ Pit
 # Ground surface elev. Depth to limiting factor N/A in. / elev. N/A ft.

Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr.Sz.Sh.	Consistence (Moist)	Boundary	Roots	Soil Application Rate GPD/ft ²	
									*Eff#1	*Eff#2



Boring ☐ Boring
☒ Pit
 # Ground surface elev. Depth to limiting factor N/A in. / elev. N/A ft.

Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr.Sz.Sh.	Consistence (Moist)	Boundary	Roots	Soil Application Rate GPD/ft ²	
									*Eff#1	*Eff#2

*Effluent #1 = BOD₅ > 30 ≤ 220 mg/L and TSS > 30 ≤ 150 mg/L*Effluent #2 = BOD₅ ≤ 30 mg/L and TSS ≤ 30 mg/L


CRAWFISH ROAD LLC

PAGE 3 OF 3
40.317 ACRES

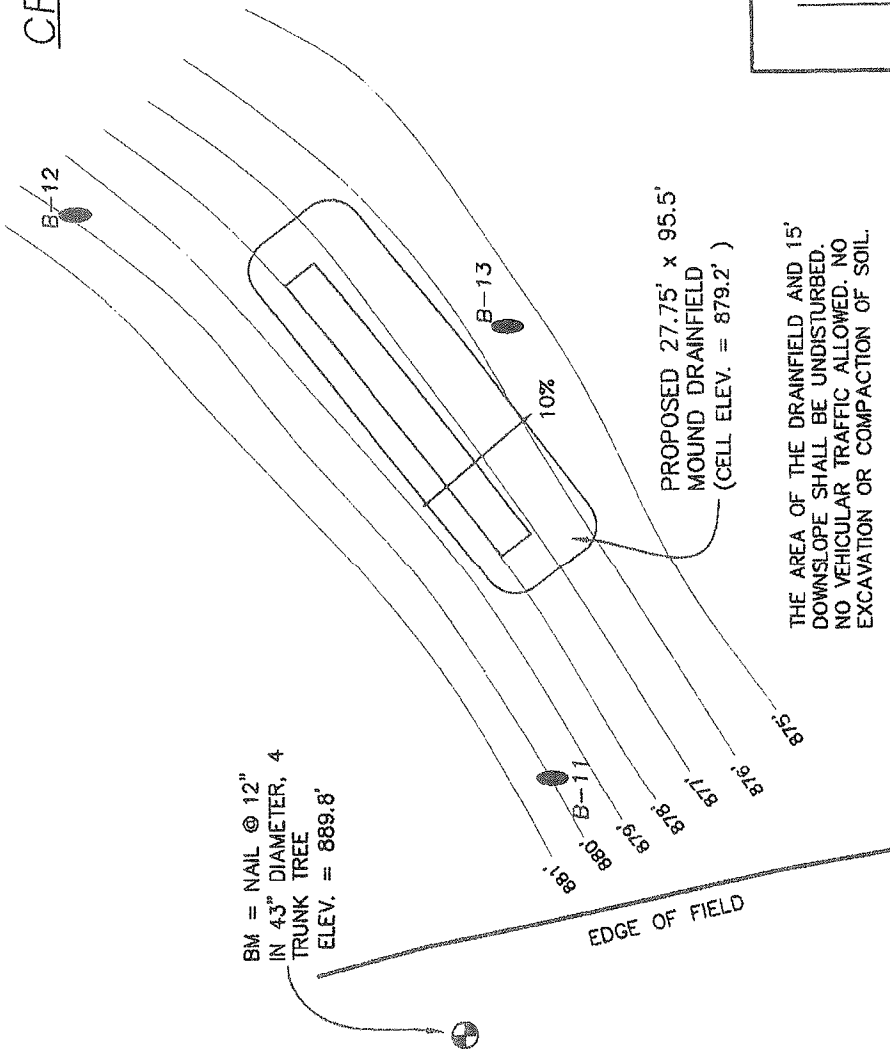

THE AREA OF THE DRAINFIELD AND 15' DOWNSLOPE SHALL BE UNDISTURBED. NO VEHICULAR TRAFFIC ALLOWED. NO EXCAVATION OR COMPACTION OF SOIL.

Scale: 1"=40'




- * Elevations are for Soil Test Use Only
- * This is Not a Survey
- * Property Lines Per Owner or County GIS Website
- * Property Lines Need to be Identified Prior to Installation

APPROX. LOT LINE

CRAWFISH ROAD R/W

LOCATION MAP
1" = 400'

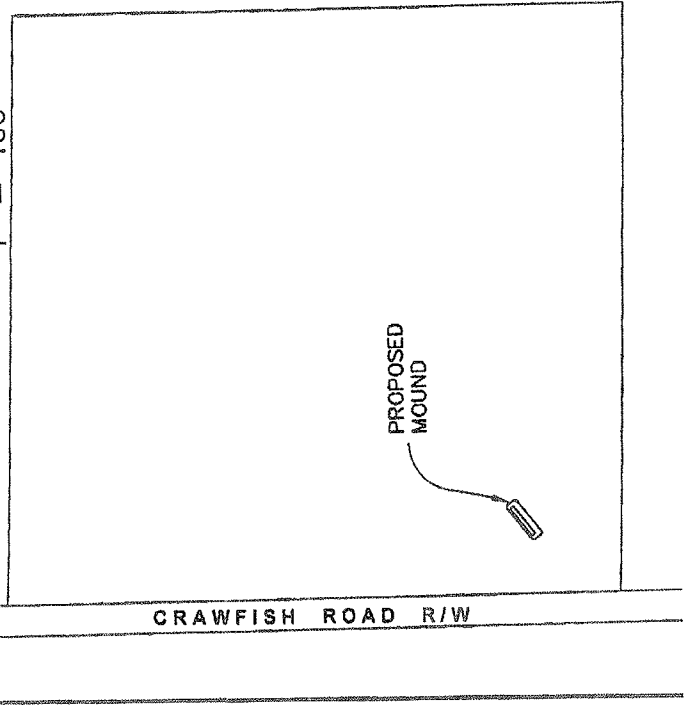

Division of Industry Services

in accordance with SPS 385, Wis. Adm. Code

Attach complete site plan on paper not less than 8 1/2 x 11" in size. Plan must include, but not limited to: vertical and horizontal reference point (BM), direction and % slope, scale or dimensions, north arrow, location & distance to nearest road.

Please print all information

Personal information you provide may be used for secondary purposes (Privacy Law, s. 15.04(1)(m)).

County	DODGE
Parcel I.D.	026-0916-2642-000
Reviewed by	Date

Property Owner CRAWFISH ROAD LLC	Property Location NW 1/4, SE 1/4, S 26, T 9 N, R 16 E
Property Owner's Mailing Address W996 HARDING RD	Site Address or CSM and Lot #:
City State Zip Code RUBICON, WI 53078	Phone Number City ☐ Town ☒ Nearest Road LEBANON CRAWFISH RD

☒ New Construction Use: ☒ Residential/No. bedrooms 4 Code derived design flow rate: 600 GPD

☐ Replacement ☐ Public or commercial- Describe: Flood Plain elevation if applicable Unknown

Parent Material: LOESS, GLACIAL TILL

General comments and recommendations: PROPOSED SYSTEM SIZED FOR 4 BEDROOMS
MINIMUM 14" OF MOUND SAND REQUIRED
CHISEL PLOW TO 12" TO BREAK UP WEAK STRUCTURE

Boring #		☐ Boring ☒ Pit		Ground surface elev.	Depth to limiting factor	22 in. / elev.		854.67 ft.	Soil Application Rate	
									GPD/ft ²	
Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr. Sz. Sh.	Consistence (Moist)	Boundary	Roots	*Eff#1	*Eff#2
Ap	0-12	10YR3/2		sil	1msbk	fr	as	2f	0.4	0.6
Bt	12-22	10YR4/4		sicl	2fsbk	fi	cs	1f	0.4	0.6
Cg	22-46	2.5Y5/4	m2d10YR6/6 6/2	cl	0mass	fi			0	0

Boring #		☐ Boring ☒ Pit		Ground surface elev.	Depth to limiting factor	38 in. / elev.		853.29 ft.	Soil Application Rate	
									GPD/ft ²	
Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr. Sz. Sh.	Consistence (Moist)	Boundary	Roots	*Eff#1	*Eff#2
Ap	0-12	10YR3/2		sil	2mgr	fr	as	2f	0.6	0.8
E	12-16	10YR5/4		sil	2fsbk	fr	cs	1f	0.6	0.8
Bt1	16-29	10YR4/4		sicl	2fsbk	fi	cs	1f	0.4	0.6
Bt2	29-38	10YR4/4		sicl	1fsbk	fi	cw	1f	0.2	0.3
C	38-50	10YR4/6	c2f10YR5/8 6/3	scl	0mass	fi			0	0

*Effluent #1 = BOD₅ > 30 ≤ 220 mg/L and TSS > 30 ≤ 150 mg/L*Effluent #2 = BOD₅ ≤ 30 mg/L and TSS ≤ 30 mg/L

CST Name	CLAY VANDERLEEST	Signature:	CST Number 1190689
Address	N7803 TOPPE RD WATERLOO, WI 53594	Date Evaluation Conducted: 9/29/2025	SP-121100003 Telephone No. (608) 509-2855
			SBD-8330(R03/22)

Property Owner: CRAWFISH ROAD LLC

Parcel ID: 026-0916-2642-000

Page 2 of 3

Boring ☐ Boring
☒ Pit

Ground surface elev. 853.71 Depth to limiting factor 23 in. / elev. 851.79 ft.

Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr.Sz.Sh.	Consistence (Moist)	Boundary	Roots	Soil Application Rate GPD/ft ²	
									*Eff#1	*Eff#2
Ap	0-11	10YR3/2		sil	2mgr	fr	as	2f	0.6	0.8
E	11-15	10YR5/4		sil	2fsbk	fr	cs	1f	0.6	0.8
Bt	15-23	10YR4/4		sicl	2fsbk	fi	cs	1f	0.4	0.6
C	23-44	10YR4/4	c2d10YR5/8 6/2	sicl	0mass	fi			0	0

Boring ☐ Boring
☒ Pit

Ground surface elev. Depth to limiting factor N/A in. / elev. N/A ft.

Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr.Sz.Sh.	Consistence (Moist)	Boundary	Roots	Soil Application Rate GPD/ft ²	
									*Eff#1	*Eff#2

Boring ☐ Boring
☒ Pit

Ground surface elev. Depth to limiting factor N/A in. / elev. N/A ft.

Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr.Sz.Sh.	Consistence (Moist)	Boundary	Roots	Soil Application Rate GPD/ft ²	
									*Eff#1	*Eff#2


*Effluent #1 = BOD₅ > 30 ≤ 220 mg/L and TSS > 30 ≤ 150 mg/L*Effluent #2 = BOD₅ ≤ 30 mg/L and TSS ≤ 30 mg/L

CRAWFISH ROAD LLC

PAGE 3 OF 3


39.877 ACRES

CRAWFISH ROAD R/W

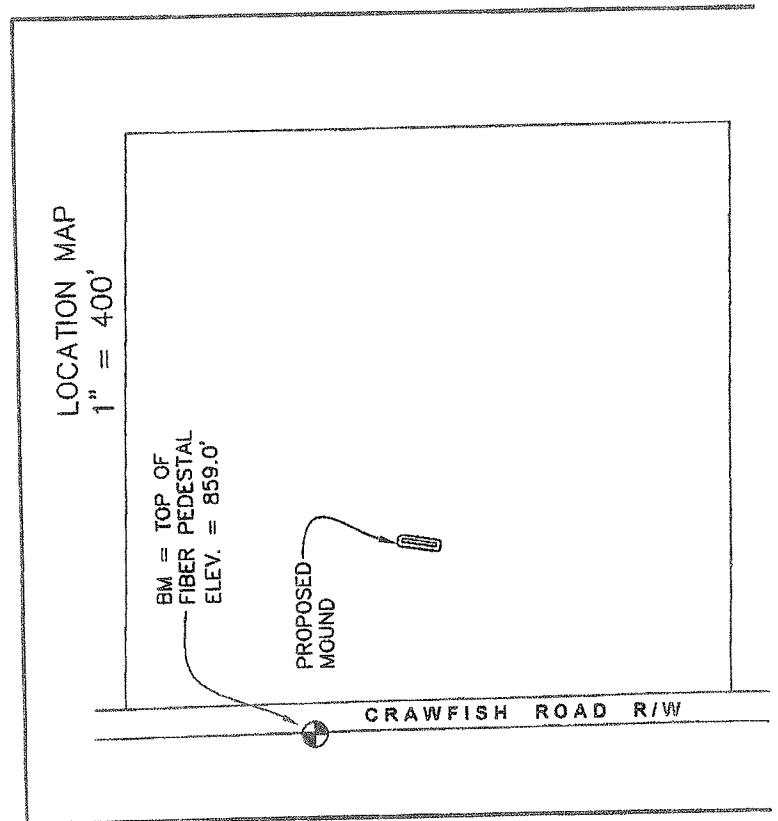

PROPOSED 24.75' x 94'
MOUND DRAINFIELD
(CELL ELEV. = 857.2')

THE AREA OF THE DRAINFIELD AND 15'
DOWNSLOPE SHALL BE UNDISTURBED.
NO VEHICULAR TRAFFIC ALLOWED. NO
EXCAVATION OR COMPACTION OF SOIL.

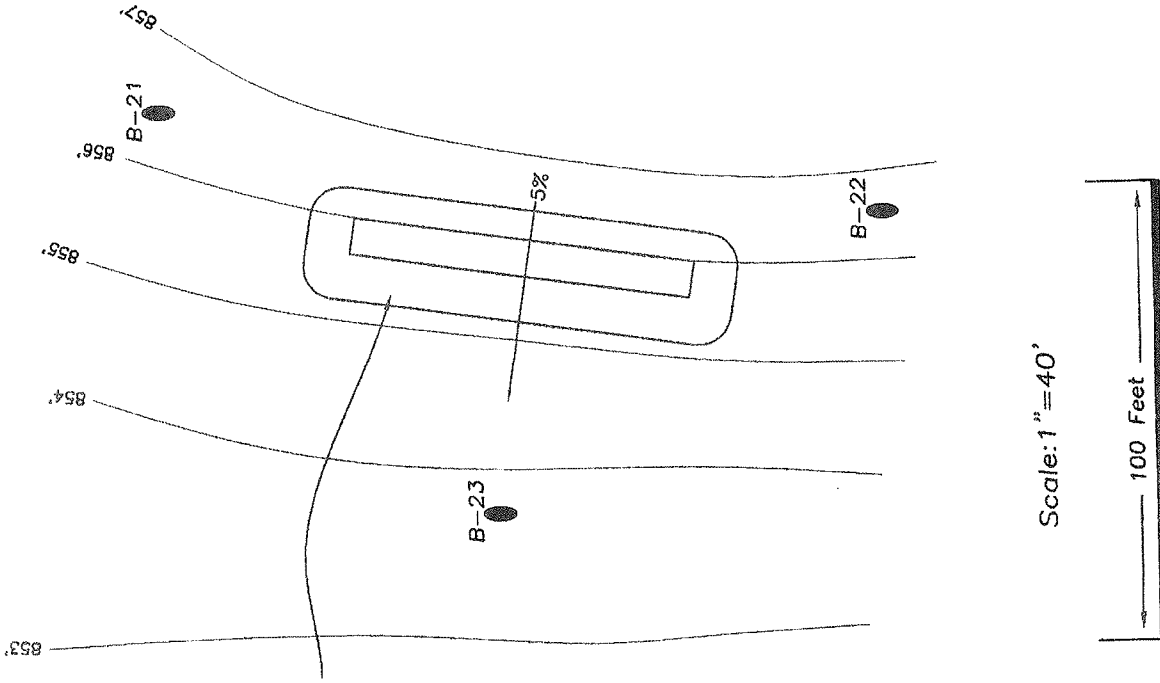

- * Elevations are for Soil Test Use Only
- * This is Not a Survey
- * Property Lines Per Owner or County GIS Website
- * Property Lines Need to be Identified Prior to Installation

Division of Industry Services

in accordance with SPS 385, Wis. Adm. Code

Attach complete site plan on paper not less than 8 1/2 x 11" in size. Plan must include, but not limited to: vertical and horizontal reference point (BM), direction and % slope, scale or dimensions, north arrow, location & distance to nearest road.

Please print all information

Personal information you provide may be used for secondary purposes (Privacy Law, s. 15.04(1)(m)).

County	DODGE
Parcel I.D.	026-0916-2643-000
Reviewed by	Date

Property Owner CRAWFISH ROAD LLC				Property Location SW 1/4, SE 1/4, S 26, T 9 N, R 16 E			
Property Owner's Mailing Address W996 HARDING RD				Site Address or CSM and Lot #:			
City	State	Zip Code	Phone Number	☐ City	☒ Town	Nearest Road	
RUBICON, WI		53078			LEBANON	CRAWFISH RD	

☒ New Construction	Use: ☒ Residential/No. bedrooms	4	Code derived design flow rate:	600 GPD
☐ Replacement	☐ Public or commercial- Describe:			
Parent Material:	LOESS, GLACIAL TILL		Flood Plain elevation if applicable	Unknown
General comments and recommendations:	PROPOSED SYSTEM SIZED FOR 4 BEDROOMS MINIMUM 12" OF MOUND SAND REQUIRED CHISEL PLOW TO 12" TO BREAK UP WEAK STRUCTURE			

Boring ☐ Boring									Soil Application Rate	
31	#	☒ Pit	Ground surface elev.	855.77	Depth to limiting factor	36 in. / elev.	852.77 ft.		GPD/ft ²	
Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr. Sz. Sh.	Consistence (Moist)	Boundary	Roots	*Eff#1	*Eff#2
Ap	0-11	10YR3/2		sil	1msbk	fr	as	2f	0.4	0.6
Bt1	11-23	7.5YR4/4		cl	2msbk	fi	cs	1f	0.4	0.6
Bt2	23-36	10YR4/6		scl	1msbk	fi	cs	1f	0.2	0.3
C	36-51	10YR4/3	f1d10YR5/8 6/2	cl	0mass	fi			0	0

Boring ☐ Boring									Soil Application Rate	
32	#	☒ Pit	Ground surface elev.	855.78	Depth to limiting factor	24 in. / elev.	853.78 ft.		GPD/ft ²	
Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr. Sz. Sh.	Consistence (Moist)	Boundary	Roots	*Eff#1	*Eff#2
Ap	0-11	10YR3/2		sil	2mgr	fr	as	2f	0.6	0.8
Bt	11-24	7.5YR4/4		cl	2msbk	fi	cs	1f	0.4	0.6
C	24-38	10YR4/3	f1d10YR5/8 6/2	cl	0mass	fi			0	0

*Effluent #1 = BOD₅ > 30 ≤ 220 mg/L and TSS > 30 ≤ 150 mg/L*Effluent #2 = BOD₅ ≤ 30 mg/L and TSS ≤ 30 mg/L

CST Name CLAY VANDERLEEST
Address N7803 TOPPE RD
WATERLOO, WI 53594

Signature:

Date Evaluation Conducted: 9/29/2025

CST Number 1190689

SP-121100003

Telephone No. (608) 509-2855

SBD-8330(R03/22)

Property Owner: CRAWFISH ROAD LLC

Parcel ID: 026-0916-2643-000

Page 2 of 3

Boring ☐ Boring
☒ Pit
 33 # Ground surface elev. 852.67 Depth to limiting factor 33 in. / elev. 849.92 ft.

Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr.Sz.Sh.	Consistence (Moist)	Boundary	Roots	Soil Application Rate GPD/ft ²	
									*Eff#1	*Eff#2
Ap	0-12	10YR3/2		sil	2mgr	fr	as	2f	0.6	0.8
E	12-15	10YR5/4		sil	2fsbk	fr	cs	1f	0.6	0.8
Bt1	15-26	10YR4/4		sicl	1fsbk	fi	cw	1f	0.2	0.3
Bt2	26-33	10YR4/4		sicl	1fsbk	fi	cw	1f	0.2	0.3
C1	33-49	10YR4/6	c2f10YR5/8 6/3	scl	0mass	fi	cw		0	0
C2	49-56	10YR6/4	c2f10YR6/6 6/2	vfs	0mass	l			0.4	0.6

Boring ☐ Boring
☒ Pit
 # Ground surface elev. Depth to limiting factor N/A in. / elev. N/A ft.


Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr.Sz.Sh.	Consistence (Moist)	Boundary	Roots	Soil Application Rate GPD/ft ²	
									*Eff#1	*Eff#2

Boring ☐ Boring
☒ Pit
 # Ground surface elev. Depth to limiting factor N/A in. / elev. N/A ft.

Horizon	Depth inches	Dominant Color Munsell	Redox Description Qu. Sz. Cont. Color	Texture	Structure Gr.Sz.Sh.	Consistence (Moist)	Boundary	Roots	Soil Application Rate GPD/ft ²	
									*Eff#1	*Eff#2


*Effluent #1 = BOD₅ > 30 ≤ 220 mg/L and TSS > 30 ≤ 150 mg/L*Effluent #2 = BOD₅ ≤ 30 mg/L and TSS ≤ 30 mg/L

LOCATION MAP
1" = 400'

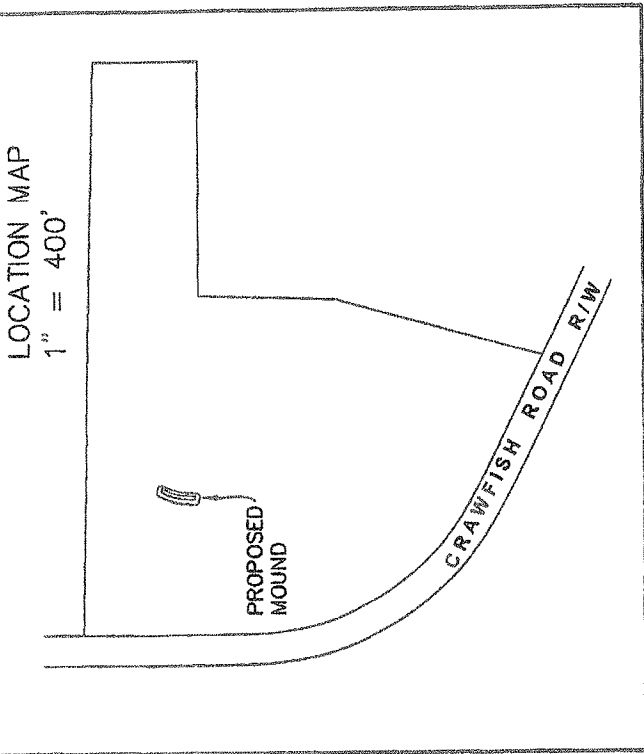

APPROX. LOT LINE
CRAWFISH ROAD LLC
PAGE 3 OF 3
27.515 ACRES

CRAWFISH ROAD R/W

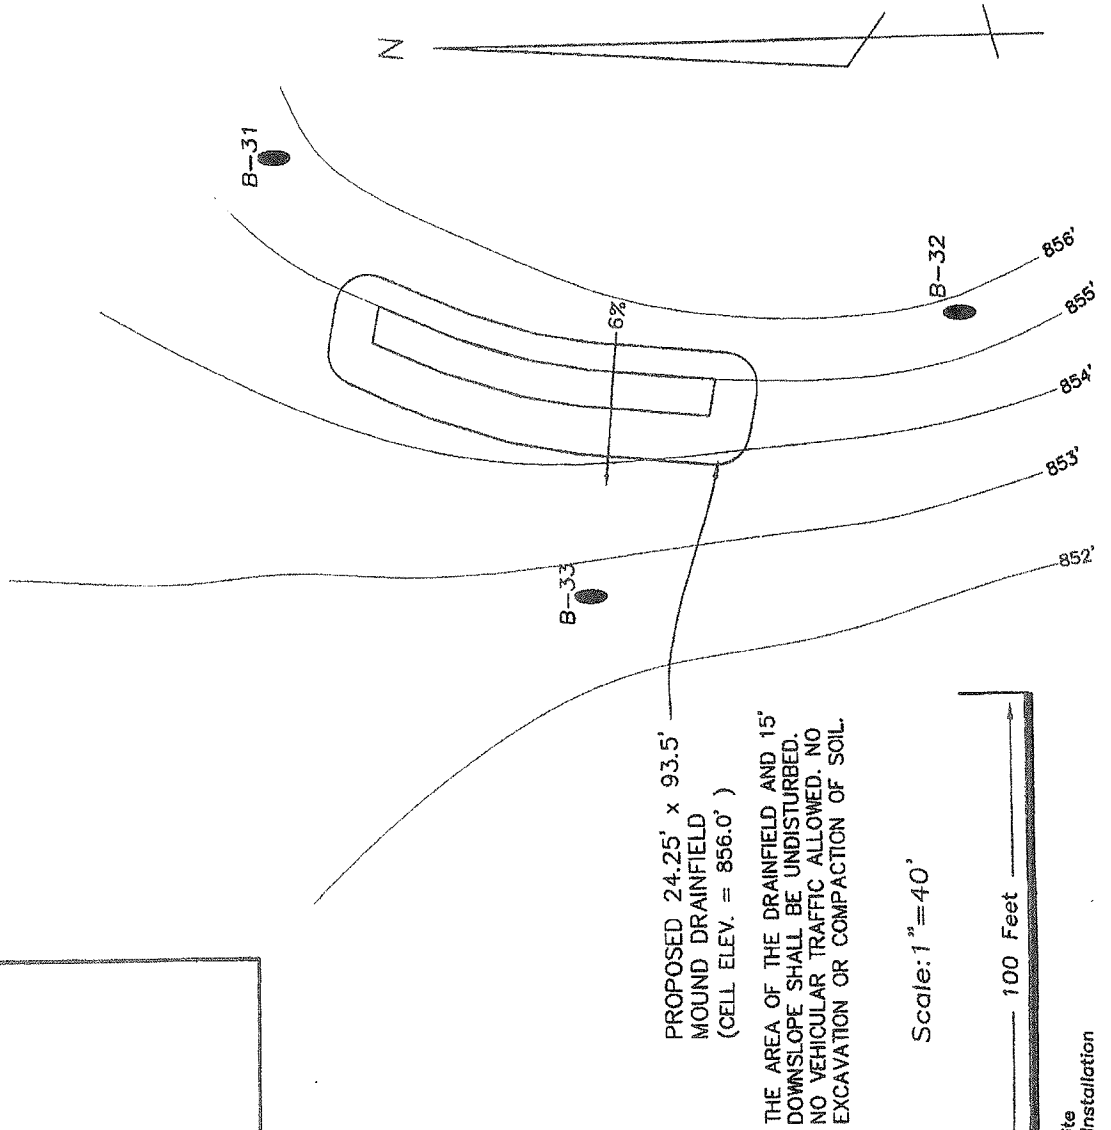

BM = NAIL @ 12"
IN POWER POLE
ELEV. = 850.1'

Scale: 1" = 40'

- * Elevations are for Soil Test Use Only
- * This is Not a Survey
- * Property Lines Per Owner or County GIS Website
- * Property Lines Need to be Identified Prior to Installation