


RDM
 150 W. 42nd Street, New York, NY 10036
 Tel: (212) 512-2000
 Fax: (212) 512-2001
 www.rdm.com

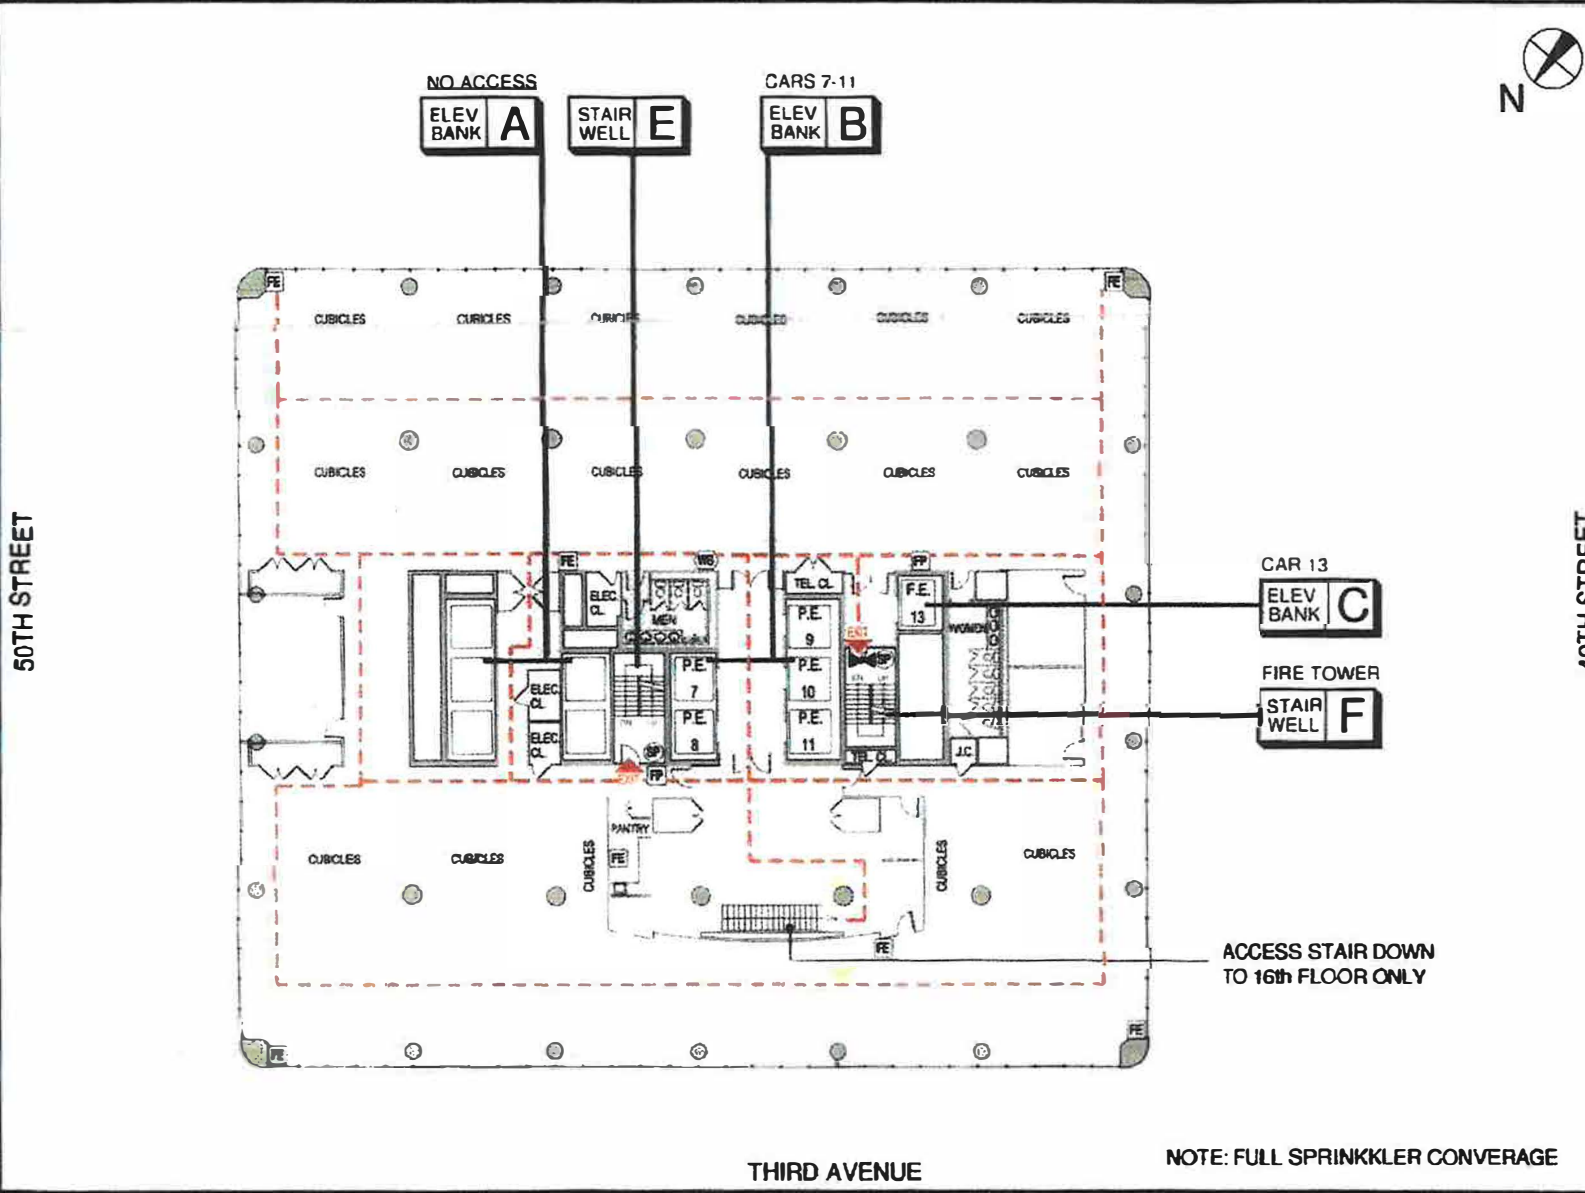

LEGEND

- NOTE: Not all devices and designations in legend may apply to this building
- Fire Alarm Pull (FP)
 - Fire Extinguisher (FE)
 - Standpipe (SP)
(with or w/o a hose)
 - Fire Hose (FH)
(with/without standpipes, hoses, outlets)
 - Warden Station (WS)
(Fire phone or phone rack)
 - Fire Command Station (FCS)
(See Ground Floor)
 - Fire Dept. Connection
(See Ground Fl. & Site Plan)
 - Sprinkler Valve (SV)
 - Standpipe Valve (SPV)
 - Combo Valve (CV)
(standpipes, fire alarm, door valves)

- EXIT
- Furniture/Equip.
(furniture, equipment/ removable partitions)
- Permanent Partition
(non-removable permanent partitions)
- Fire Barrier
(permanent part. walls of assembly, corridors, & mech. equip. rooms)
- In-Building Relocation Areas (IBRAs)
- Sprinkled Areas (blue) & Non-sprinkled Areas
(Shown on partially covered floors. See bottom right corner of plan for details)

NO.	DATE	NAME	REVISION/TITLE

Drawn By: EB / D.F.
 Checked By: AT / JC
 BUILDING ADDRESS:
805 Third Avenue
 New York, N.Y. 10022

DRAWING TITLE:
17th Floor
FL-17

SURVEY BY: JW
 SURVEY DATE(S): 9/20/12 - 9/21/12



49TH STREET

50TH STREET

THIRD AVENUE

NOTE: FULL SPRINKLER CONVERGENCE