


WEST 30TH STREET

NOTE: FULL SPRINKLER COVERAGE

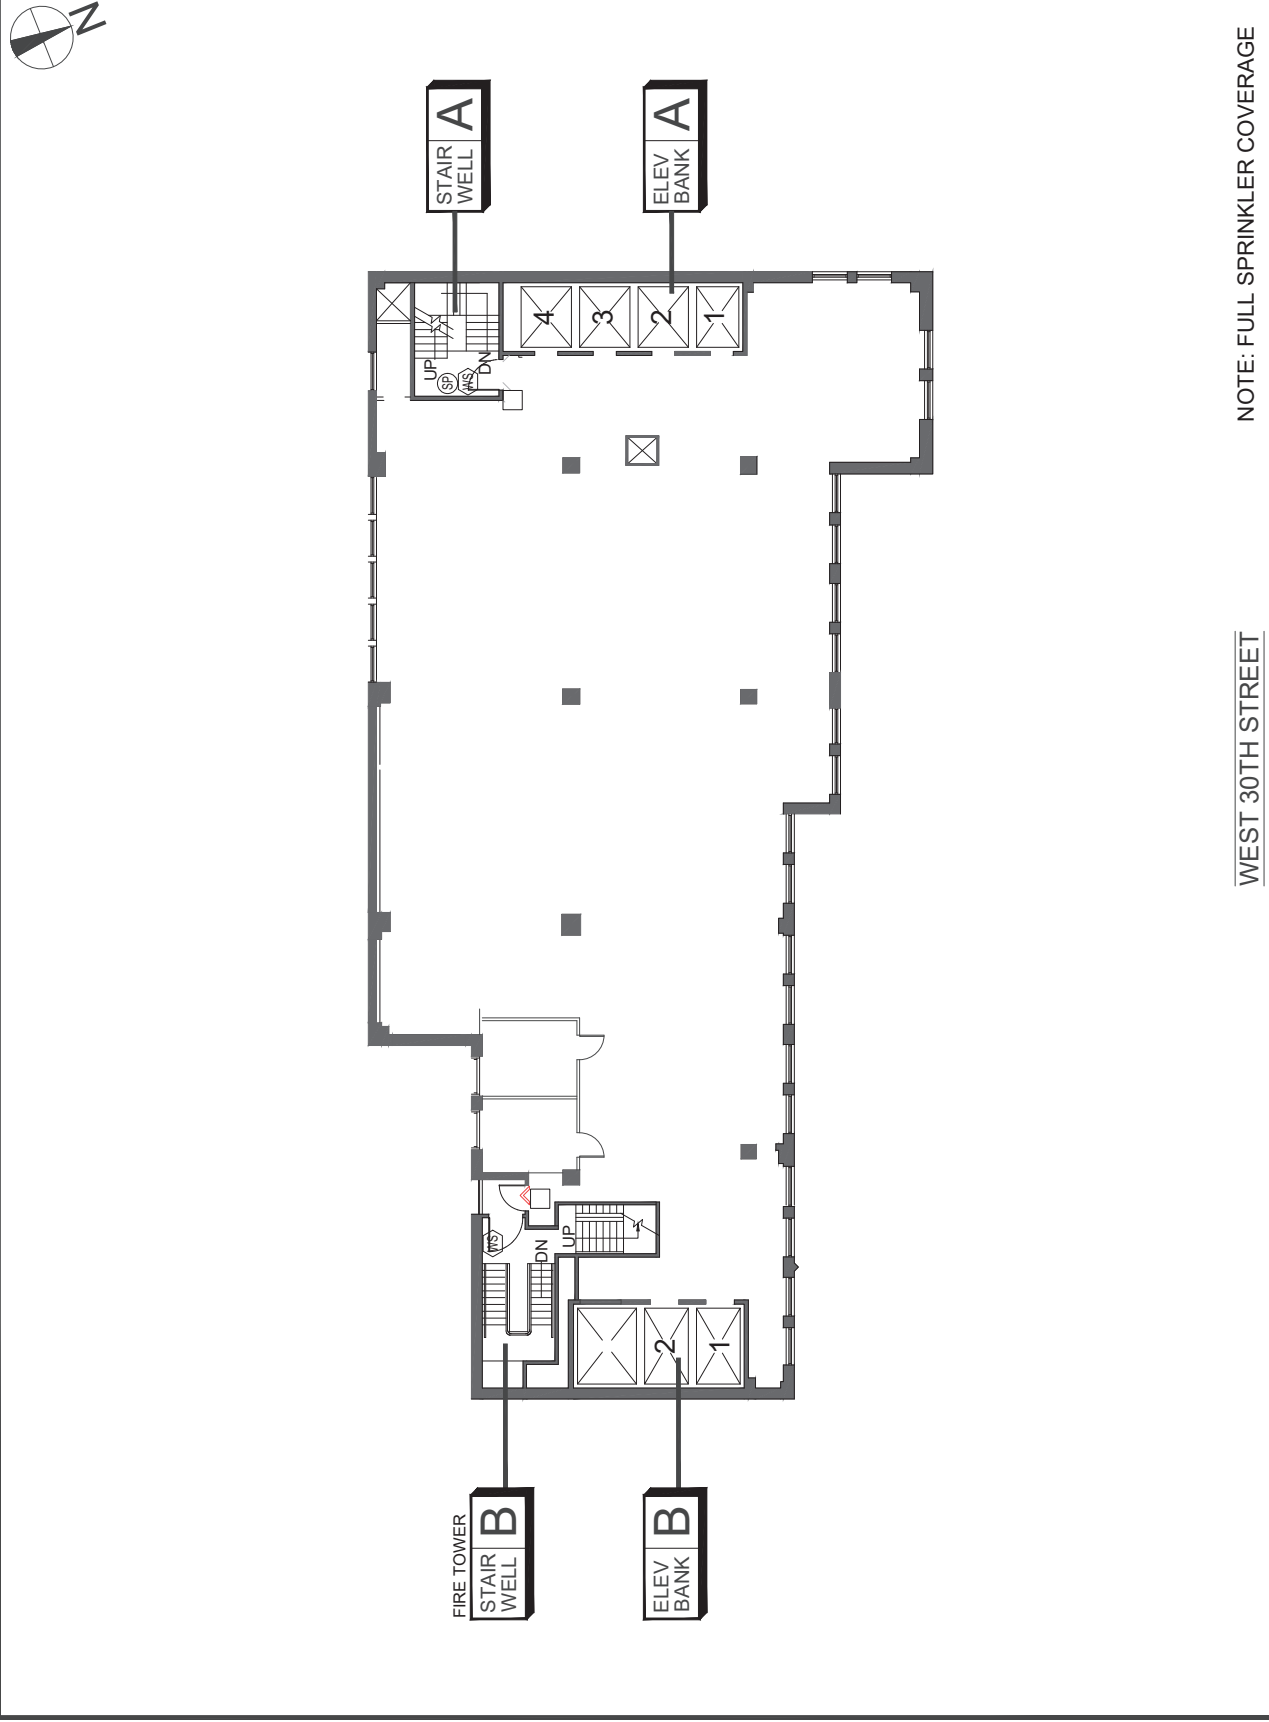

LEGEND

- FP MANUAL PULL STATION
- SP STANDPIPE HOSE OUTLET
- WS FIRE WARDEN STATION
- FCS FIRE COMMAND STATION
- FD FIRE DEPT. CONNECTION (SIAMOSE CONNECTION)
- SV STANDPIPE CONTROL VALVE
- SV SPRINKLER CONTROL VALVE
- D DOMESTIC WATER MAIN CONTROL VALVE
- E EVACUATION ROUTE
- F FURNITURE/EQUIPMENT
- FB FIRE BARRIER
- NS NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IR IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE	NAME	REVISION COMMENTS
1	10.01.20	MM	ISSUED FOR SAFETY FILE AND ISSUED FOR REVIEW AND FILING
2	10.08.20	JW	REVISION PER COMMENTS ISSUED FOR FILING

DRAWN BY/DATE: _____
 KM DL
 CHECKED BY/DATE: _____
 DL
 BUILDING ADDRESS:
150 WEST 30TH ST
NEW YORK, NY 10001

DRAWING TITLE:
FL-17
17TH FLOOR

SURVEY BY: | SURVEY DATE(S):
 AR 09.15.20