

CODE, EXITING & OCCUPANCY LEGEND

CODE NOTES:
 A. SEE COVER SHEET FOR FULL "CODE ANALYSIS".

→ EXIT DISCHARGE AND OCCUPANT LOAD (TABLE 1004.1.2)

FIRE EXTINGUISHER & CABINET - SEE DETAIL
 PROVIDE 2A-10BC RATED FIRE EXTINGUISHERS, CLASS "K" IN KITCHEN

LINE INDICATES "EXIT ACCESS TRAVEL DISTANCE", "COMMON PATH OF EGRESS TRAVEL" OR TRAVEL DISTANCE TO FIRE EXTINGUISHER, AS SHOWN/INDICATED

SPACE NAME
 150 → AREA OF SPACE (USED FOR OCCUPANT LOAD CALCULATION OF SPACE)
 FUNCTION → FUNCTION OF SPACE (FROM IBC TABLE 1004.5)
 XXX → OCCUPANT LOAD (# OF OCCUPANTS)
 XXX → LOAD FACTOR (FROM IBC TABLE 1004.5)

EXIT → ILLUMINATED WALL OR CEILING MOUNTED EXIT SIGN (GENERAL LOCATION SHOWN), COMPLY W/ IBC 1013, (INTERNALLY OR EXTERNALLY ILLUMINATED)

TACTILE → TACTILE WALL MOUNTED EXIT SIGN MOUNTED ADJACENT TO DOOR PER IBC 1013.4 AND ANSI A117.1 703. SEE

RESTROOM SIGN → RESTROOM SIGN ADJACENT TO DOOR, REQUIRED BY IBC 2902.4 AND DESCRIBED BY ANSI A117.1 703. SEE

LIFE SAFETY OCCUPANCY LOAD TABLE

Name	AREA - FUNCTION	Area	AREA - OCCUPANT LOAD FACTOR	Occupant Load
TENANT 1 = DT	BUSINESS	1763 SF	150	12
TENANT 2 = SD	BUSINESS	1670 SF	150	11
TENANT 3 = SD	BUSINESS	1500 SF	150	10
Grand total: 3		4932 SF		33

OCCUPANCY CLASSIFICATION & FIRE RATINGS

ACCESSORY OCCUPANCY ASSEMBLY OCCUPANCY

BUSINESS OCCUPANCY


ELEMENT (CODE REFERENCE) RATING GRAPHIC REPRESENTATION

STRUCTURAL FRAME: 1-HOUR

FLOOR CONSTRUCTION (711): 1-HOUR

SHAFT CONSTRUCTION (707 - FIRE BARRIER): 2-HOUR

NOTE:

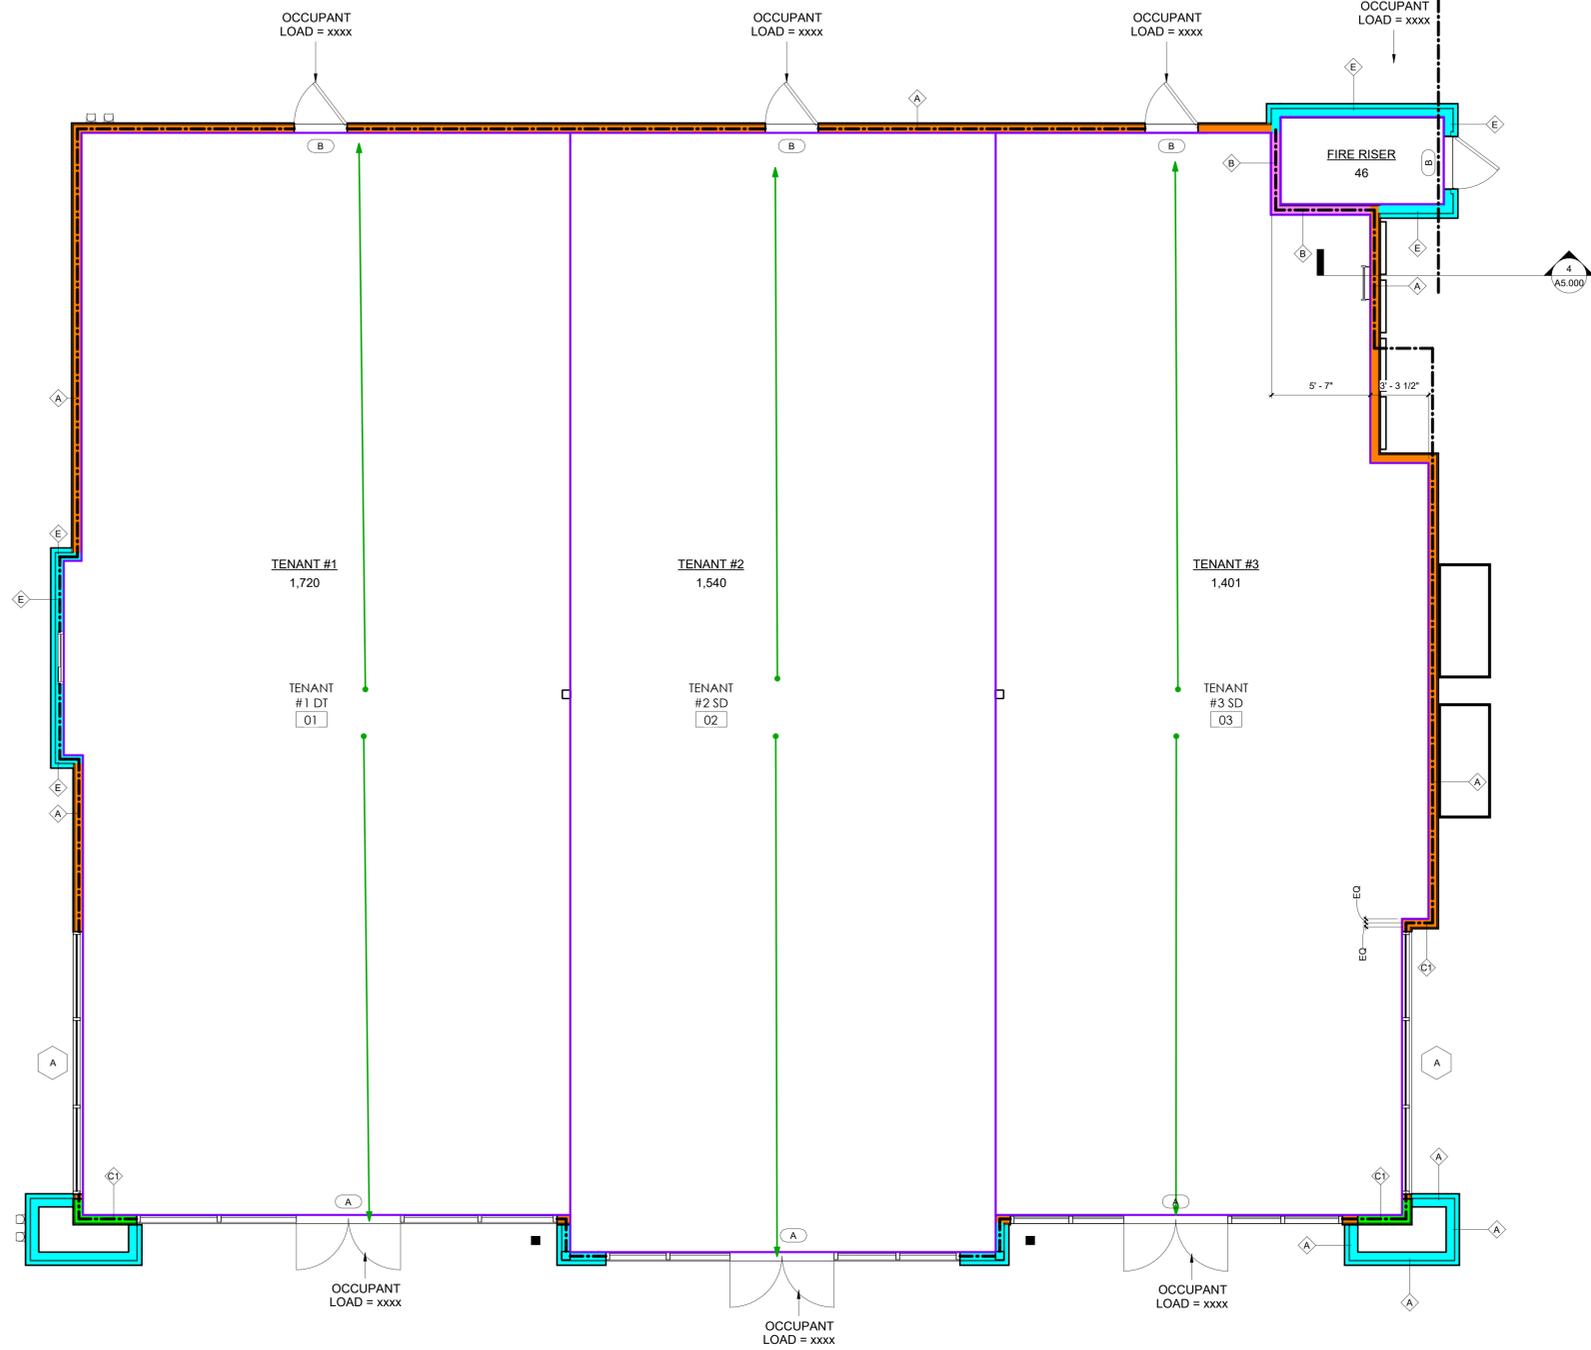

1ST FLOOR LIFE AND SAFETY PLAN
 SCALE: 1/4" = 1'-0"



REVISIONS

PROJ NO:	2406C
RELEASE DATE:	06.30.25
DRAWN BY:	TWS
CHECKED BY:	HAL

LIFE & SAFETY PLAN

