

Case Number: EH23789

Polk County Health & Human Services

PIN: P73-139

ENVIRONMENTAL HEALTH SERVICES (828-894-3739)

OPERATIONS PERMIT

CODE: S-19

Property Owner: WILLIAM LEDFORD

Property Location: NC HWY 108


Application Date: 07.13.2022

Directions: E HWY 108 PAST POLK COUNTY HIGH SCHOOL; ON L/ ABOUT 300 FT

Subdivision: _____ Phase/section: _____ Lot#: _____ Installer: _____ Cert.# _____

Water Supply: Community/Public Private Well Single Family Dwelling Well Shared Well Spring Min Required Setback Distance 50' Installed? Yes No

Conditions: 1) Pump septic tank every 3 to 5 years. 2) Clean septic tank effluent filter annually or as needed. 3) Divert all gutters and other surface water, away from septic system and repair areas. 4) No grading - cutting or filling over septic system and repair areas.

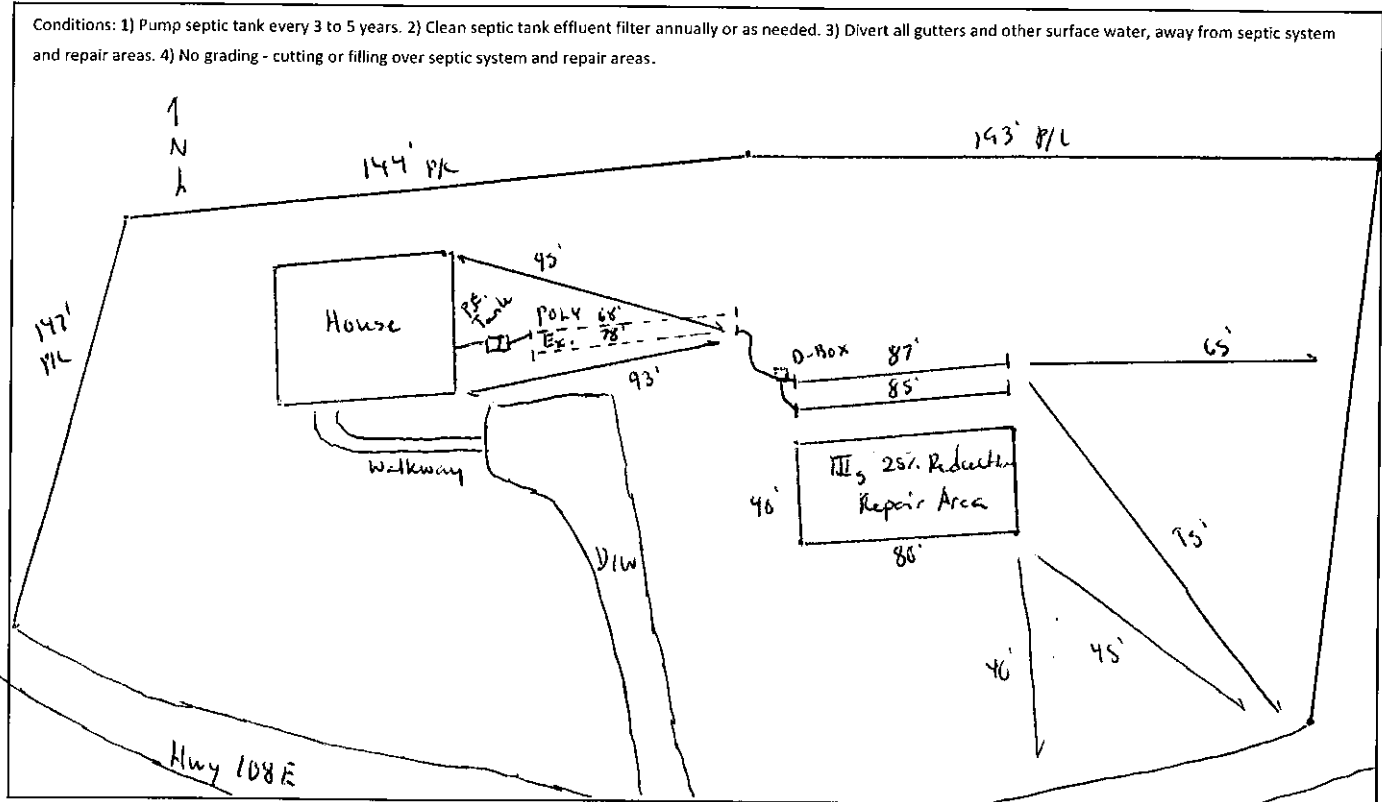

Operations Permit For: New System Repair Revision Expansion/Addition Drawings, plans, conditions, etc. attached? Yes No
System Approved For: House Mobile Home Modular RV Bedrooms: 4 Max. # Occupants: 8 Bsmt: Yes No Bsmt. Plumbing: Yes No
 Multiple Unit Dwelling: No. of Units: _____ Bedrooms/per unit: _____ Max.# Occupants/per unit: _____
 Business No. of Employees: _____ Number of Shifts: _____ Industrial Waste: Yes No Type: _____

Operation Maintenance & Monitoring Description (if applicable): _____
Approved Installation Specifications: 980 LTAR: 0.4 System Classification: Type I: II *III IV *V *VI
(Total Design Flow-GPD)

Septic Tank(s) Capacity: Pre-existing Date of Manufacture: Pre-existing Tank Serial #: Pre-existing
Pump System: (Gallons) Pump Tank Capacity: _____ Date of Tank Manufacture: _____ Tank serial # _____ Solid Lift Pump Required Yes No
Septic Tank Location: GPS Latitude: _____ Longitude: _____
Pump Specification: Pump Make: _____ Model: _____ Serial #: _____
System Type Installed: CHM36 III, 25% Reduction Shallow Placement System Yes No Fill Depth: _____
Tranches: Length: 112' ft No. of Trenches: 2 Width: 3 ft Spacing: 9 ft Depth: 18 in (lower sidewall) Aggregate Depth: 12 in
Distribution Type: Serial- 3" sch 40 PVC Pressure Manifold Equal Distribution- _____
Comments: _____

*Type V & VI expire in 5 years. Owner must contact Environmental Health 6 months prior to expiration for permit renewal.

Inspected by: [Signature] Date: 1/27/23

The system has been installed in compliance with the applicable NC General Statutes, Rules for Sewage Treatment and Disposal (15A NCAC 18A .1900). Approval does not guarantee the system will function satisfactory for any given time.