




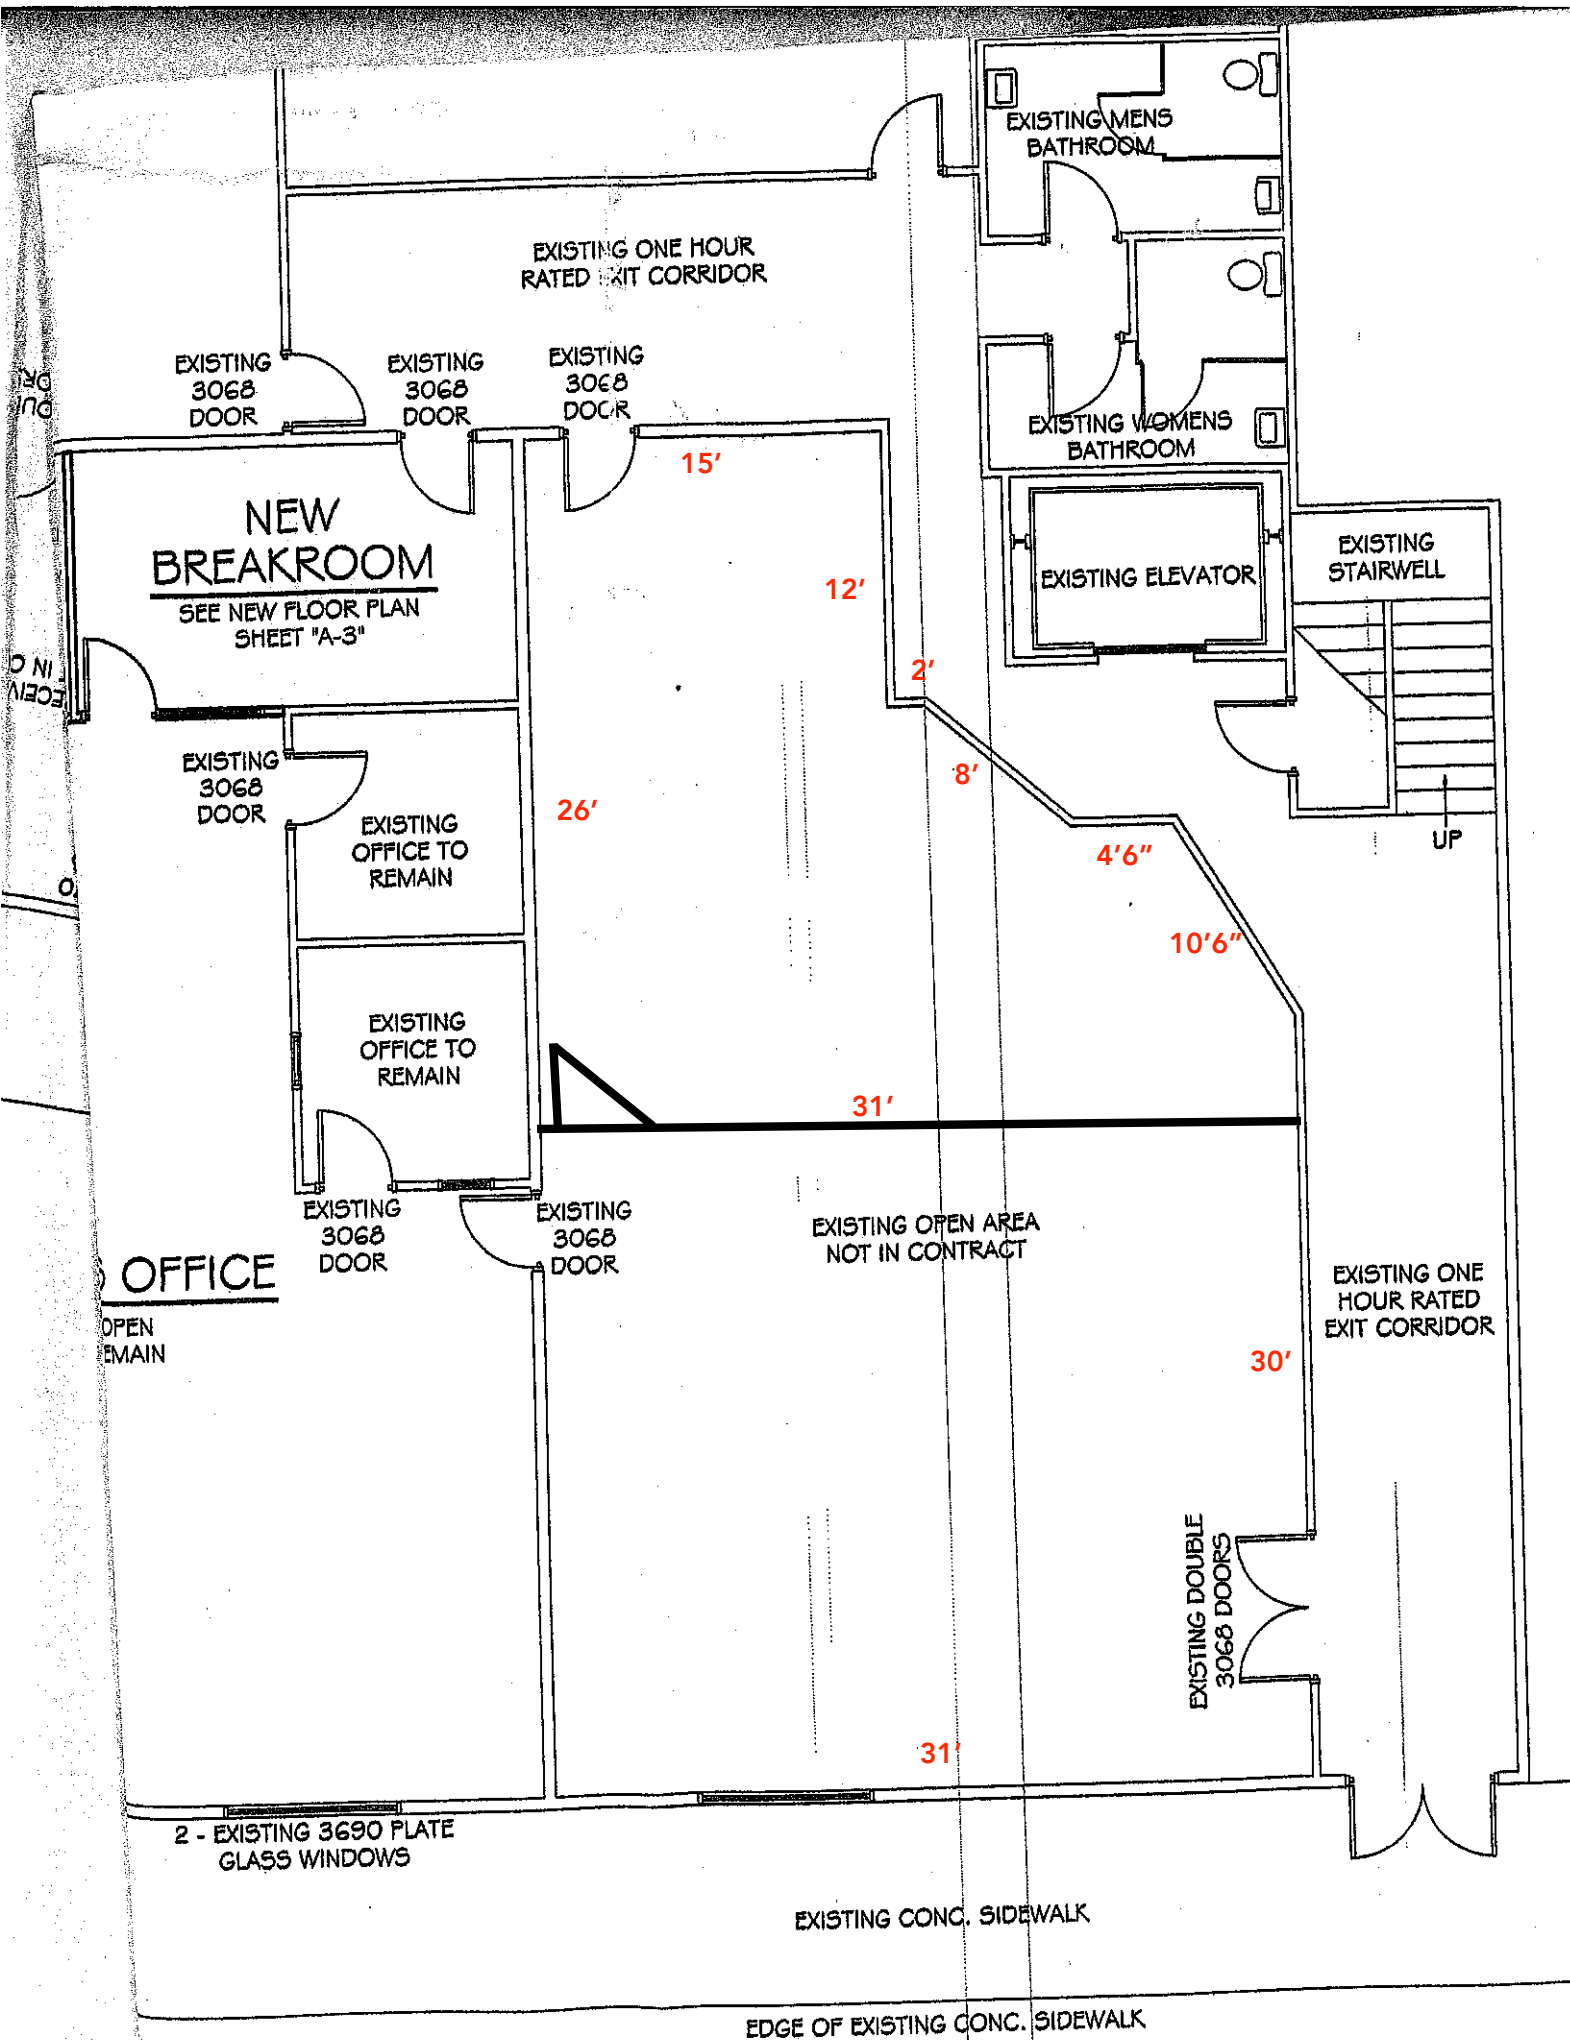

1/4" = 1' - 0'

NOTE: ALL ITEMS ARE NEW EXCEPT AS INDICATED.
(E) = EXISTING ITEM

PERMIT
FOR
JAN 9 2002

NEW	208Y/120 VOLTS, 3 PHASE, 4 WIRE, NEUTRAL BUS, GROUND BUS, FLUSH MOUNTING. 200 A. MINIMUM MAIN BUS ONLY, COPPER OR ALUMINUM, PLUG-IN BRANCH BREAKERS, FULL SIZE BREAKERS ONLY, 10,000 AIC, TYPEWRITTEN DIRECTORY	CIR. BKE.	CIR. F	CIR. CIR. BKG.	SERVICE	WIRE SIZE
-----	---	-----------	--------	----------------	---------	--------------