



LEGEND

- MF** MANUAL PULL STATION
- SP** STANDPIPE HOSE OUTLET
- WS** FIRE WARDEN STATION
- FCS** FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMOSE CONNECTION)
- STANDPIPE CONTROL VALVE
- SPRINKLER CONTROL VALVE
- DOMESTIC WATER MAIN CONTROL VALVE
- EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- FIRE BARRIER
- NON-SPRINKLERED AREAS (SHOWN ON FLOORS WITH PARTIAL SPRINKLER COVERAGE)
- IN-BUILDING RELOCATION AREAS (IBRA)


NO.	DATE	NAME	REVISED COMMENTS
1	10.01.20	MM	ISSUED FOR PERMITTING (SEE 10.01.20 REVISED PER COMMENTS)
2	10.03.20	JW	ISSUED FOR PERMITTING (SEE 10.03.20 REVISED PER COMMENTS)

DRAWN BY/DATE: KM
 CHECKED BY/DATE: DL

BUILDING ADDRESS:
150 WEST 30TH ST
NEW YORK, NY 10001

DRAWING TITLE:
FL-12
12TH FLOOR

SURVEY BY: AR
 SURVEY DATE(S): 09.15.20

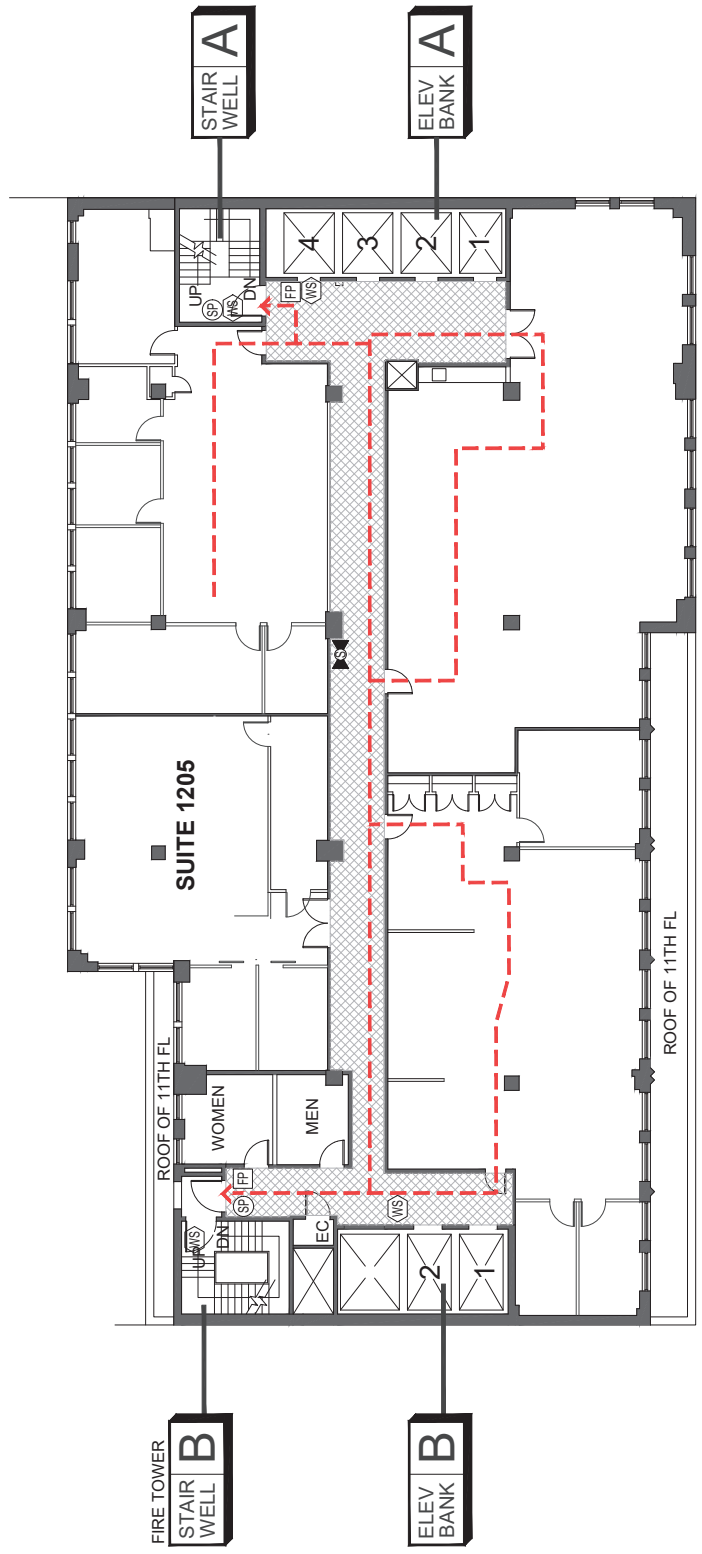

NOTE: FULL SPRINKLER COVERAGE

WEST 30TH STREET