

2 ENLARGED TOILET PLAN 3 TOILET ELEVATION


TOILET ACCESSORIES	
KEY	REMARKS
A	SIDEWALL VERTICAL GRAB BAR 18" MIN.
B	MIRROR FRAMELESS (FULL WIDTH x 4')
C	REARWALL GRAB BARS 36" MIN. < MTD. @ 34" A.F.F.
D	SIDEWALL GRAB BARS 42" MIN. < MTD. @ 34" A.F.F.
E	TOILET TISSUE DISPENSER STAINLESS/SINGLE ROLL

FINISH NOTES

- ALL INTERIOR GIPSUM BOARD WALLS ARE TO BE TAPED, SANDED AND LEFT UNPAINTED IN THE SALES AREA. TOILETS SHALL HAVE (3) WALLS OF PAINTED GIPSUM BOARD AND ONE WALL (EXTERIOR BUILDING WALL) SHALL BE PAINTED GMD.
- ALL INTERIOR FINISHES TO BE MINIMUM CLASS B PER ASTM E 84.
- ACOUSTICAL CEILING SHALL BE 2"x4" T-BAR EXPOSED GRID SUSPENDED ACOUSTICAL TILE CEILING IN THE SALES AREA. INSTAL. CEILING AT 10'-0" A.F.F. AND 8'-0" A.F.F. IN TOILETS.
- INSTALL 12"x12" VINYL COMPOSITION TILE AND 4" RUBBER CORE BASE IN TOILETS ONLY. PROVIDE RUBBER REDUCER STRIP AT DOOR INTO TOILET.

DOOR SCHEDULE				
NO.	SIZE	MATERIAL	THRESHOLD	FRAME
A	3'-0"x6'-8"x1'-3/8"	HOLLOW CORE WOOD	NONE	PRE-HUNG WOOD
				BUTT HINGES, PRIVACY LOCKSET, FLOOR STOP

ROOM FINISH SCHEDULE					
ROOM NAME	FLOOR	BASE	WALLS	CEILING	CLG. HT.
SALON	BY TENANT	BY TENANT	GWB - UNPAINTED	ACOUSTICAL 5/8"x24"x48"	10'-0"
RESTROOM	VCT	BLACK VINYL	GWB - PAINTED	ACOUSTICAL 5/8"x24"x48"	8'-0"

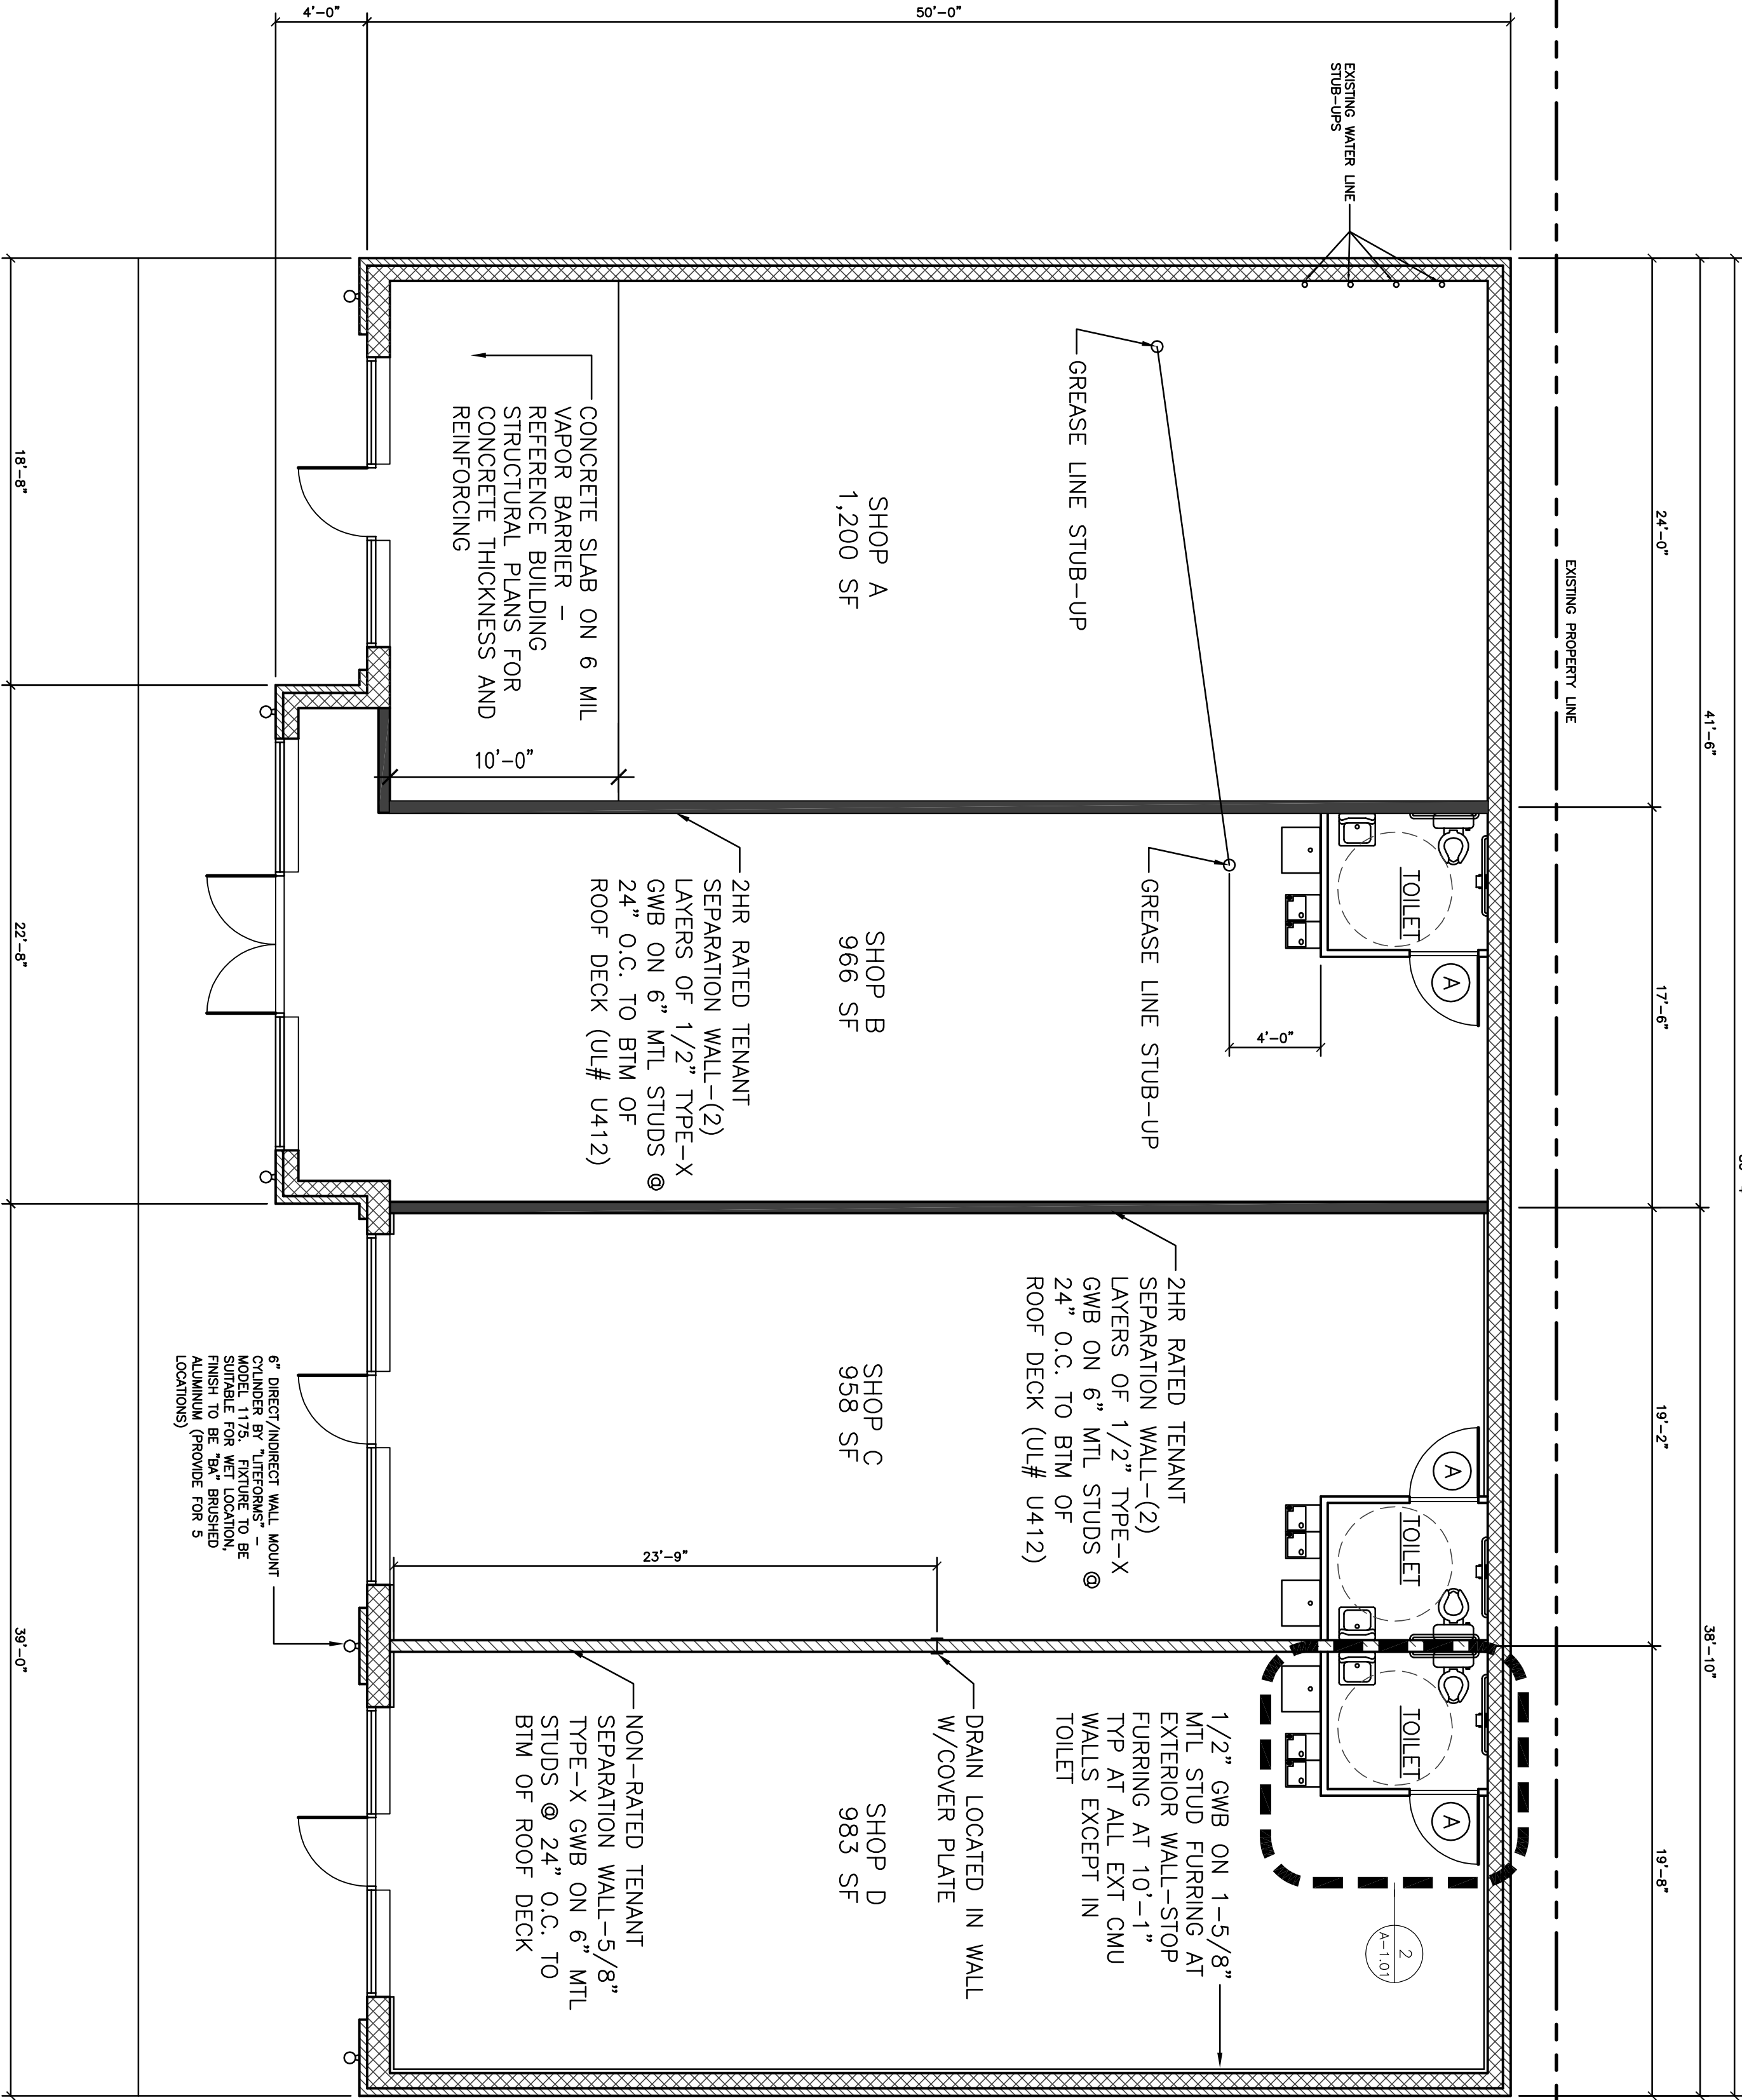

1 FLOOR PLAN

PARTITION LEGEND

- EXISTING EXTERIOR MASONRY WALL
- NEW 2HR RATED FIRE SEPARATION WALL - (2) LAYERS OF 1/2" TYPE-X GWB EA. SIDE OF 6" MTL STUDS SPACED AT 24" O.C. TO BOTTOM OF ROOF DECK (UL# U412).
- 0 RATED TENANT DEMISING WALL, 5/8" TYPE, 'X' GWB EA. SIDE OF 6" MTL STUDS @ 24" O.C. TO BOTTOM OF ROOF DECK.
- TOILET PARTITION WALL: 1/2" GWB EACH SIDE OF 3 5/8" MTL STUDS @ 24" O.C. TO 10'-1" A.F.F.