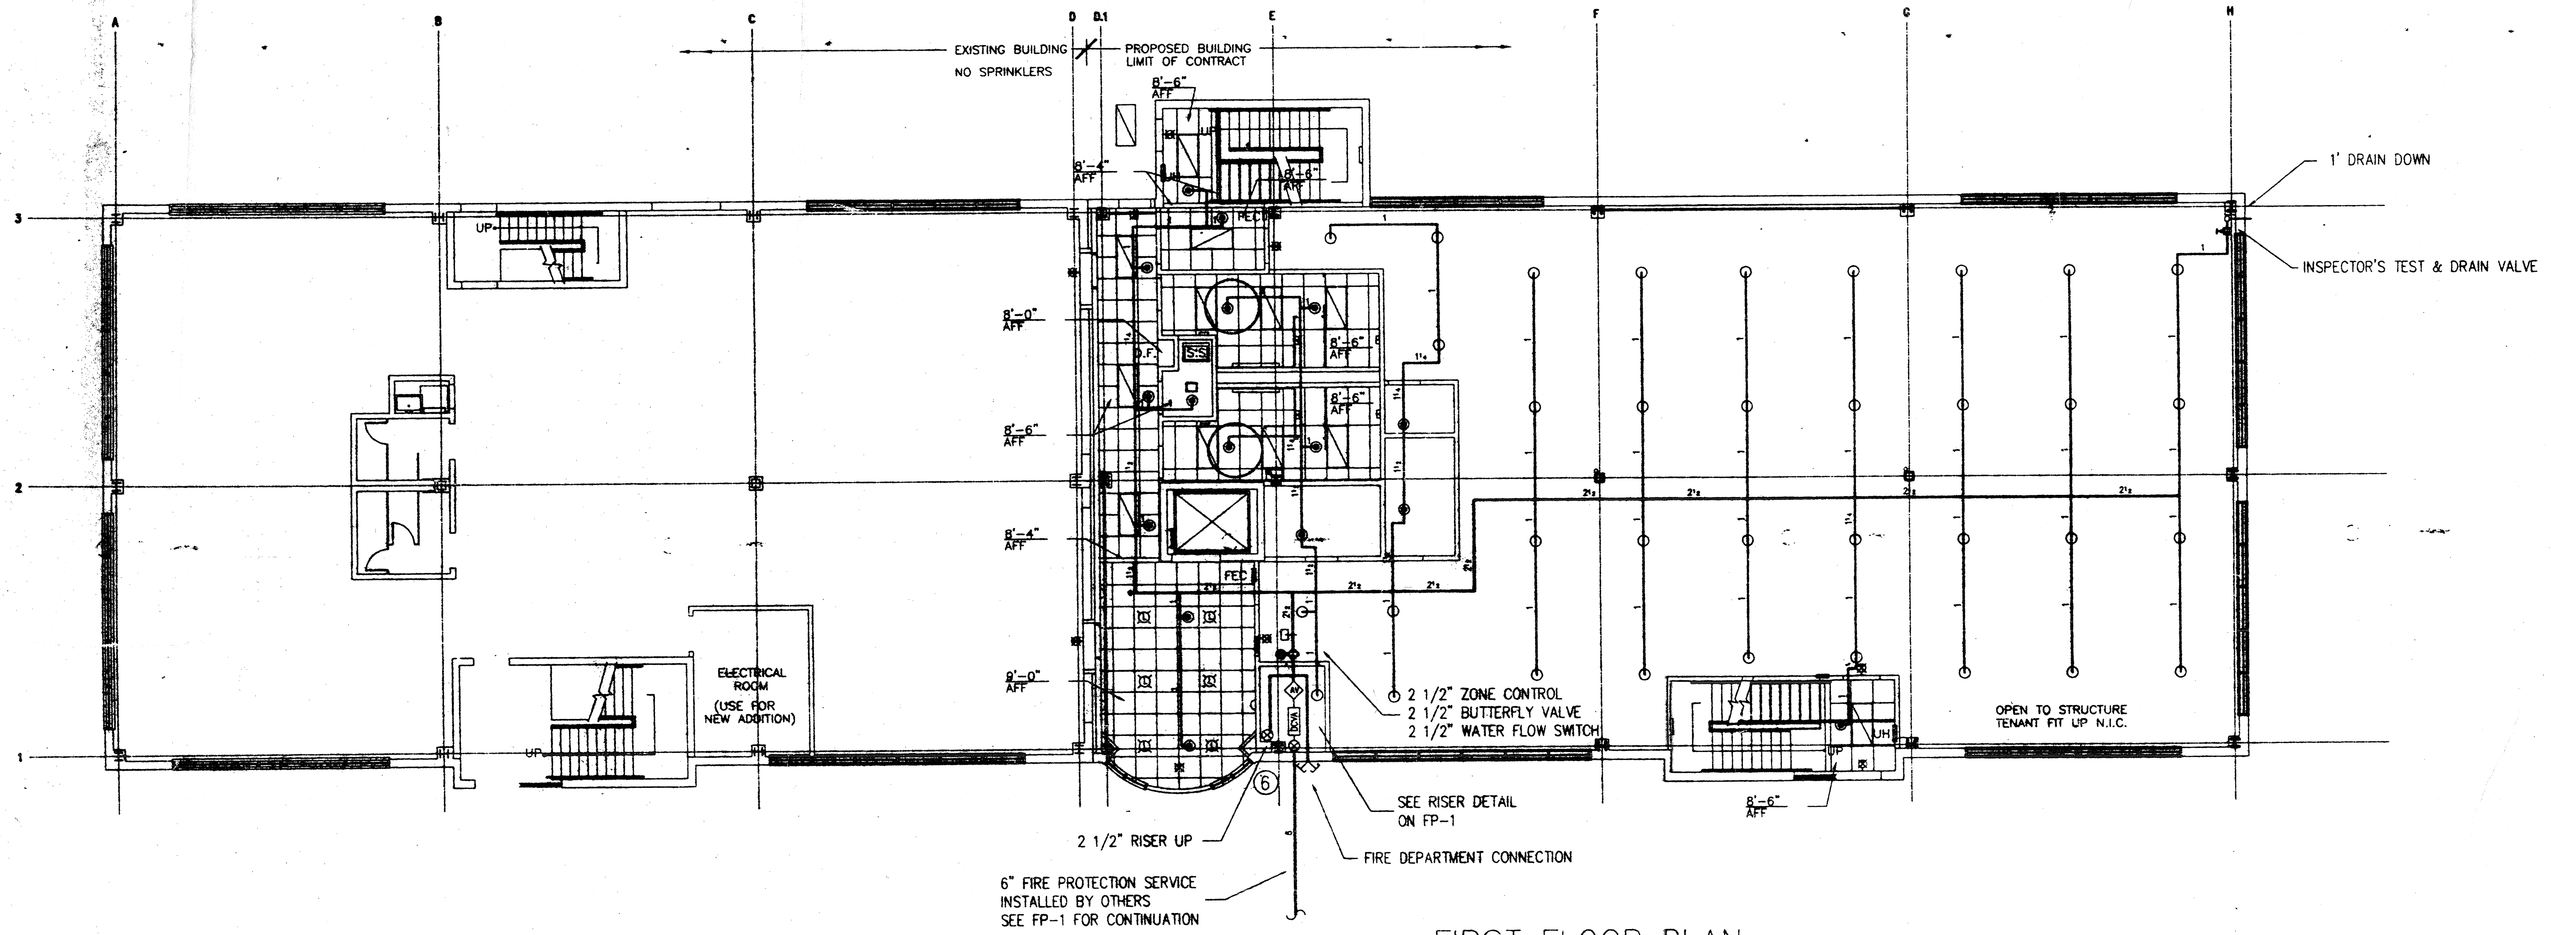

FIRST FLOOR PLAN

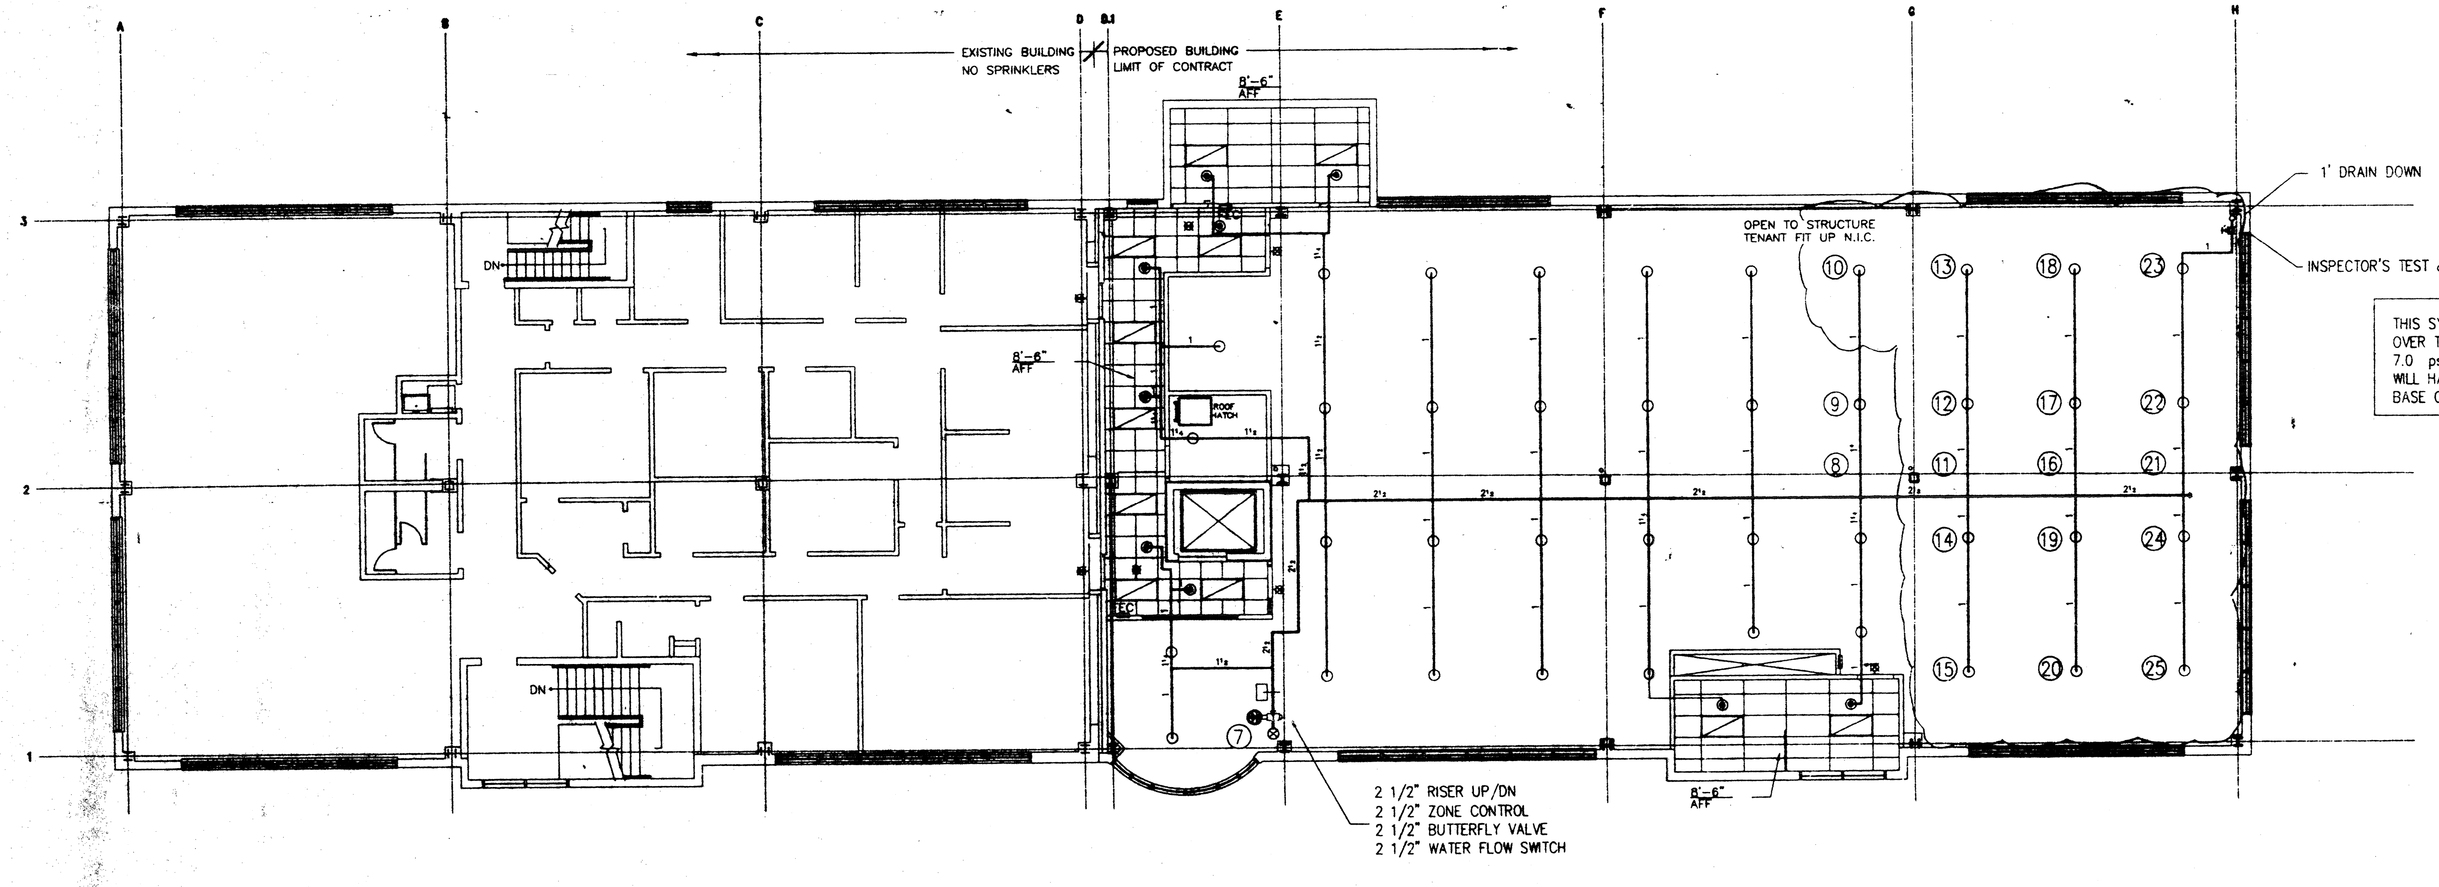

THIS SYSTEM IS CALCULATED TO PROVIDE DENSITY OF .10 OVER THE MOST REMOTE 1500 sq. ft. WITH 14.8 gpm AT 7.0 psi AT THE MOST REMOTE SPRINKLER, THIS SYSTEM WILL HAVE A DEMAND OF 311.0 gpm AT 53.1 psi AT THE BASE OF RISER.

SECOND FLOOR PLAN

NOTES

REVISIONS		
DATE	DESCRIPTION	BY

SPRINKLER SYMBOLS

SYM	QNT	NAME	METAL	TEMP	K	NPT	ORIF	MFG.	MODEL #	ESCUT	CONN.
◉	25	PENDENT	CHROME	155	5.60	1/2"	1/2	CENTRAL	QB-QR	CHROME	Thread
○	76	UPRIGHT	BRASS	155	5.60	1/2"	1/2	CENTRAL	QB-QR		Thread

TOTAL SPRINKLERS = 101

ZSC

JADE SPRINKLER CORP.
P.O. BOX 467
UXBRIDGE, MA. 01569

MD DENTAL
107 OTIS STREET
NORTHBOROUGH, MA.

CONTRACTOR:

SPRINKLER PIPING SITE/DETAILS	
PERMIT NO.	
CONTRACT NO.	
APPROVAL	
C.D.T.	BGH
SCALE	1/8"=1'-0"
DATE	10/13/2002
SHEET	FP2 of 2