


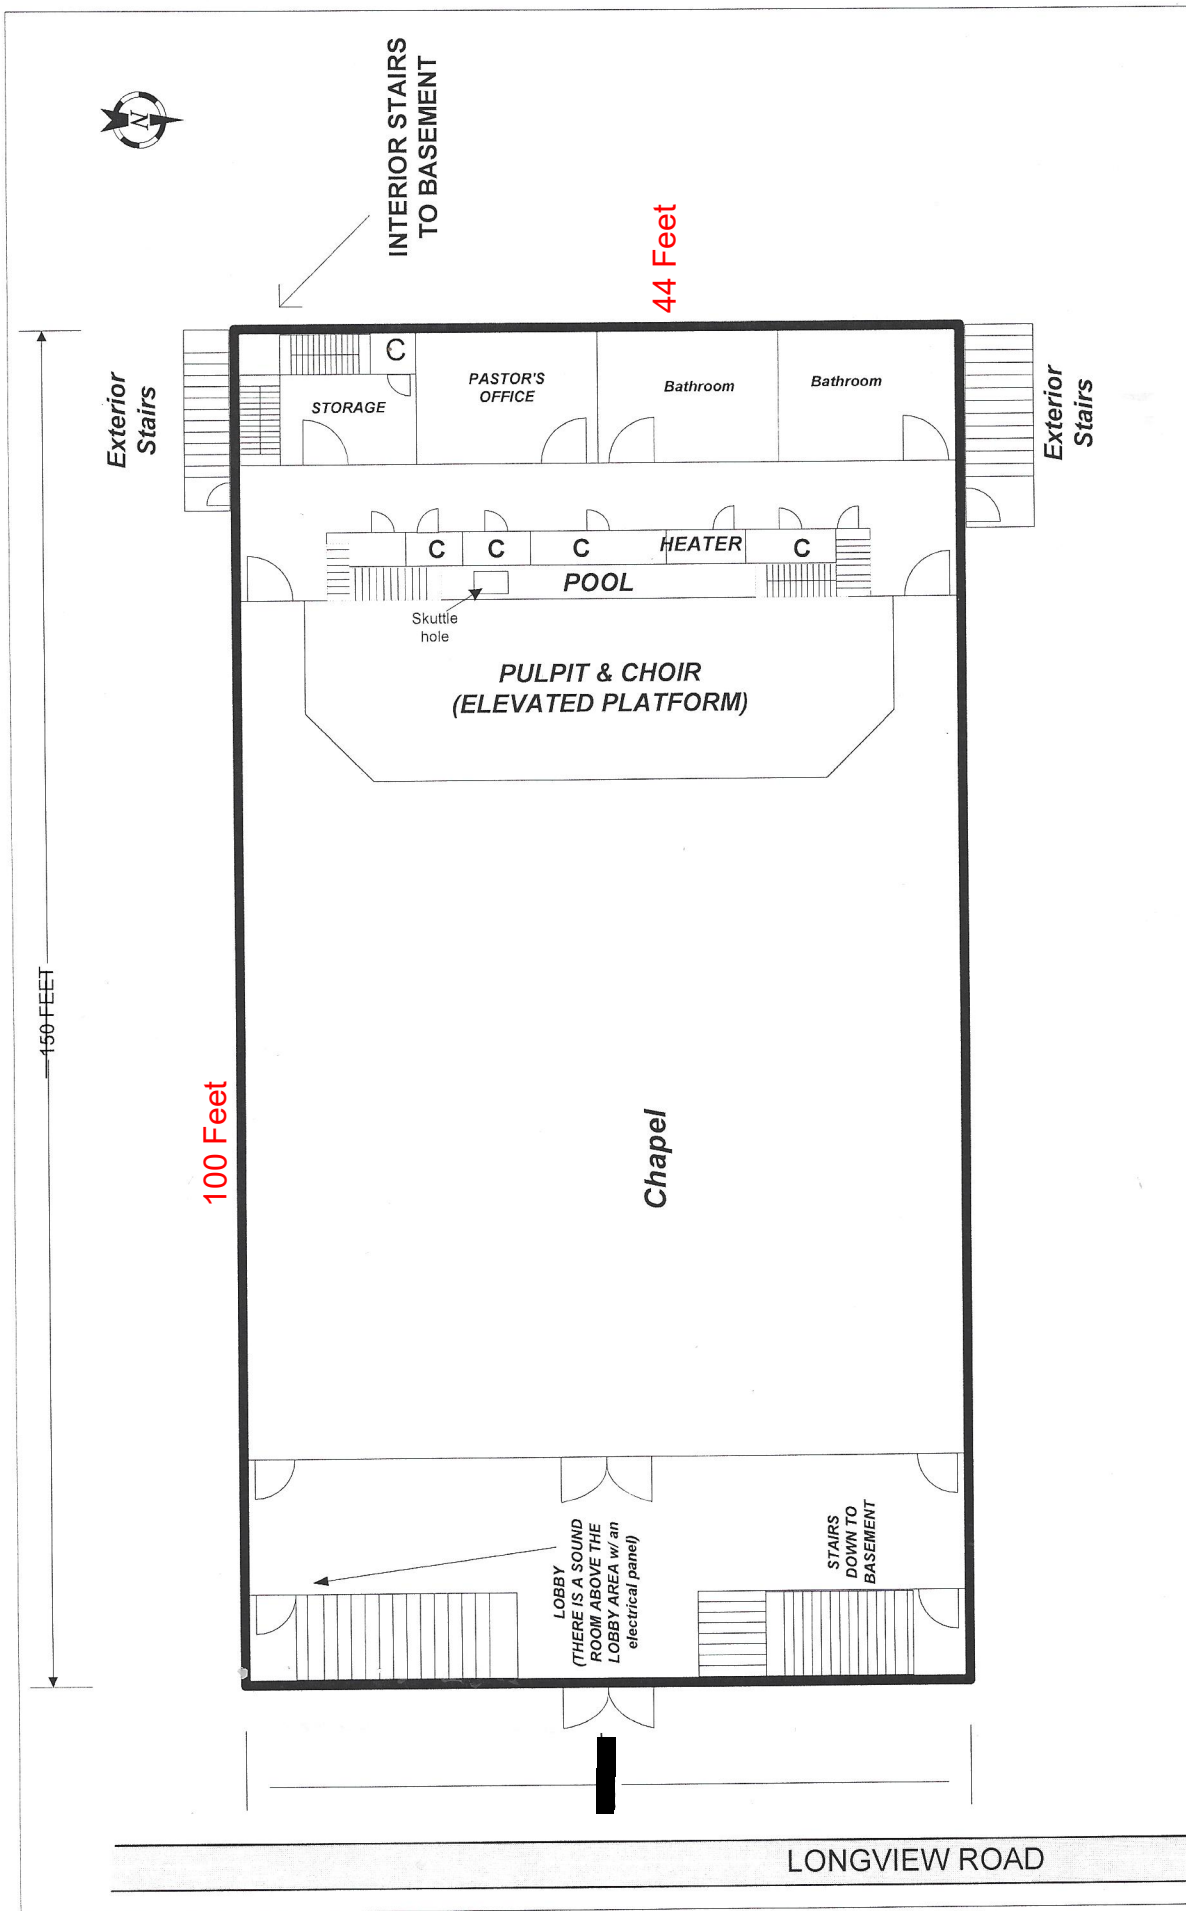

THIS IS THE MAIN FLOOR OF THE CHURCH / SEE OTHER PAGES FOR BASEMENT DIAGRAM AND SITE PLANS FOR THE ENTIRE COMPLEX

NS

MAIN FLOOR: CHURCH

152 LONGVIEW ROAD

Updated by: P Hitch

Date: 11/30/2015

SCALE: None

FCP	Fire Alarm Control Panel	2-Way FDC	Electrical Meter	Automatic Sprinkler - Fully Sprinklered	Emergency Light
K	Know Box/Keys	Single Door	Gas Line Meter	Non - Sprinklered	Riser Valve
O S & V Valve		Hydrant	electrical panel	Automatic Sprinkler - Partially Sprinklered	Fire Door
		Hazards	Doors	Overhead Door	Fuel Pump
Radioactive	Scuttle Hole	2 Lane Road	Dimension Line		LP Tank
Biohazard	Attic Access				

129 Feet

Approx. 3
ft. drop

26 Feet



ALL EXTERIOR
STAIRS LEAD
TO GROUND
LEVEL

Band
ROOM
20' x 18'

Art
ROOM
20' x 18'

Classroom
25' x 18'

99 Feet

*** WARNING ***

THIS DOORWAY OPENS UP TO THE GYM / THERE
ARE NO STAIRS / IT IS PROTECTED BY A GUARD
RAIL / 8 FT DROP TO GYM FLOOR

100 Feet

Classroom
17' x 24'

Classroom
17' x 24'

STORAGE CLOSETS

STAIRS DOWN

74 Feet

THIS SECTION IS
THE UPPER
LEVEL ROOF OF
THE GYM AREA

30 Feet

FCP	Fire Alarm Control Panel	2-Way FDC	Electrical Meter	Automatic Sprinkler - Fully Sprinklered	Emergency Light
AS	Knock Box/ Keys	Single Door	Gas Line/Meter	Non-Sprinklered	Riser Valve
OS & Y Valve	Hydrant	electrical panel	electrical panel	Automatic Sprinkler - Partially Sprinklered	Fire Door
Radioactive	Hazards	Doors	Overhead Door	Fuel Pump	LP Tank
Bi-Hazard	Scuttle Hole	2 Lane Road	Dimension Line		
	Attic Access				

THIS END OF THE BUILDING IS THE
ONLY PART THAT IS ON GROUND
LEVEL / THE REST OF THE UPPER
FLOOR DROPS OFF FROM GRADE
LEVEL

NS GYM: SECOND FLOOR

152 LONGVIEW ROAD


Updated By: P Hitch

Date: 11/30/2015
SCALE: None



Skirt door to crawlspace

THERE IS SKIRTING ALL AROUND THE TRAILER /
SOME STORAGE IS LOCATED UNDER THE TRAILER

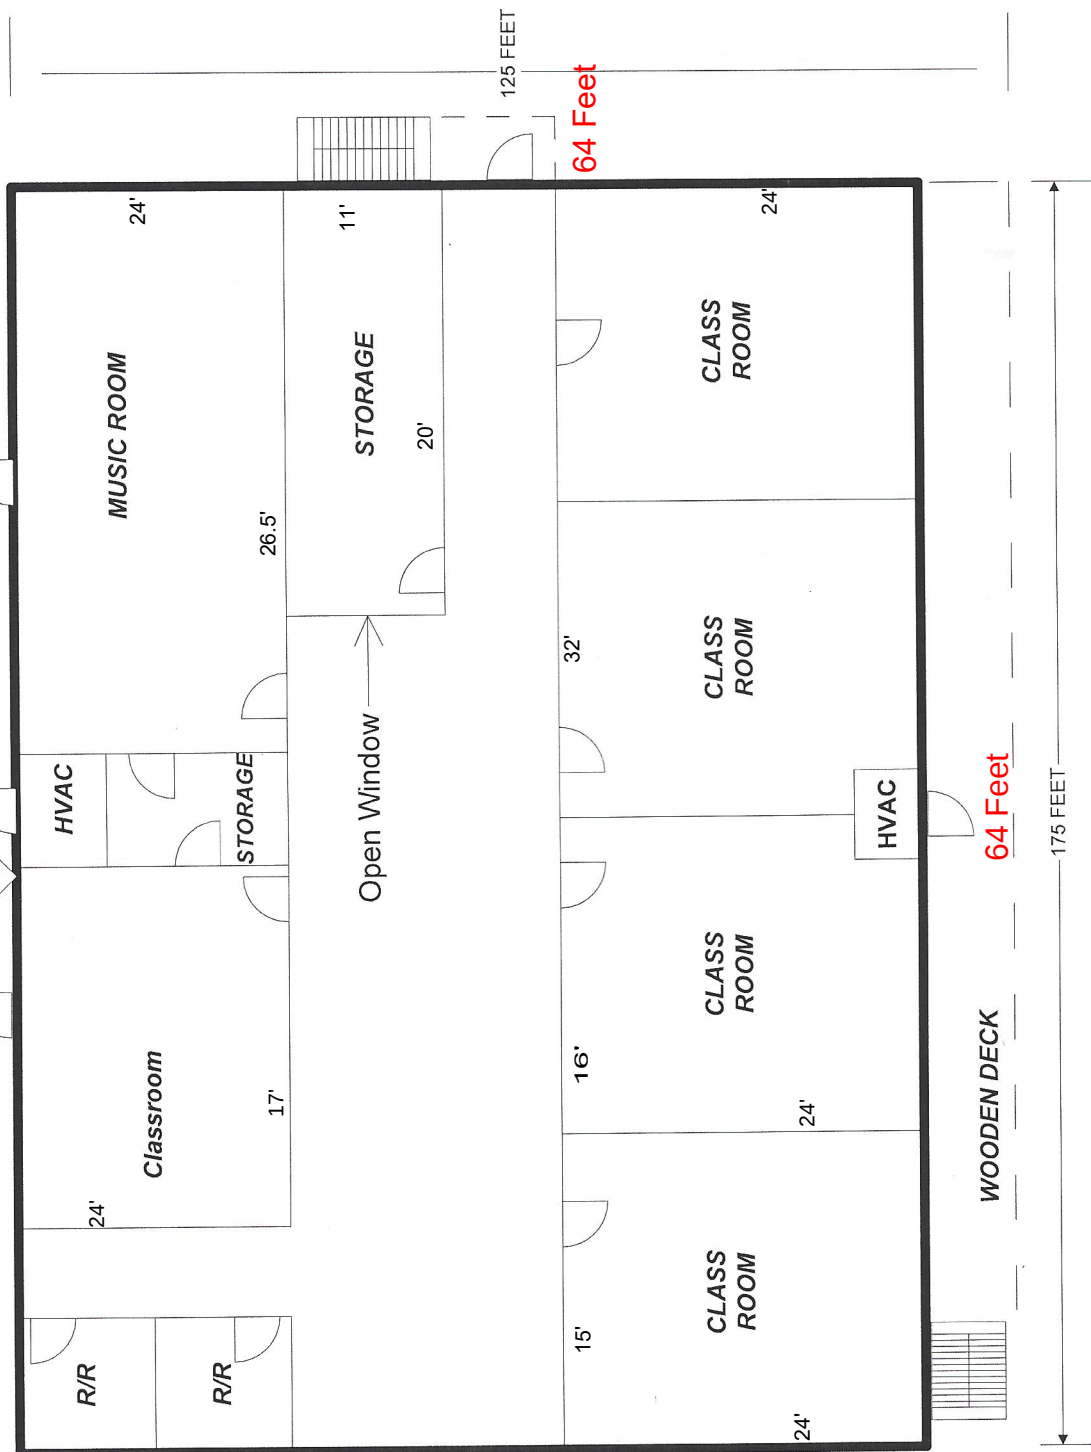

SIDE ONE
FACES THE REAR
OF THE CHURCH

64 Feet

64 Feet

175 FEET




TRAILER

NS

152 LONGVIEW ROAD

Updated by: P Hitch
Date: 11/30/2015
SCALE: None

FCP	Fire Alarm Control Panel	2-Way FDC	Electrical Meter	Automatic Sprinkler - Fully Sprinklered	Emergency Light
K	Knock Box / Keys	Single Door	Gas Line / Meter	Non - Sprinklered	Riser Valve
O & Y Valve	Hydrazine	Hydrazine	electrical panel	Automatic Sprinkler - Partially Sprinklered	Fire Door
Radioactive	Hazards	Hazards	Doors	Overhead Door	Fluid Pump
Bi-hazard	Scuttle Hole	2 Lane Road	Dimension Line	LP Tank	
	Attic Access				

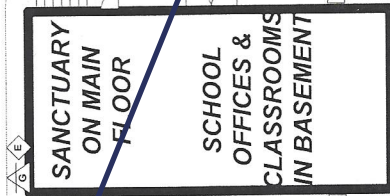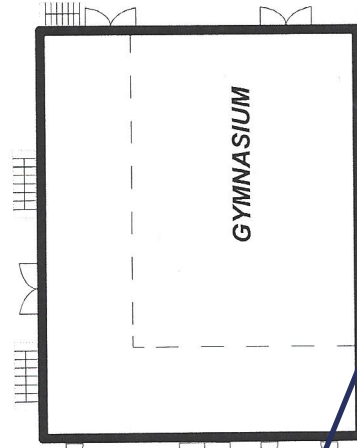

PARKING AREA

PARKING AREA

STUDENT
EVACUATION
AREA


LONGVIEW ROAD

Site Plan	
152 LONGVIEW ROAD	
Updated by: P Hitch	Date: 11/30/2015 SCALE: None

FCP	Fire Alarm Control Panel	2-Way FDC	Electrical Meter	Automatic Sprinkler - Fully Sprinklered	Emergency Light
K	Knox Box/Keys	Single Door	Gas Line/Meter	Non-Sprinklered	Riser Valve
O S & Y Valve	Hydrant	electrical panel	electrical panel	Automatic Sprinkler - Partially Sprinklered	Fire Door
Biohazard	Hazards	Doors	Doors	Overhead Door	Fuel Pump
Radioactive	Scuttle Hole	2 Lane Road	2 Lane Road	Dimension Line	LP Tank
	Attic Access				



BASEMENT
EXTERIOR ACCESS TO SIDES B, C, and D ONLY

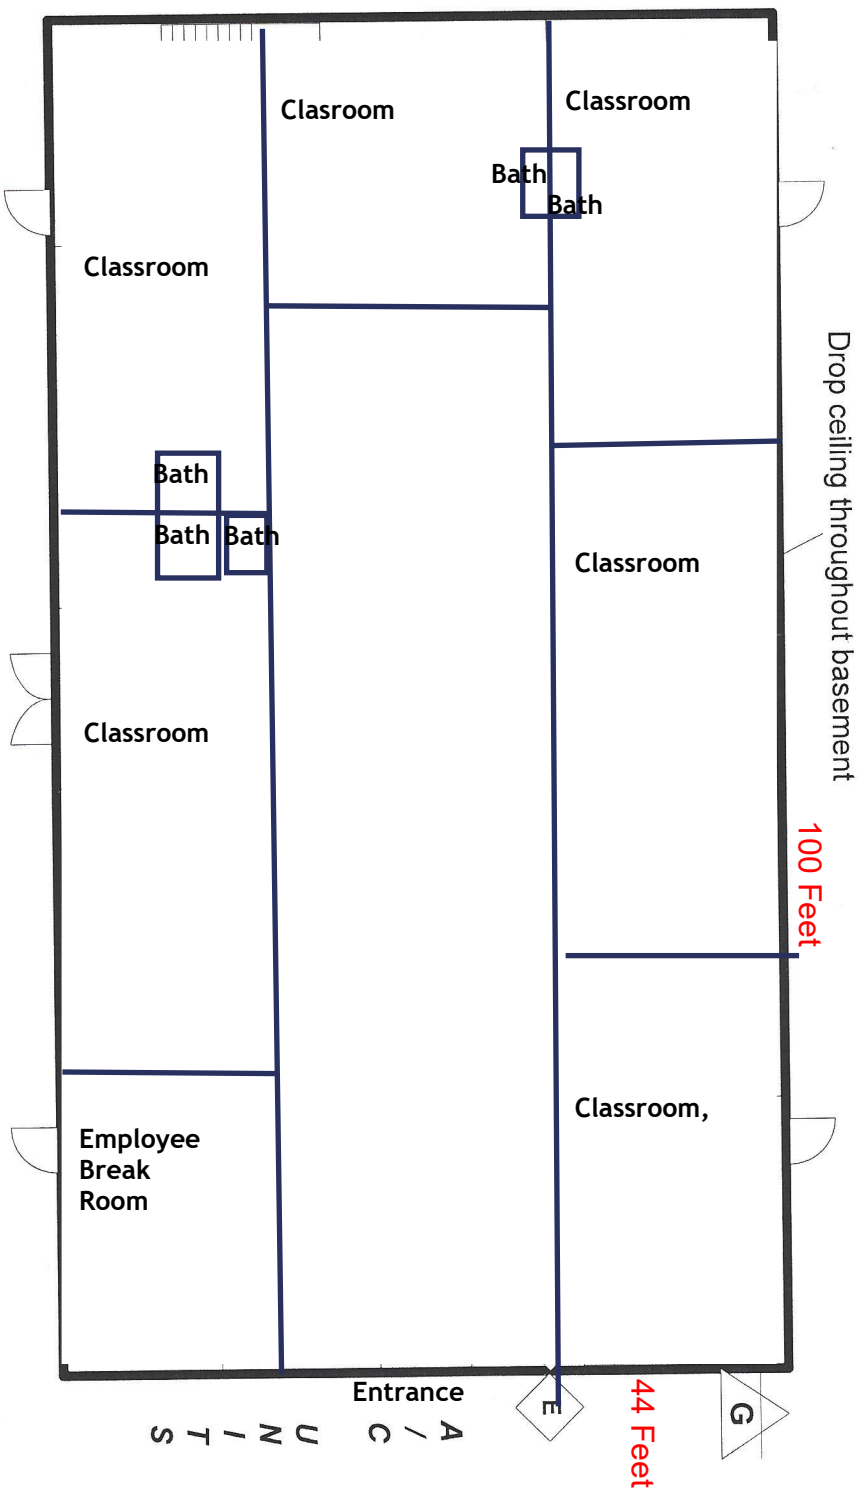

FCP	Fire Alarm Control Panel	9.0	2-Way FDC	Electrical Meter	Automatic Sprinkler - Fully Sprinkled	Emergency Light
	Key Box / Keys	Single Door	Gas Line Meter	Non - Sprinkled	Riser Valve	
24	O.S & V Valve	Hydrant	Electrical panel	Automatic Sprinkler - Partially Sprinkled	Fire Door	
Radioactive	Biohazard	Hazards	Doors	Overhead Door	Fuel Pump	
	Scuttle Hole	Attic Access	2 Lane Road	Dimension Line	LP Tank	

SEE ADDITIONAL DRAWINGS
FOR ENTIRE COMPLEX

NS BASEMENT: SCHOOL PORTION

152 LONGVIEW ROAD

Updated by: P. Hitch

Date: 11/30/2015
SCALE: None