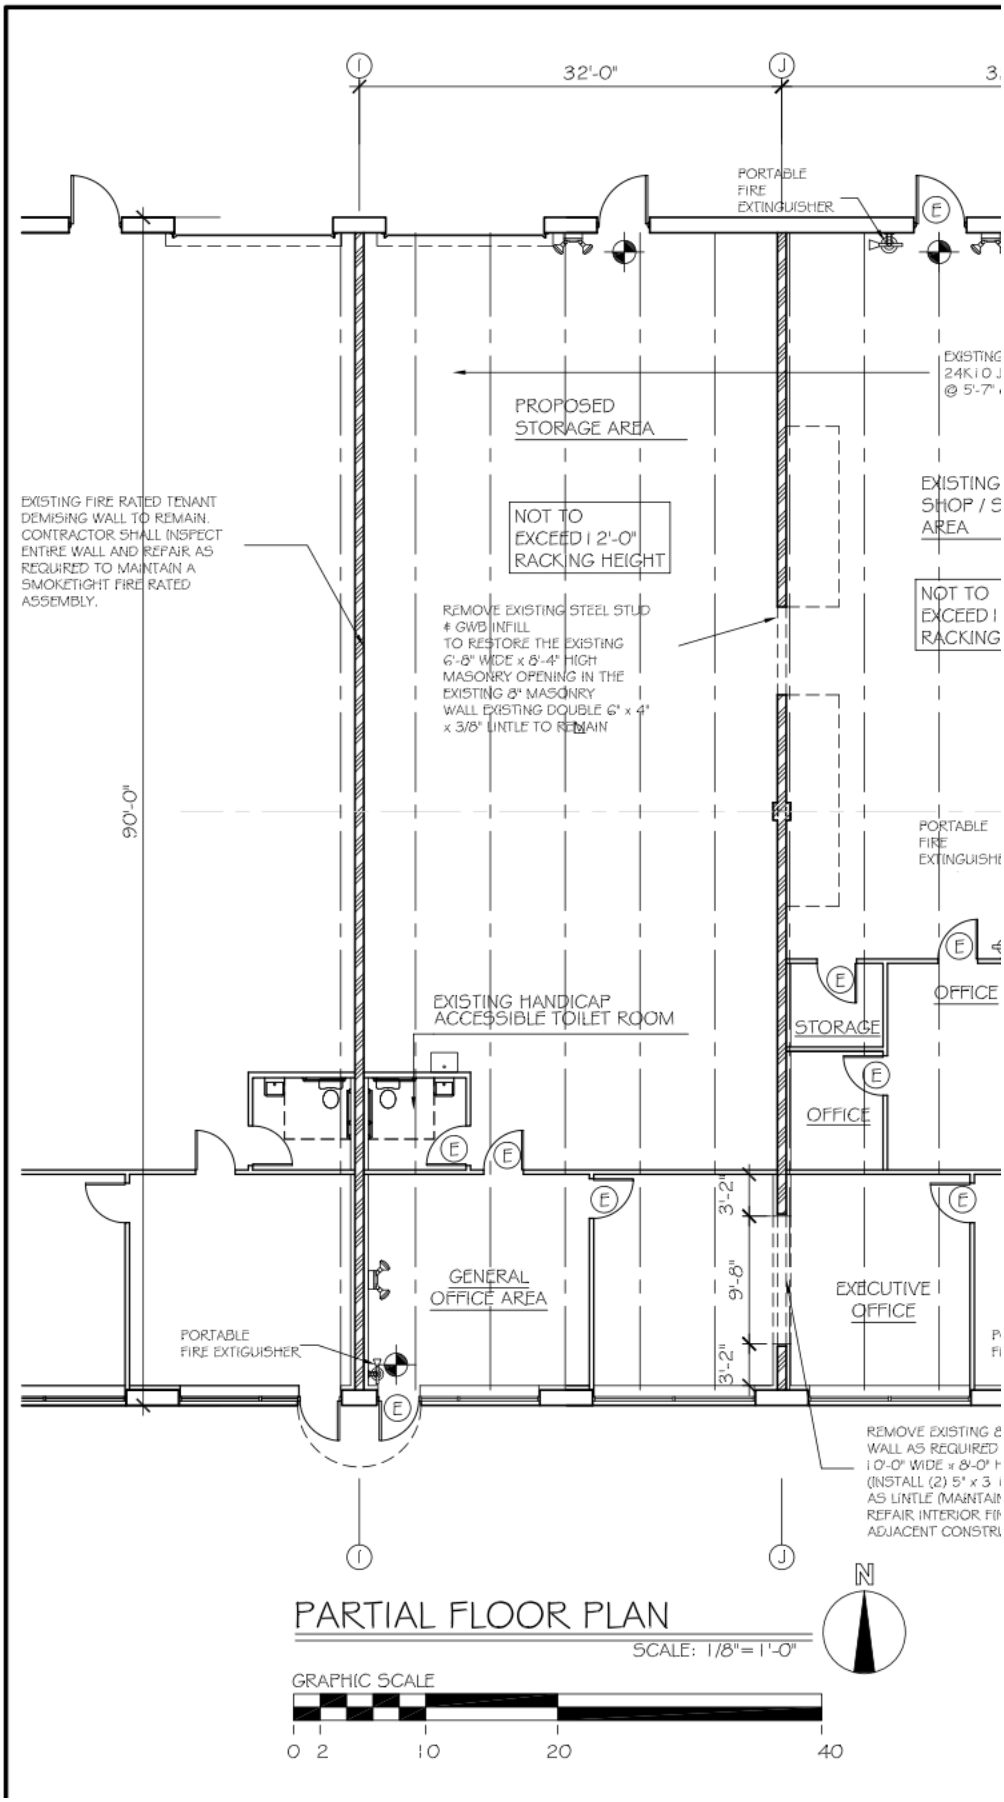
I
32'-0"
J
PORTABLE FIRE EXTINGUISHER
E
PROPOSED STORAGE AREA
NOT TO EXCEED 12'-0" RACKING HEIGHT
EXISTING FIRE RATED TENANT DEMISING WALL TO REMAIN. CONTRACTOR SHALL INSPECT ENTIRE WALL AND REPAIR AS REQUIRED TO MAINTAIN A SMOKETIGHT FIRE RATED ASSEMBLY.
REMOVE EXISTING STEEL STUD & GWB INFILL TO RESTORE THE EXISTING 6'-8" WIDE x 8'-4" HIGH MASONRY OPENING IN THE EXISTING 8" MASONRY WALL EXISTING DOUBLE 6" x 4" x 3/8" LINTLE TO REMAIN
90'-0"
EXISTING HANDICAP ACCESSIBLE TOILET ROOM
STORAGE
OFFICE
OFFICE
3'-2"
9'-8"
3'-2"
GENERAL OFFICE AREA
EXECUTIVE OFFICE
PORTABLE FIRE EXTIGUISHER
N
PARTIAL FLOOR PLAN
SCALE: 1/8"=1'-0"
GRAPHIC SCALE
0 2 10 20 40